

MECHANICAL SPECIFICATIONS (DIVISIONS 22 AND 23)

BASIC MECHANICAL REQUIREMENTS
FURNISH LABOR, MATERIALS, AND EQUIPMENT NECESSARY FOR COMPLETION OF WORK UNLESS INDICATED OR NOTED OTHERWISE. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH LOCAL AND STATE ORDINANCES AND THE INTERNATIONAL MECHANICAL CODE...

SUBMITTALS FOR REVIEW

DISINFECTION OF DOMESTIC WATER PIPING SYSTEM
PRIOR TO STARTING WORK VERIFY SYSTEM IS COMPLETE, FLUSHED AND CLEAN. ENSURE PH OF WATER TO BE TREATED IS BETWEEN 7.4 AND 7.6 BY ADDING ALKALI (CAUSTIC SODA OR SODA ASH) OR ACID (HYDROCHLORIC)...

TESTING

TESTING
SANITARY SEWER & VENT: TEST ALL BUILDING SANITARY SEWER & VENT PIPING TO ENSURE SYSTEM IS WATER TIGHT. A WATER TEST SHALL BE APPLIED TO THE DRAINAGE AND VENT SYSTEMS EITHER IN ITS ENTIRETY OR IN SECTIONS...

DEMOLITION

DEMOLITION
DEMOLITION OF EXISTING MECHANICAL SYSTEMS AND EQUIPMENT IN REMODELED AREAS SHALL BE PROVIDED FOR BY THIS CONTRACTOR. THE CONTRACTOR SHALL REMOVE EQUIPMENT, PIPING, DUCTWORK, ETC. AS INDICATED ON DRAWINGS...

EXISTING UTILITIES AND PIPING

EXISTING UTILITIES AND PIPING
THE LOCATIONS OF EXISTING CONCEALED LINES AND CONNECTION POINTS HAVE BEEN INDICATED AS CLOSELY AS POSSIBLE FROM AVAILABLE INFORMATION. THE CONTRACTOR SHALL ASSUME THAT SUCH CONNECTION POINTS ARE WITHIN A 14 FOOT (17) RADIUS OF THE INDICATED LOCATION...

RECORD DRAWINGS

RECORD DRAWINGS
RECORD DIFFERENCES BETWEEN INSTALLED WORK AND CONTRACT DOCUMENTS ON A SET MARKED UP TO BE FURNISHED TO THE OWNER'S REPRESENTATIVE.

TESTING, ADJUSTING, AND BALANCING

TESTING, ADJUSTING, AND BALANCING
AIR AND WATER DISTRIBUTION SYSTEMS SHALL BE BALANCED TO FLOW RATES AND CONDITIONS SPECIFIED AND INDICATED ON THE DRAWINGS (AND IN ACCORDANCE WITH THE STATE ENERGY CODE) BY AN AABC OR NEBB CERTIFIED BALANCING AGENCY...

OPERATING AND MAINTENANCE INSTRUCTIONS

OPERATING AND MAINTENANCE INSTRUCTIONS
CONTRACTOR SHALL INSTRUCT THE OWNER OF THE PROPER OPERATION OF EQUIPMENT FURNISHED BY THIS CONTRACTOR AND SHALL PREPARE MANUALS DESCRIBING THE SERVICING AND MAINTENANCE REQUIREMENTS FOR ALL MECHANICAL EQUIPMENT...

SEISMIC

SEISMIC
SEISMIC SUPPORTS ARE REQUIRED FOR THE PLUMBING AND HVAC SYSTEMS IN THE PROJECT. SEISMIC CONDITIONS: SEISMIC DESIGN CATEGORY D, MECHANICAL SYSTEM IMPORTANCE FACTOR FOR NATURAL GAS PIPING AND GAS FIRED EQUIPMENT...

CUT AND PATCH

CUT AND PATCH
ALL CUTTING AND PATCHING REQUIRED FOR INSTALLATION OF MECHANICAL SYSTEMS AND EQUIPMENT SHALL BE THE RESPONSIBILITY OF THIS CONTRACTOR. NO CUTTING OF STRUCTURAL MEMBERS SHALL BE ALLOWED WITHOUT STRUCTURAL ENGINEERS APPROVAL...

EQUIPMENT

EQUIPMENT
INSTALL IN COMPLETE ACCORDANCE WITH MANUFACTURER REQUIREMENTS.

MECHANICAL IDENTIFICATION

MECHANICAL IDENTIFICATION
IDENTIFY ALL SCHEDULED EQUIPMENT WITH PLASTIC NAMEPLATES AND CONTROL PANELS (LAMINATED THREE-LAYER PLASTIC WITH ENGRAVED WHITE LETTERS ON BLACK BACKGROUND). SMALL DEVICES, SUCH AS IN-LINE PUMPS, MAY BE IDENTIFIED WITH TAGS...

SEVES/SEALS

SEVES/SEALS
WHERE PIPING AND DUCTWORK PENETRATES A ROOF, FLOOR OR WALL, CLOSE OFF SPACE BETWEEN PIPE AND SLEEVE WITH 3 LB. FIBERGLASS INSULATION AND ELASTOMERIC FIRE RATED SEALANT (AIR TIGHT). THIS APPLIES TO ALL ROOFS, WALLS OR FLOORS REGARDLESS OF FIRE RATINGS...

ACCESS DOORS

ACCESS DOORS
PROVIDE ACCESS DOORS IN WALL/SHAFT SURFACES AND DUCTWORK AS REQUIRED TO ALLOW FOR SERVICE TO EQUIPMENT SUCH AS VALVES, ACTUATORS, FIRE DAMPERS, FANS, PUMPS ETC.

DUCTWORK

DUCTWORK
SUPPLY & RETURN LOW PRESSURE SHEET METAL DUCTWORK SHALL BE GALVANIZED STEEL CONSTRUCTED IN STRICT ACCORDANCE WITH THE LATEST EDITION OF SMACNA STANDARDS FOR HVAC DUCT CONSTRUCTION AND WITH THE INTERNATIONAL MECHANICAL CODE UNLESS INDICATED OTHERWISE...

FLEXIBLE DUCTWORK

FLEXIBLE DUCTWORK
THERMAFLEX MODEL G-9M OR EQUAL, UL 181 CLASS 1 FLEXIBLE AIR DUCT COMPLYING WITH NFPA STANDARD 90A. FACTORY FABRICATED ASSEMBLY COMPOSED OF AN INNER LINER, COATED WOUND SPRING STEEL WIRE...

DUCT SEALANT

DUCT SEALANT
SEALANT CLASS A: HARDCAST, DURADYNE, DUCTMATE, OR APPROVED EQUAL. NON-HARDENING, WATER RESISTANT, FIRE RESISTIVE, COMPATIBLE WITH MATING MATERIALS. SEALANT SHALL BE COMPOSITELY TESTED FOR FIRE AND SMOKE HAZARD RATINGS...

DUCT INSULATION

DUCT INSULATION
GLASS FIBER, FLEXIBLE BLANKET (DUCT WRAP); MANUFACTURERS: JOHNS MANVILLE, R-SERIES MICROLITE, CERTANTEED, STANDARD DUCTWRAP, KNAUF, DUCTWRAP, OWENS CORNING, ALL SERVICE DUCTWRAP OR EQUAL INSULATION...

DUCT ACCESSORIES

DUCT ACCESSORIES
MANUAL VOLUME DAMPERS SHALL BE OPPOSED BLADE OR SINGLE BLADE AS INDICATED ON THE DRAWINGS AND SHALL BE COMPLETE WITH EXTERNAL LOCKING QUADRANTS. OPPOSED BLADE DAMPERS SHALL BE RUSKIN OR APPROVED EQUAL...

REFRIGERANT PIPING

REFRIGERANT PIPING
FURNISH AND INSTALL COMPLETE REFRIGERANT PIPING SYSTEMS. PIPE: NITROGENIZED TYPE ACR HARD DRAWN OR ANNEALED, ASTM B280 AND ANSI B9.1 HARD DRAWN (AND BRAZED) OR ANNEALED. SINGLE ZONE SYSTEMS LESS THAN 2 TONS MAY UTILIZE ANNEALED PIPING.

PLUMBING FIXTURES AND EQUIPMENT

PLUMBING FIXTURES AND EQUIPMENT
ALL FIXTURES AND RELATED EQUIPMENT SHALL BE EQUAL TO ITEMS SCHEDULED ON THE PLANS. ALL EQUIPMENT SHALL BE NEW AND OF THE LATEST AND MOST CURRENT LINE OF THE SPECIFIED MODEL.

DOMESTIC HOT AND COLD WATER PIPING-ABOVE GRADE

DOMESTIC HOT AND COLD WATER PIPING-ABOVE GRADE
SHALL BE TYPE "K" OR "L" COPPER CONFORMING TO ASTM-B88 WITH ASME B16.22 WROUGHT COPPER AND BRONZE FITTINGS USING 95% NO LEAD SWEAT FITTINGS.

LAB ACID RESISTANCE WASTE & VENT ABOVE GRADE (EXCEPT RETURN AIR PLENUMS)

LAB ACID RESISTANCE WASTE & VENT ABOVE GRADE (EXCEPT RETURN AIR PLENUMS)
CPVC PIPE: SPEARS LAB WASTE PIPING, ASTM F 483
FITTINGS: CPVC
JOINTS: ASTM D 3311, SOLVENT WELD WITH ASTM F 483 SOLVENT CEMENT

PROCESSED WATER SYSTEMS FOR LABORATORY FACILITIES

PROCESSED WATER SYSTEMS FOR LABORATORY FACILITIES
PIPE & FITTINGS: HIGH PURITY POLYPROPYLENE, PVDF (FOR AIR PLENUMS), OR SCHEDULE 80 LOW EXTRACTION PVC. SPEARS, GEORGE FISCHER, GSR, PPS, RYAN HERCO, ASAHI OR APPROVED EQUAL. FITTINGS TO INCLUDE FUSION COALS, BUTT OR SOCKET WELD...

NATURAL GAS PIPING

NATURAL GAS PIPING
FURNISH AND INSTALL COMPLETE GAS PIPING SYSTEMS. PIPE: BLACK STEEL SCHEDULE 40, TYPE E OR S, GRADE B, SEAMLESS BELVELED ENDS. FITTINGS: MALLEABLE IRON, ASME B16.3, JOINTS: NFPA 54, THREADED, ANSI B31.2.

PIPE HANGERS

PIPE HANGERS
PIPE HANGERS SHALL BE GRINNELL, FEE AND MASON OR APPROVED EQUAL. INSTALL PIPING SO AS NOT TO INTERFERE WITH ANY OTHER BUILDING COMPONENTS OR MECHANICAL/ELECTRICAL SYSTEMS. PROVIDE WITH SUITABLE INSULATION...

ABOVE GRADE SANITARY WASTE AND VENT PIPING

ABOVE GRADE SANITARY WASTE AND VENT PIPING
WASTE PIPING SHALL BE SERVICE WEIGHT CAST IRON WITH HEAVY DUTY NO-HUB FITTINGS UTILIZING 4-BAND STAINLESS STEEL AND NEOPRENE GASKETS. VENT PIPING SHALL BE SCHEDULE 40 CAST IRON WITH NO-HUB FITTINGS OR SOLID CURE SCHEDULE 40 PVC (DWV)...

INDIRECT WASTE PIPING

INDIRECT WASTE PIPING
SHALL BE TYPE "L" COPPER (OR PVC) CONFORMING TO ASTM B88 WITH ASME B16.22 WROUGHT COPPER AND BRONZE FITTINGS USING 95% NO LEAD SWEAT FITTINGS.

PLUMBING SPECIAL TIES

PLUMBING SPECIAL TIES
BALL VALVES: CLASS 150, 400 PSI. BRONZE TWO PIECE BODE. CHROME PLATED BRASS BALL, REGULAR PORT, TEFLON SEATS AND STUFFING BOX RING. BLOW-OUT PROOF STEM, LEVER HANDLE, SOLDER OR THREADED ENDS WITH UNION...

PIPING INSULATION

PIPING INSULATION
INSULATE HYDRONIC AND PLUMBING PIPING SYSTEMS INCLUDING PIPE FITTINGS AND VALVES. INSULATION SHALL BE GLASS FIBER WITH ALL SERVICE VAPOR BARRIER JACKET AND SHALL BE GREENGUARD CERTIFIED.

LAB AND MEDICAL PIPING LEGEND

Table with 2 columns: Symbol and Description. Includes symbols for Carbon Filtered Water, Carbon Dioxide, Deionized Water, Distilled Water, Lab Compressed Air, Lab Vent (Acid Resistant Vent), Lab Waste (Acid Resistant Waste), Medical Air, Medical Vacuum, Nitrogen, Nitrous Oxide, Non-Potable Cold Water, Non-Potable Hot Water, Non-Potable Hot Water Return, Non-Potable Soft Cold Water, Oxygen, Pure Water Supply, Pure Water Return, Reverse Osmosis, Vacuum.

HYDRONIC PIPING LEGEND

Table with 2 columns: Symbol and Description. Includes symbols for Condensate Drain, Refrigerant Gas, Refrigerant Liquid.

PLUMBING/PIPING LEGEND

Table with 2 columns: Symbol and Description. Includes symbols for Domestic Cold Water (CW), Domestic Hot Water (HW), Domestic Recirculated Water (HWR), Dry Stand Pipe, Fire, Fire Department Connection Pipe, Indirect Waste (Above Floor), Natural Gas (P/WC, Unless Otherwise Noted), Overflow Drain Line, Roof Drain Line, Storm Drain, Sanitary Sewer, Solar Heating Return, Solar Heating Supply, Vent, Waste, Vent (Below Grade), Waste (Below Grade).

PIPING SYMBOLS

Table with 2 columns: Symbol and Description. Includes symbols for Valve (2-way, 3-way, Globe/Throttling, Solenoid, Shutoff), Air Separator, Angle Valve, Automatic Air Vent, Check Valve, Circuit Setter, Circulating Pump, Clean-Out (Below Floor or Grade), Clean-Out (Flush to Floor or Grade), Cross, Reducer, Elbow, Elbow Down, Elbow Up, Expansion Joint, Fire Department Connection, Flexible Connection, Floor Drain (Round or Square), Floor Sink, Flow Direction, Flow Direction and Slope, Flow Switch, Gauge Cook, Hose Bibb/Wall Hydrant, Manhole/Driveway, Manual Air Vent, Penetration (Floor or Wall), Pipe Anchor, Pipe Continues Although Not Drawn, Pipe Guide, Pipe Sleeve.

HVAC SYMBOLS

Table with 2 columns: Symbol and Description. Includes symbols for Rectangular Supply Duct, Rectangular Return Duct, Rectangular Exhaust Duct, Rectangular OSA Duct, Round Supply Duct, Round Return Duct, Round Exhaust Duct, Round OSA Duct, Flat Oval Supply Duct, Ductwork with Internal Lining, Aluminum/Stainless Steel Ductwork, Air Transfer Duct Sleeve, Flexible Duct, Duct Offset and Direction, Round/Oval Mitered Ell, Turning Vanes, Turning Vanes, Air Split Takeoff, Balance/Volume Damper, Motorized Control Damper, Fire/Smoke Damper, Rectangular Duct Size (Width x Depth), Circular Duct Diameter, Flat Oval Duct Size (Width x Depth).

TEMPERATURE CONTROL SYMBOLS

Table with 2 columns: Symbol and Description. Includes symbols for Airflow Monitor, Averaging Sensor, Carbon Dioxide Sensor, Carbon Monoxide Sensor, Coil (Heating/Cooling), Lab Vent (Acid Resistant Vent), Control Point, Current Transducer, Damper Motor Actuator Identification, Differential Pressure Switch, Duct Smoke Detector, End Switch, Equipment Identification, Filter, Flow Switch, Humidity Sensor, In-Line Device, Interface Relay, Light (Pilot or Annunciator), Light with Audio Annunciator, Low Limit Freeze/STAT, Motor Starter, Motor Starter with Current Sensing Relay, Motorized Damper, Occupancy Sensor, Point Sensor, Pressure Sensor, Pump, Refrigerant Monitor Sensor, Solenoid Valve Actuator, Static Pressure Sensor, Switch, Switch with Guarded Cover, Switch with Pilot Light, Temperature Transmitter, Temperature Transmitter with Sun Shield, Thermostat, Thermostat & CO2, Thermostat and Humidity Sensor, Thermostat, CO2 and Humidity Sensor, Thermowell, Valve Motor Actuator Identification, Waterflow Meter, 2-Way Modulating Valve, 3-Way Modulating Valve, 2-OR-3-Way Modulating Valve (See Plans or Details for Requirements).

SYMBOLS & ABBREVIATIONS

Table with 2 columns: Symbol and Description. Includes General Symbols (Key Note, Equipment Identifier, Detail Number, Detail Reference, Sheet Number, Matched Sheet Number, Current Sheet Number, Room Name and Number, Connection to Existing, Revision Number, Section Number, Sheet Reference, North Arrow, Center Line) and Line/Lightweight Legend (New Work, Existing to Remain, Demolition, Future Work).

LINEWEIGHT LEGEND

GENERAL ABBREVIATIONS

Table with 2 columns: Symbol and Description. Lists abbreviations for materials (Aluminum, Steel, Copper, etc.), equipment (Pump, Fan, Valve, etc.), and units (Foot, Inch, etc.).

MECHANICAL ABBREVIATIONS

Table with 2 columns: Symbol and Description. Lists abbreviations for mechanical components and equipment like Air Handling Units, Boilers, Chillers, etc.

PLUMBING SPECIALTIES EQUIPMENT ANNOTATION

Table with 2 columns: Symbol and Description. Lists symbols for Area Drain, Backflow Preventer, Downspout Nozzle, Electronic Trap Primer, Floor Drain, Floor Sink, Freeze Proof Wall Hydrant, Grease Interceptor, etc.

PLUMBING FIXTURES EQUIPMENT ANNOTATION

Table with 2 columns: Symbol and Description. Lists symbols for Bath Tub, Drinking Fountain, Eye Wash, Eye Wash/Safety Shower, Lavatory, Mop Sink, Sink, Shower, Water Closet, etc.

PLUMBING EQUIPMENT ANNOTATION

Table with 2 columns: Symbol and Description. Lists symbols for Air Compressor, Booster Pump, Compression Tank, Hot Water Recirculation Pump, Medical Air Compressor, Medical Vacuum Pump, Sewage Ejector, Storage Tank, Sump Pump, Vacuum Pump, Water Heater, Water Softener, etc.


KNIT logo and contact information: knitstudios.com, 601 W First Ave, Ste 1200, Spokane, WA 99201, USA. Includes a professional engineer seal for Jacob Deery.

ISSUE DATE: 12.20.2024

Table with 2 columns: REV and COMMENT. Includes revision dates and descriptions of changes.

Professional Engineer seal for Jacob Deery, License No. 17163, State of Idaho.

LEGENDS & ABBREVIATIONS & SPECIFICATIONS - MECHANICAL & PLUMBING. FOOD RESEARCH CENTER TI - PHASE 1 (BUILDING #: 005). 860 IDAHO AVE., MOSCOW, ID 83844. UNIVERSITY OF IDAHO. TITLE: PROJECT. CLIENT: JOB NO: 240004. CAPITAL PROJECT NO: CP220034. M0-01.

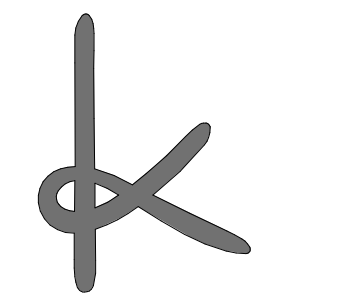

KNIT


knitstudios.com

THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSES OF CONTRACTING, LENDING AND MARKETING THE PROJECT AND AS THE ARCHITECT OF RECORD FOR THE PROJECT RETAINS OWNERSHIP OF THESE DOCUMENTS. ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN, IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT. REPRODUCTION OF THESE DOCUMENTS IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.



ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT
A	1/31/2025	Owner Revisions

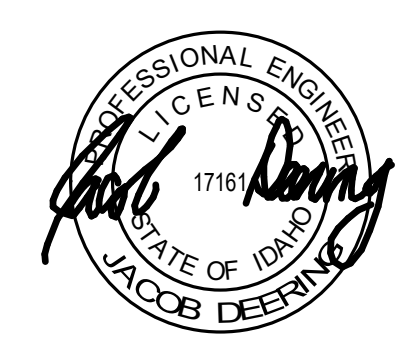


FLOOR PLAN - MECHANICAL
FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE., MOSCOW, ID 83844
UNIVERSITY OF IDAHO


TITLE	PROJECT	CLIENT

JOB NO: **240004**
 CAPITAL PROJECT NO: **CP220034**

M2-11

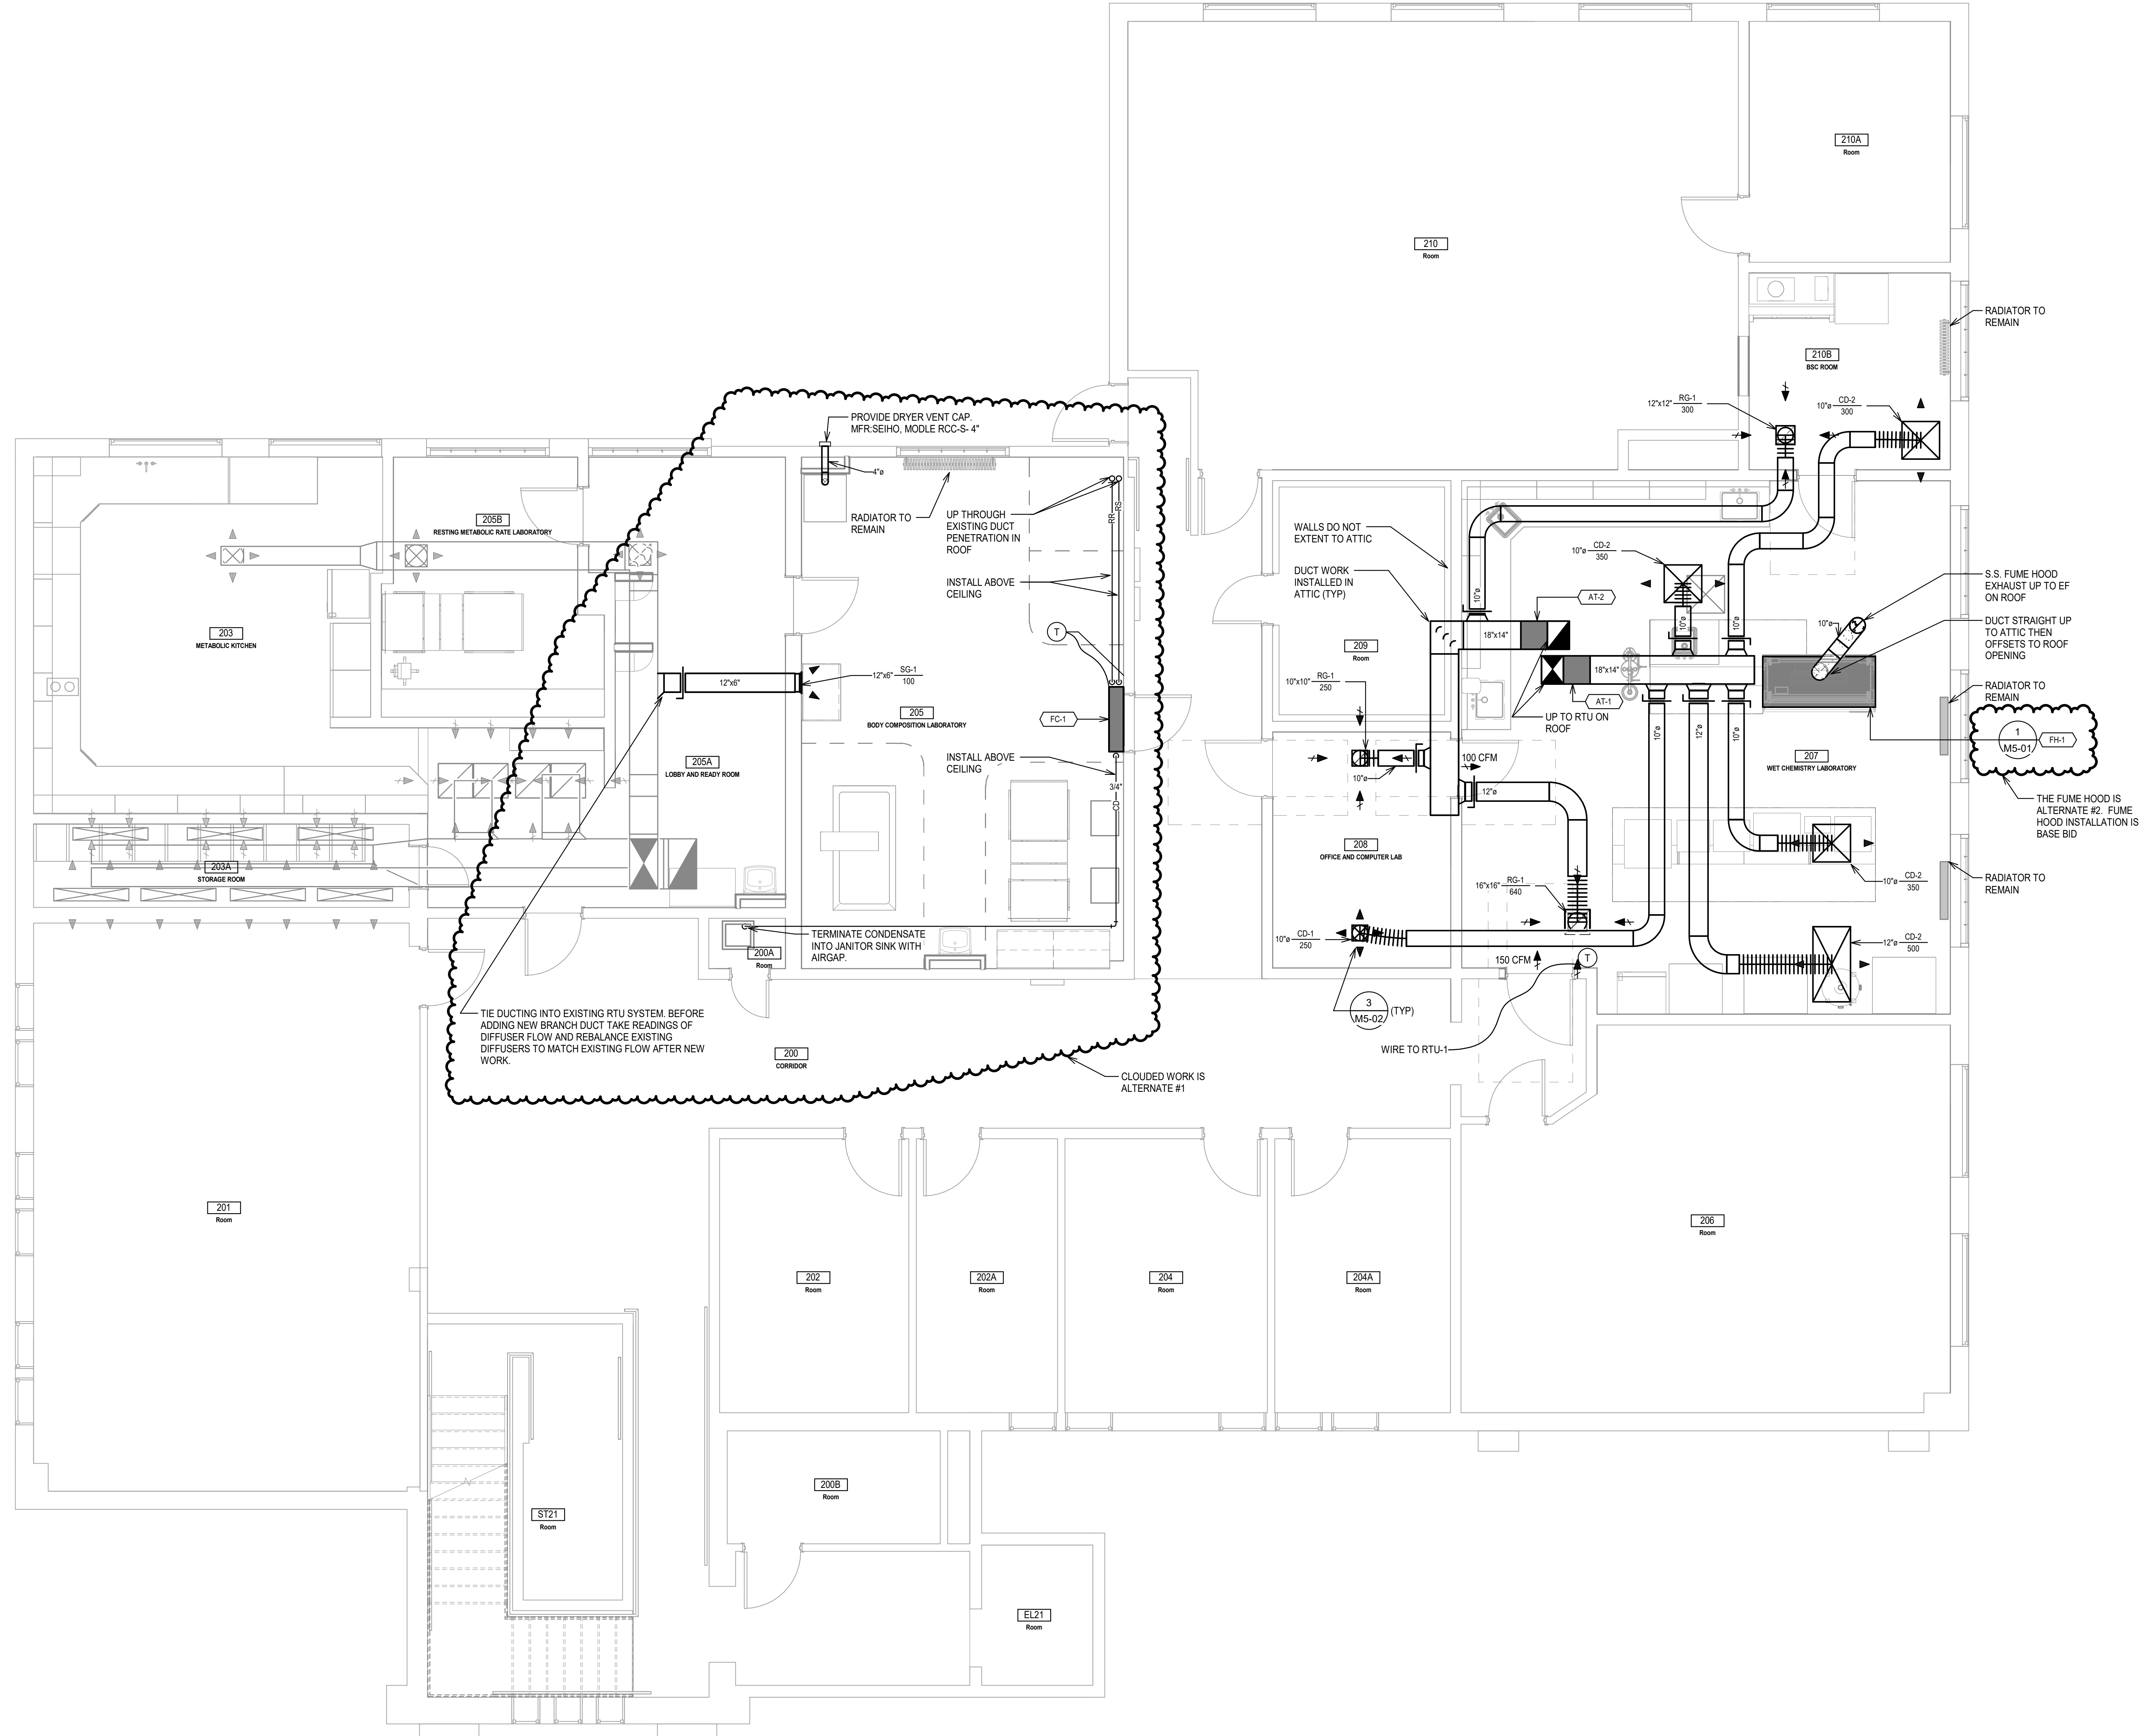

LEVEL 2 - MECHANICAL
 1/4" = 1'-0"

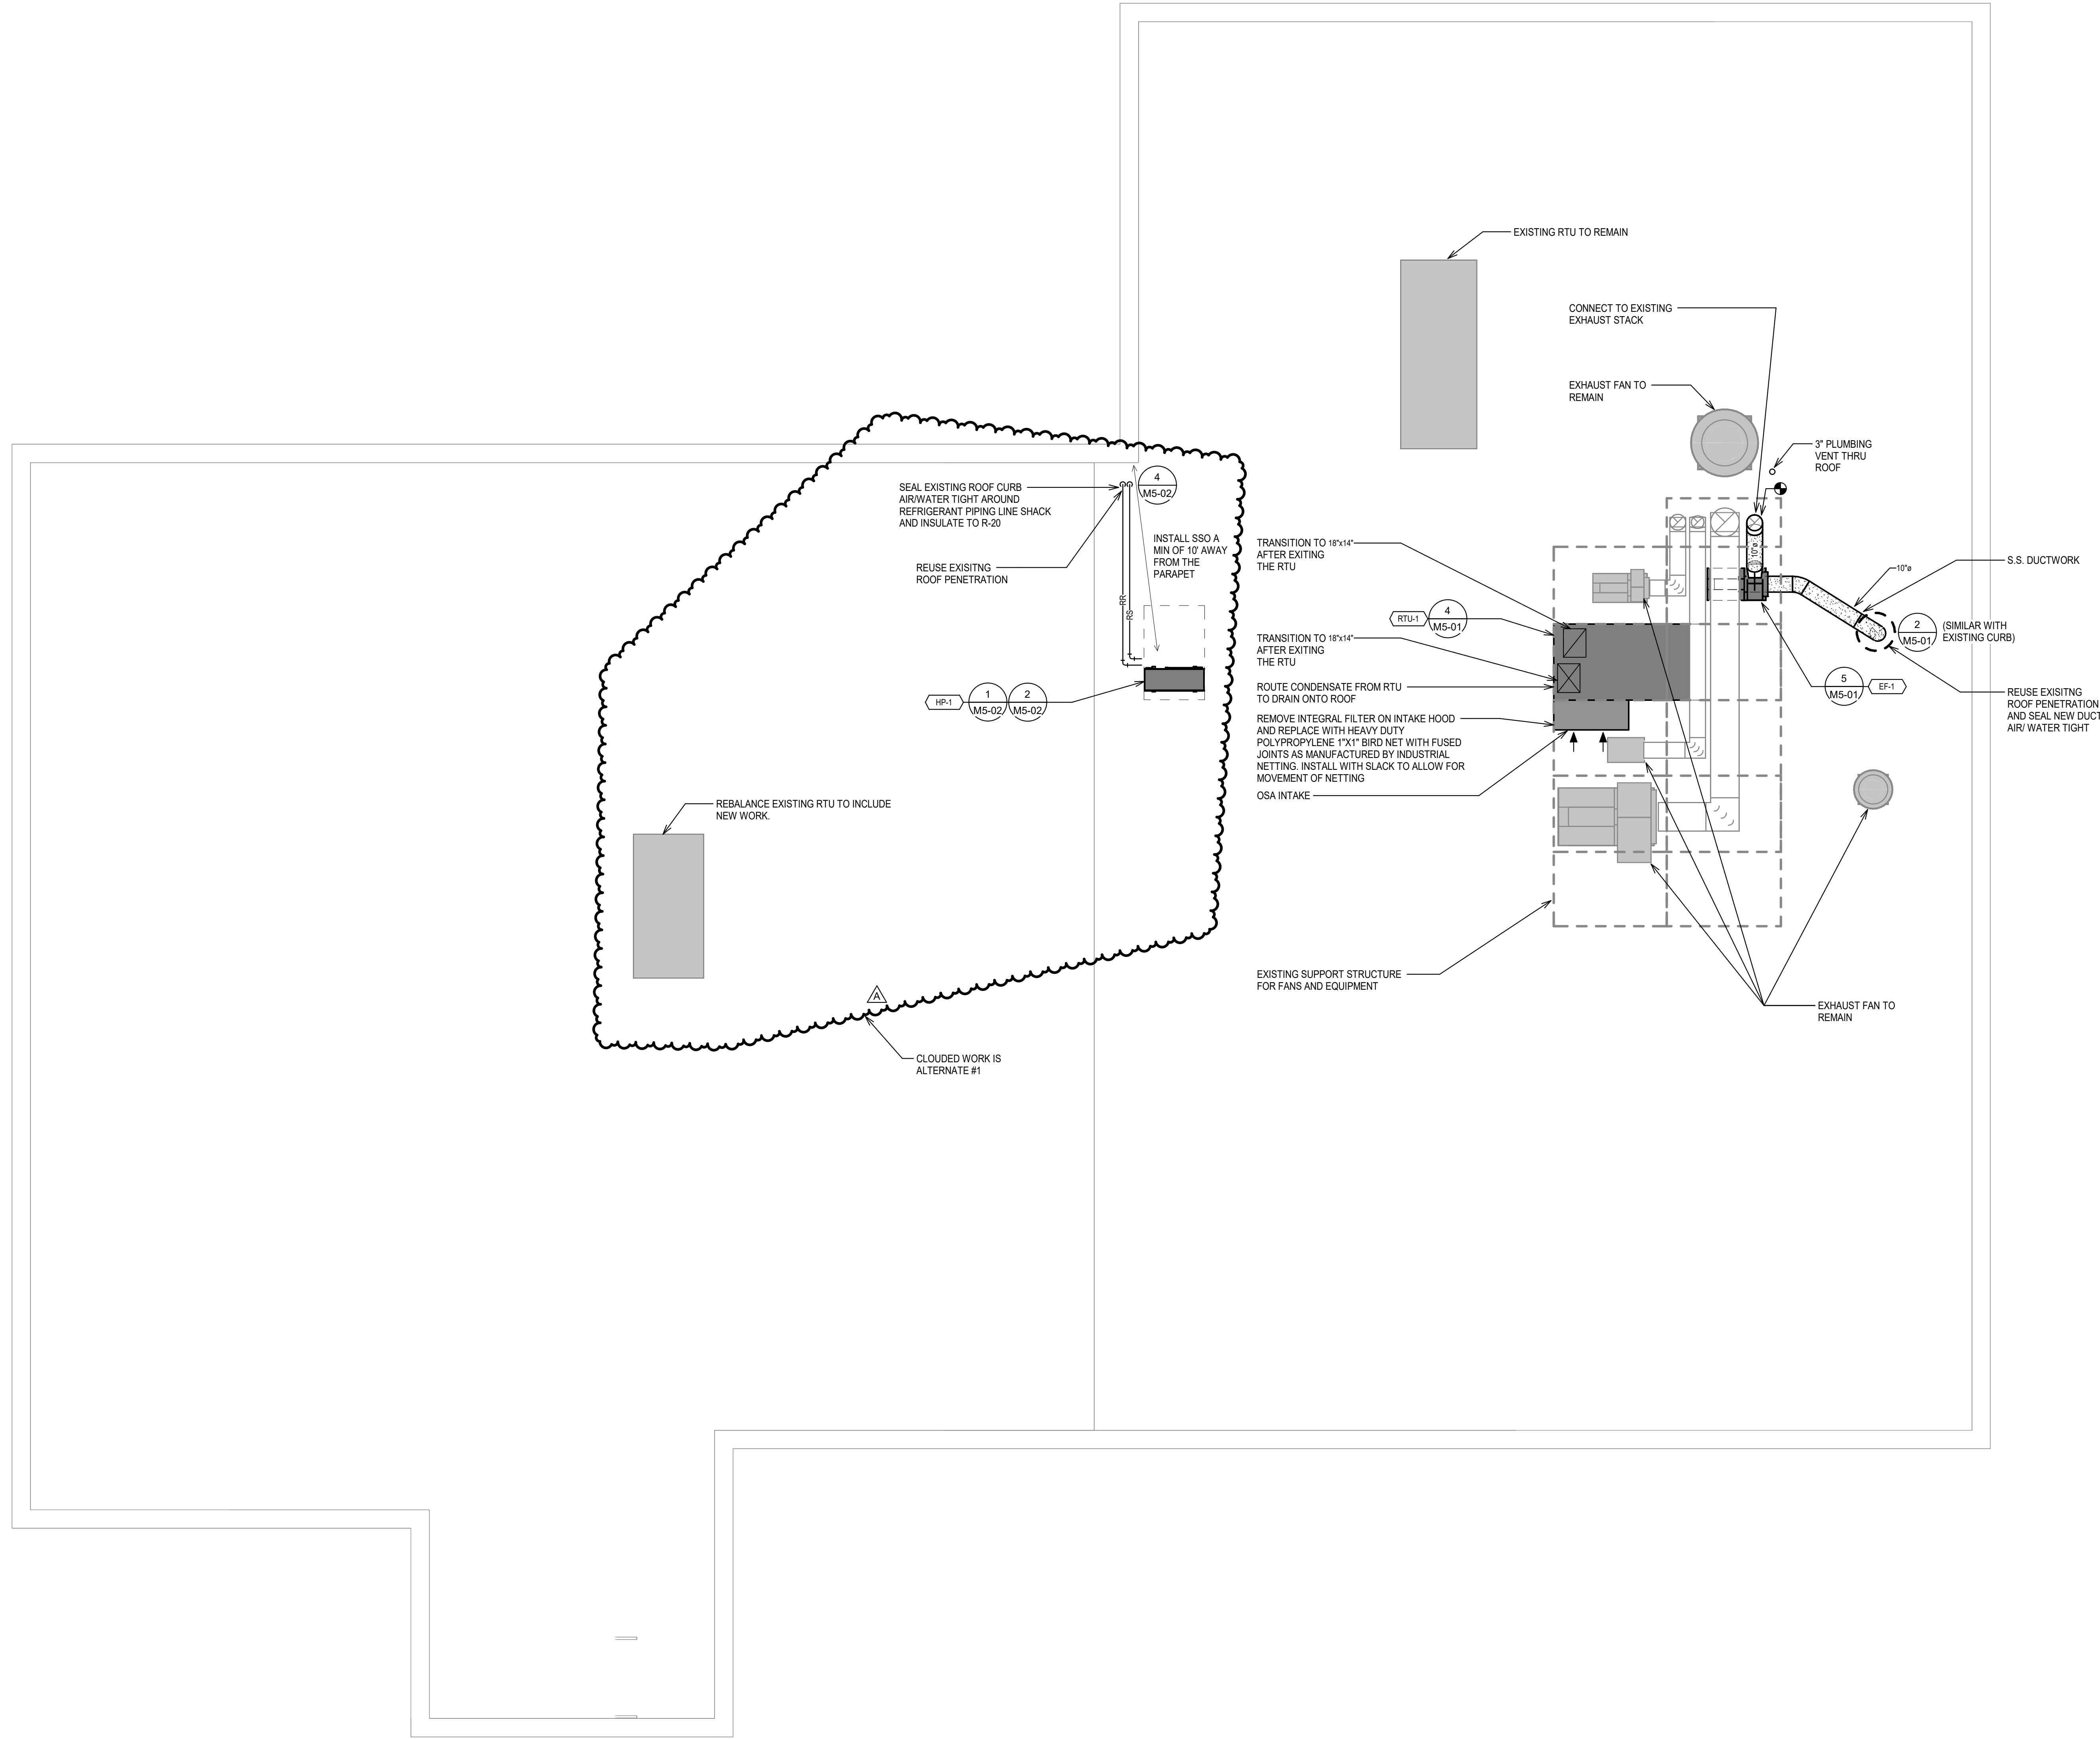

ROOF PLAN - MECHANICAL

1/4" = 1'-0"



knitstudios.com
 THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSE OF CONTRACTING UNDER AND MAINTAINING THE PROJECT AND AS THE ARCHITECT OF RECORD FOR THE PROJECT RETAINS OWNERSHIP OF THESE DOCUMENTS.
 ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY OTHER PARTY WITHOUT THE WRITTEN CONSENT OF KNIT IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.
 REPRODUCTION OF THESE DOCUMENTS IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.



ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT
A	1/31/2025	Owner Revisions









ROOF PLAN - MECHANICAL
FOOD RESEARCH CENTER TI - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE., MOSCOW, ID 83844
UNIVERSITY OF IDAHO

TITLE	PROJECT	CLIENT
ROOF PLAN - MECHANICAL	FOOD RESEARCH CENTER TI - PHASE 1 (BUILDING #: 005)	UNIVERSITY OF IDAHO

JOB NO: **240004**
 CAPITAL PROJECT NO: **CP220034**

M2-12

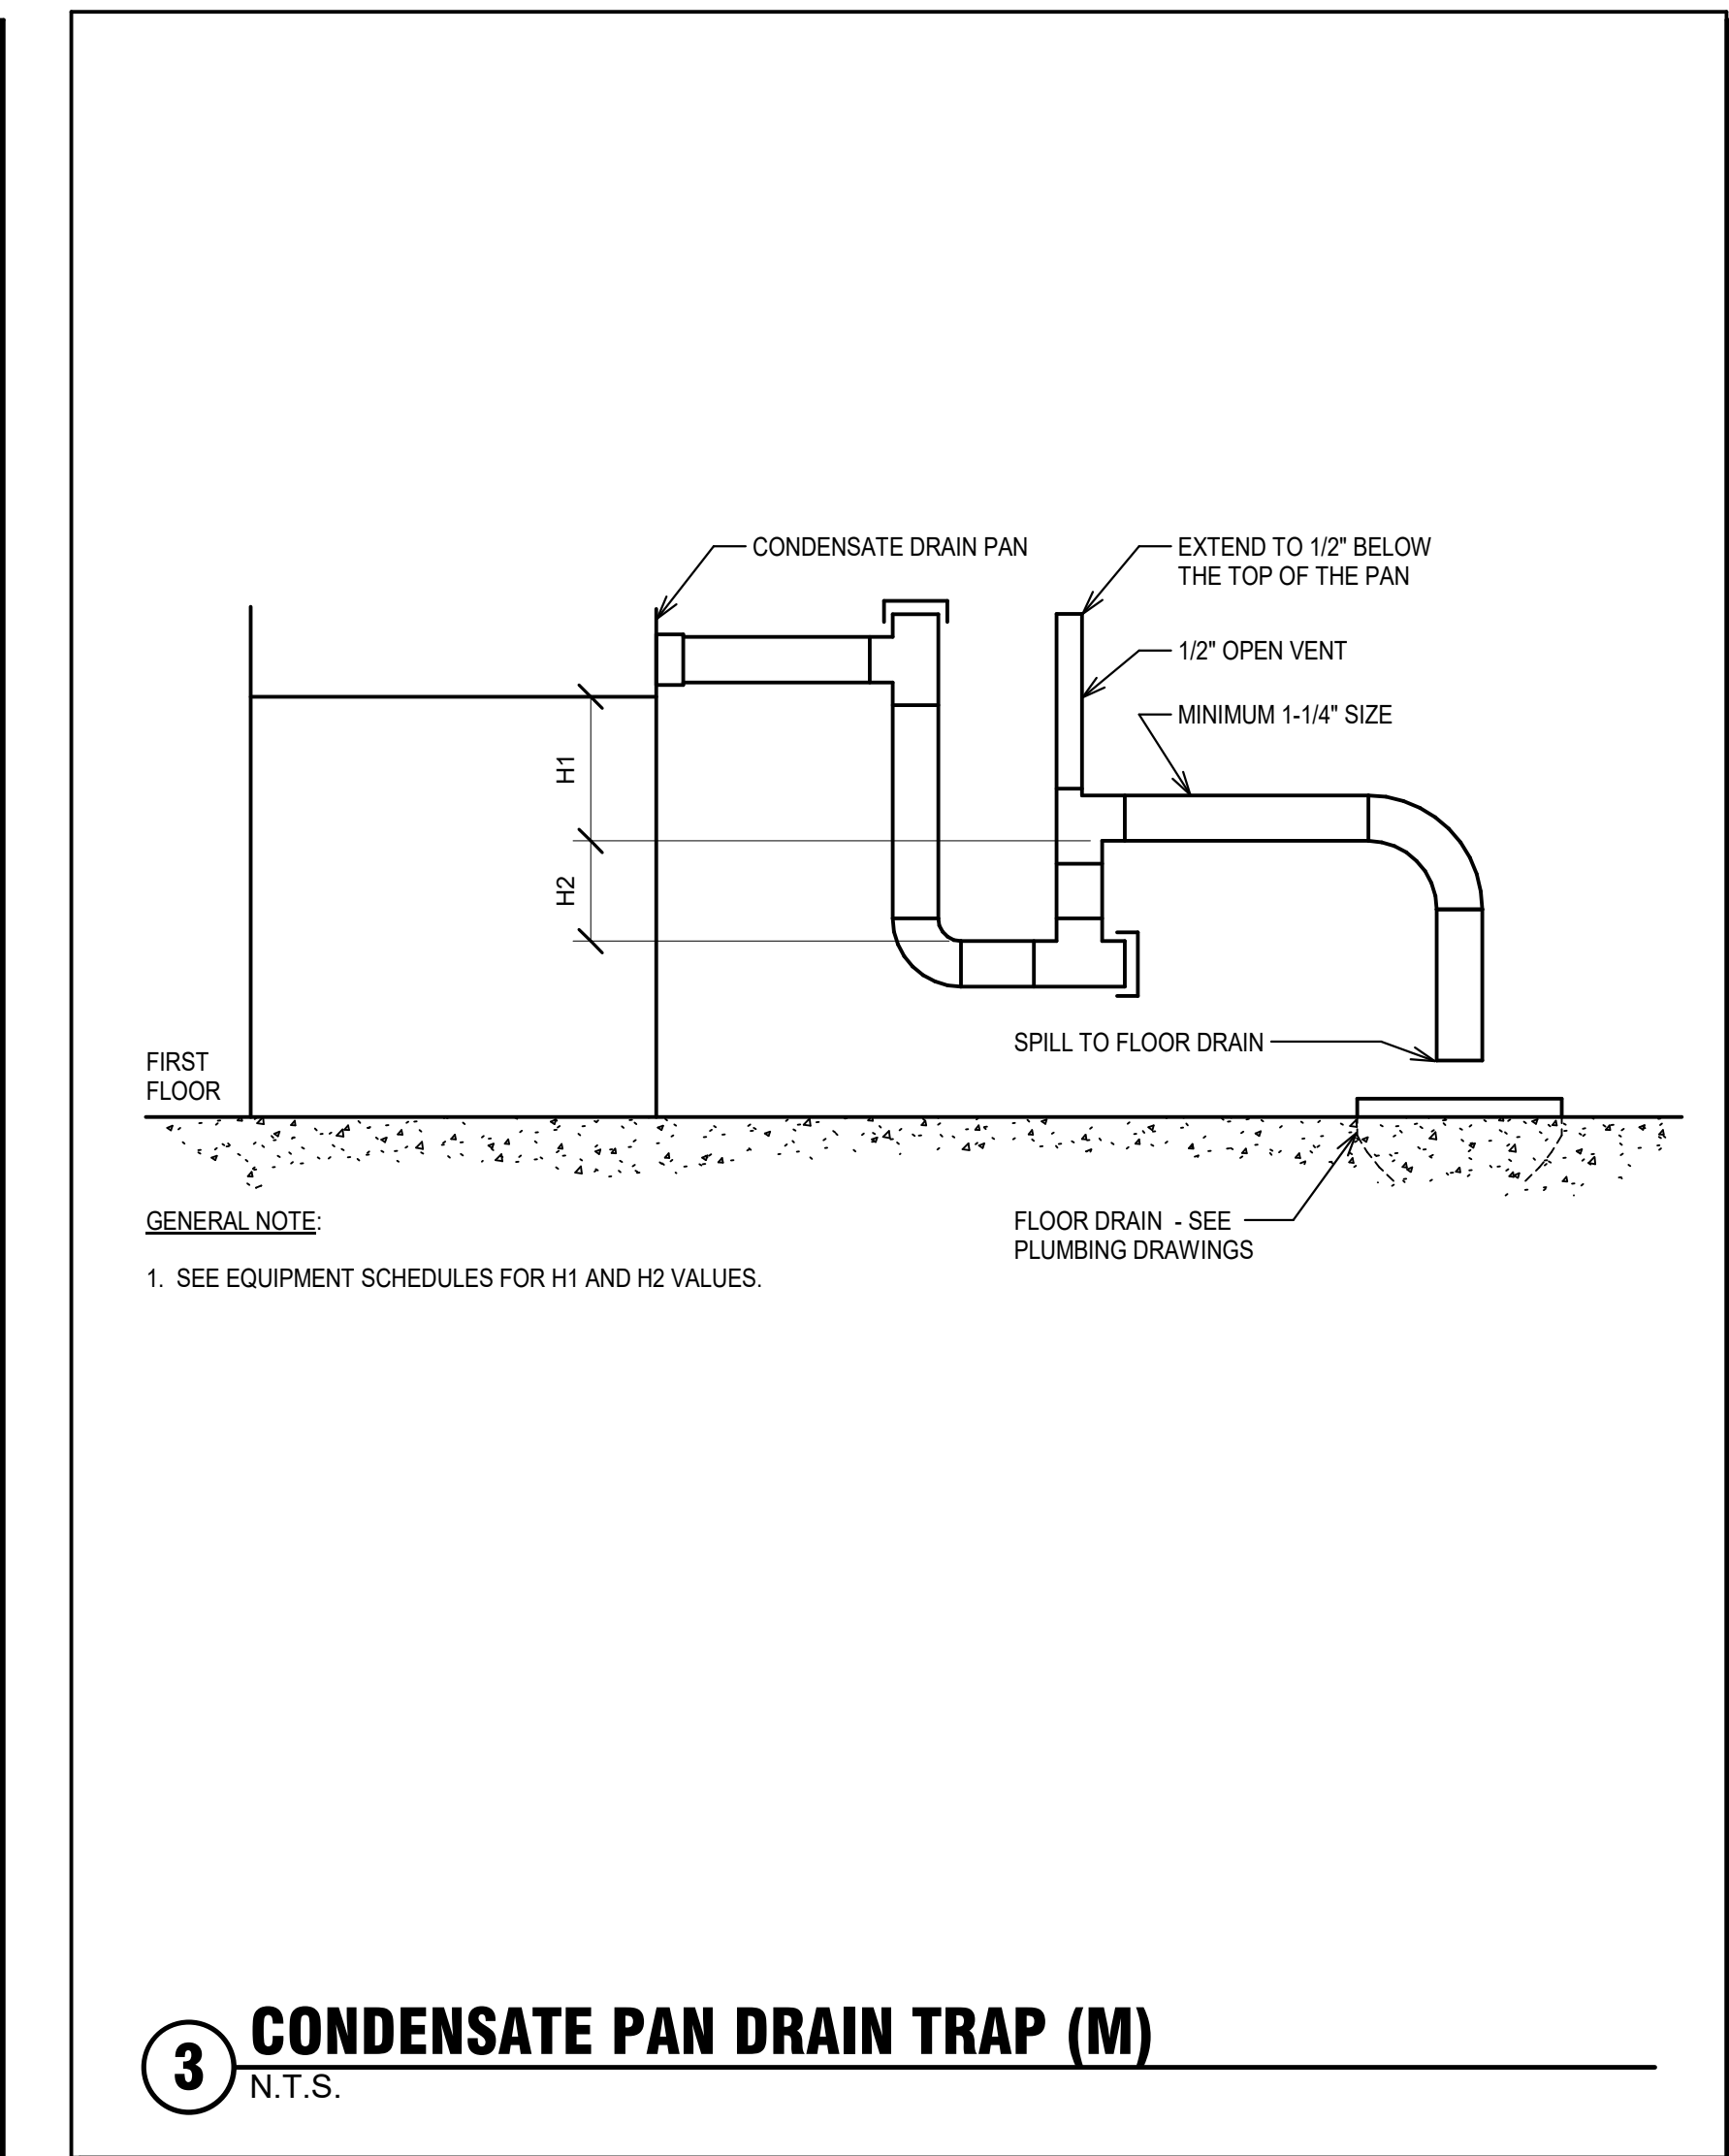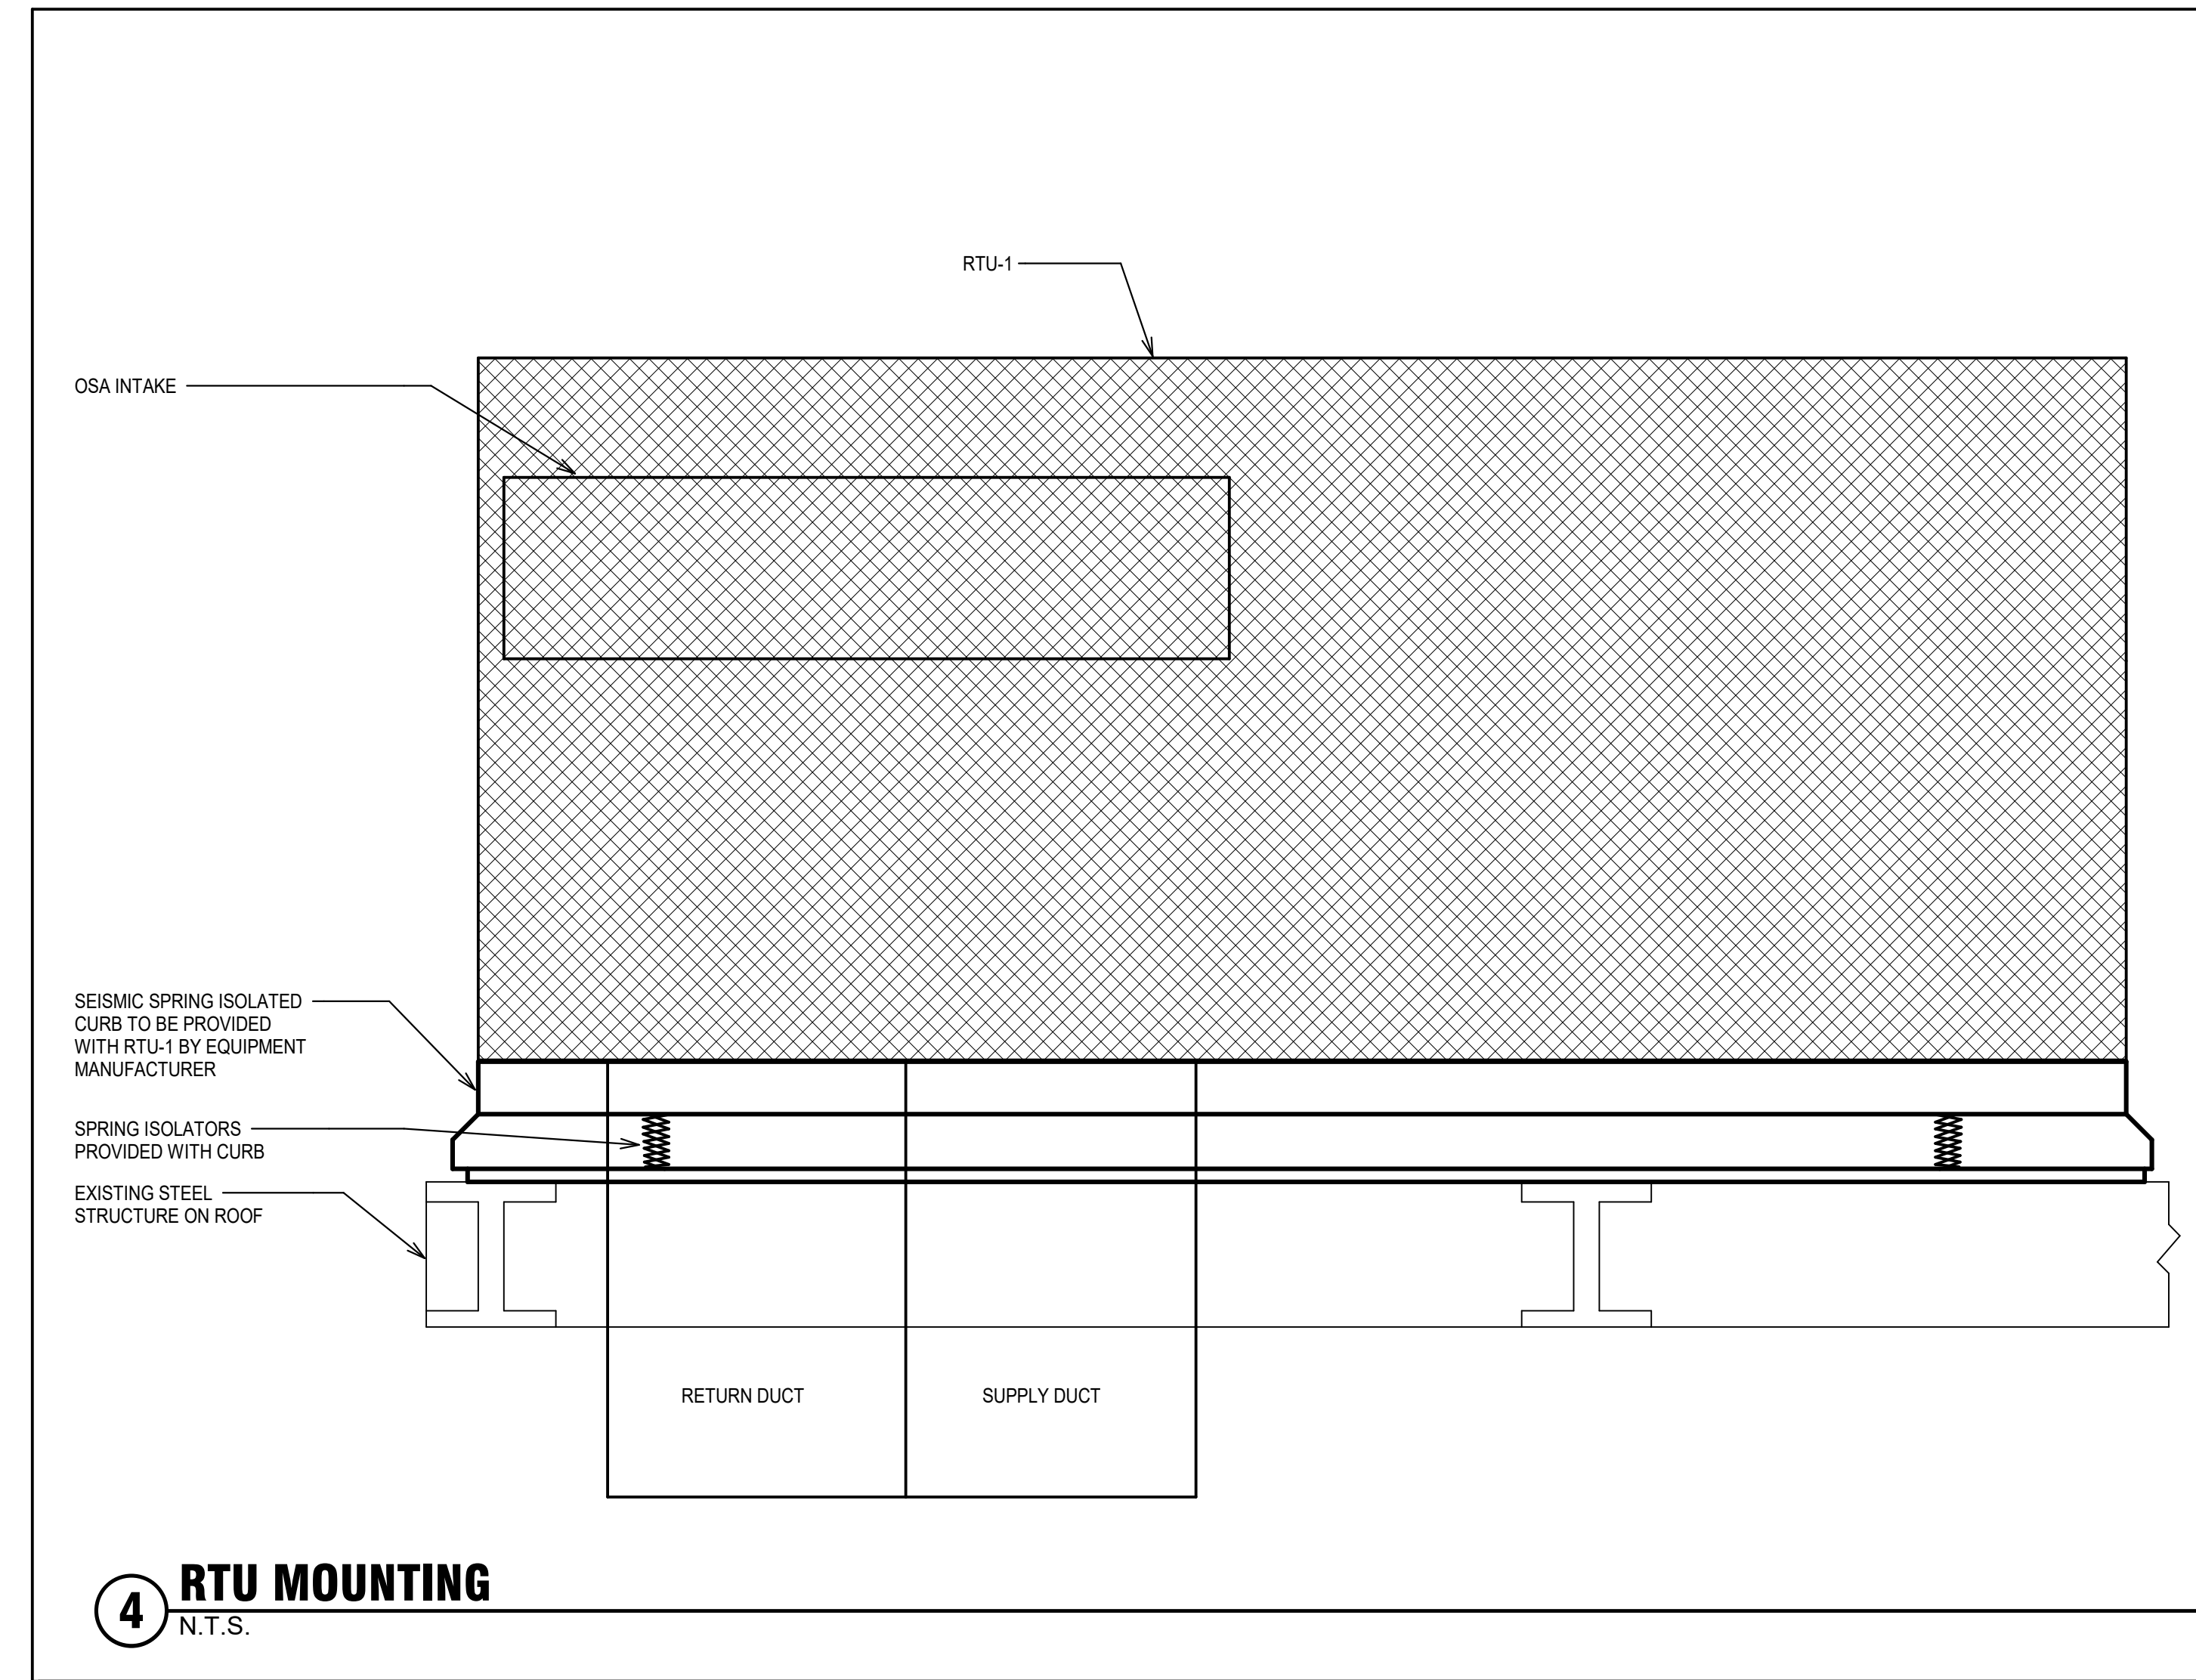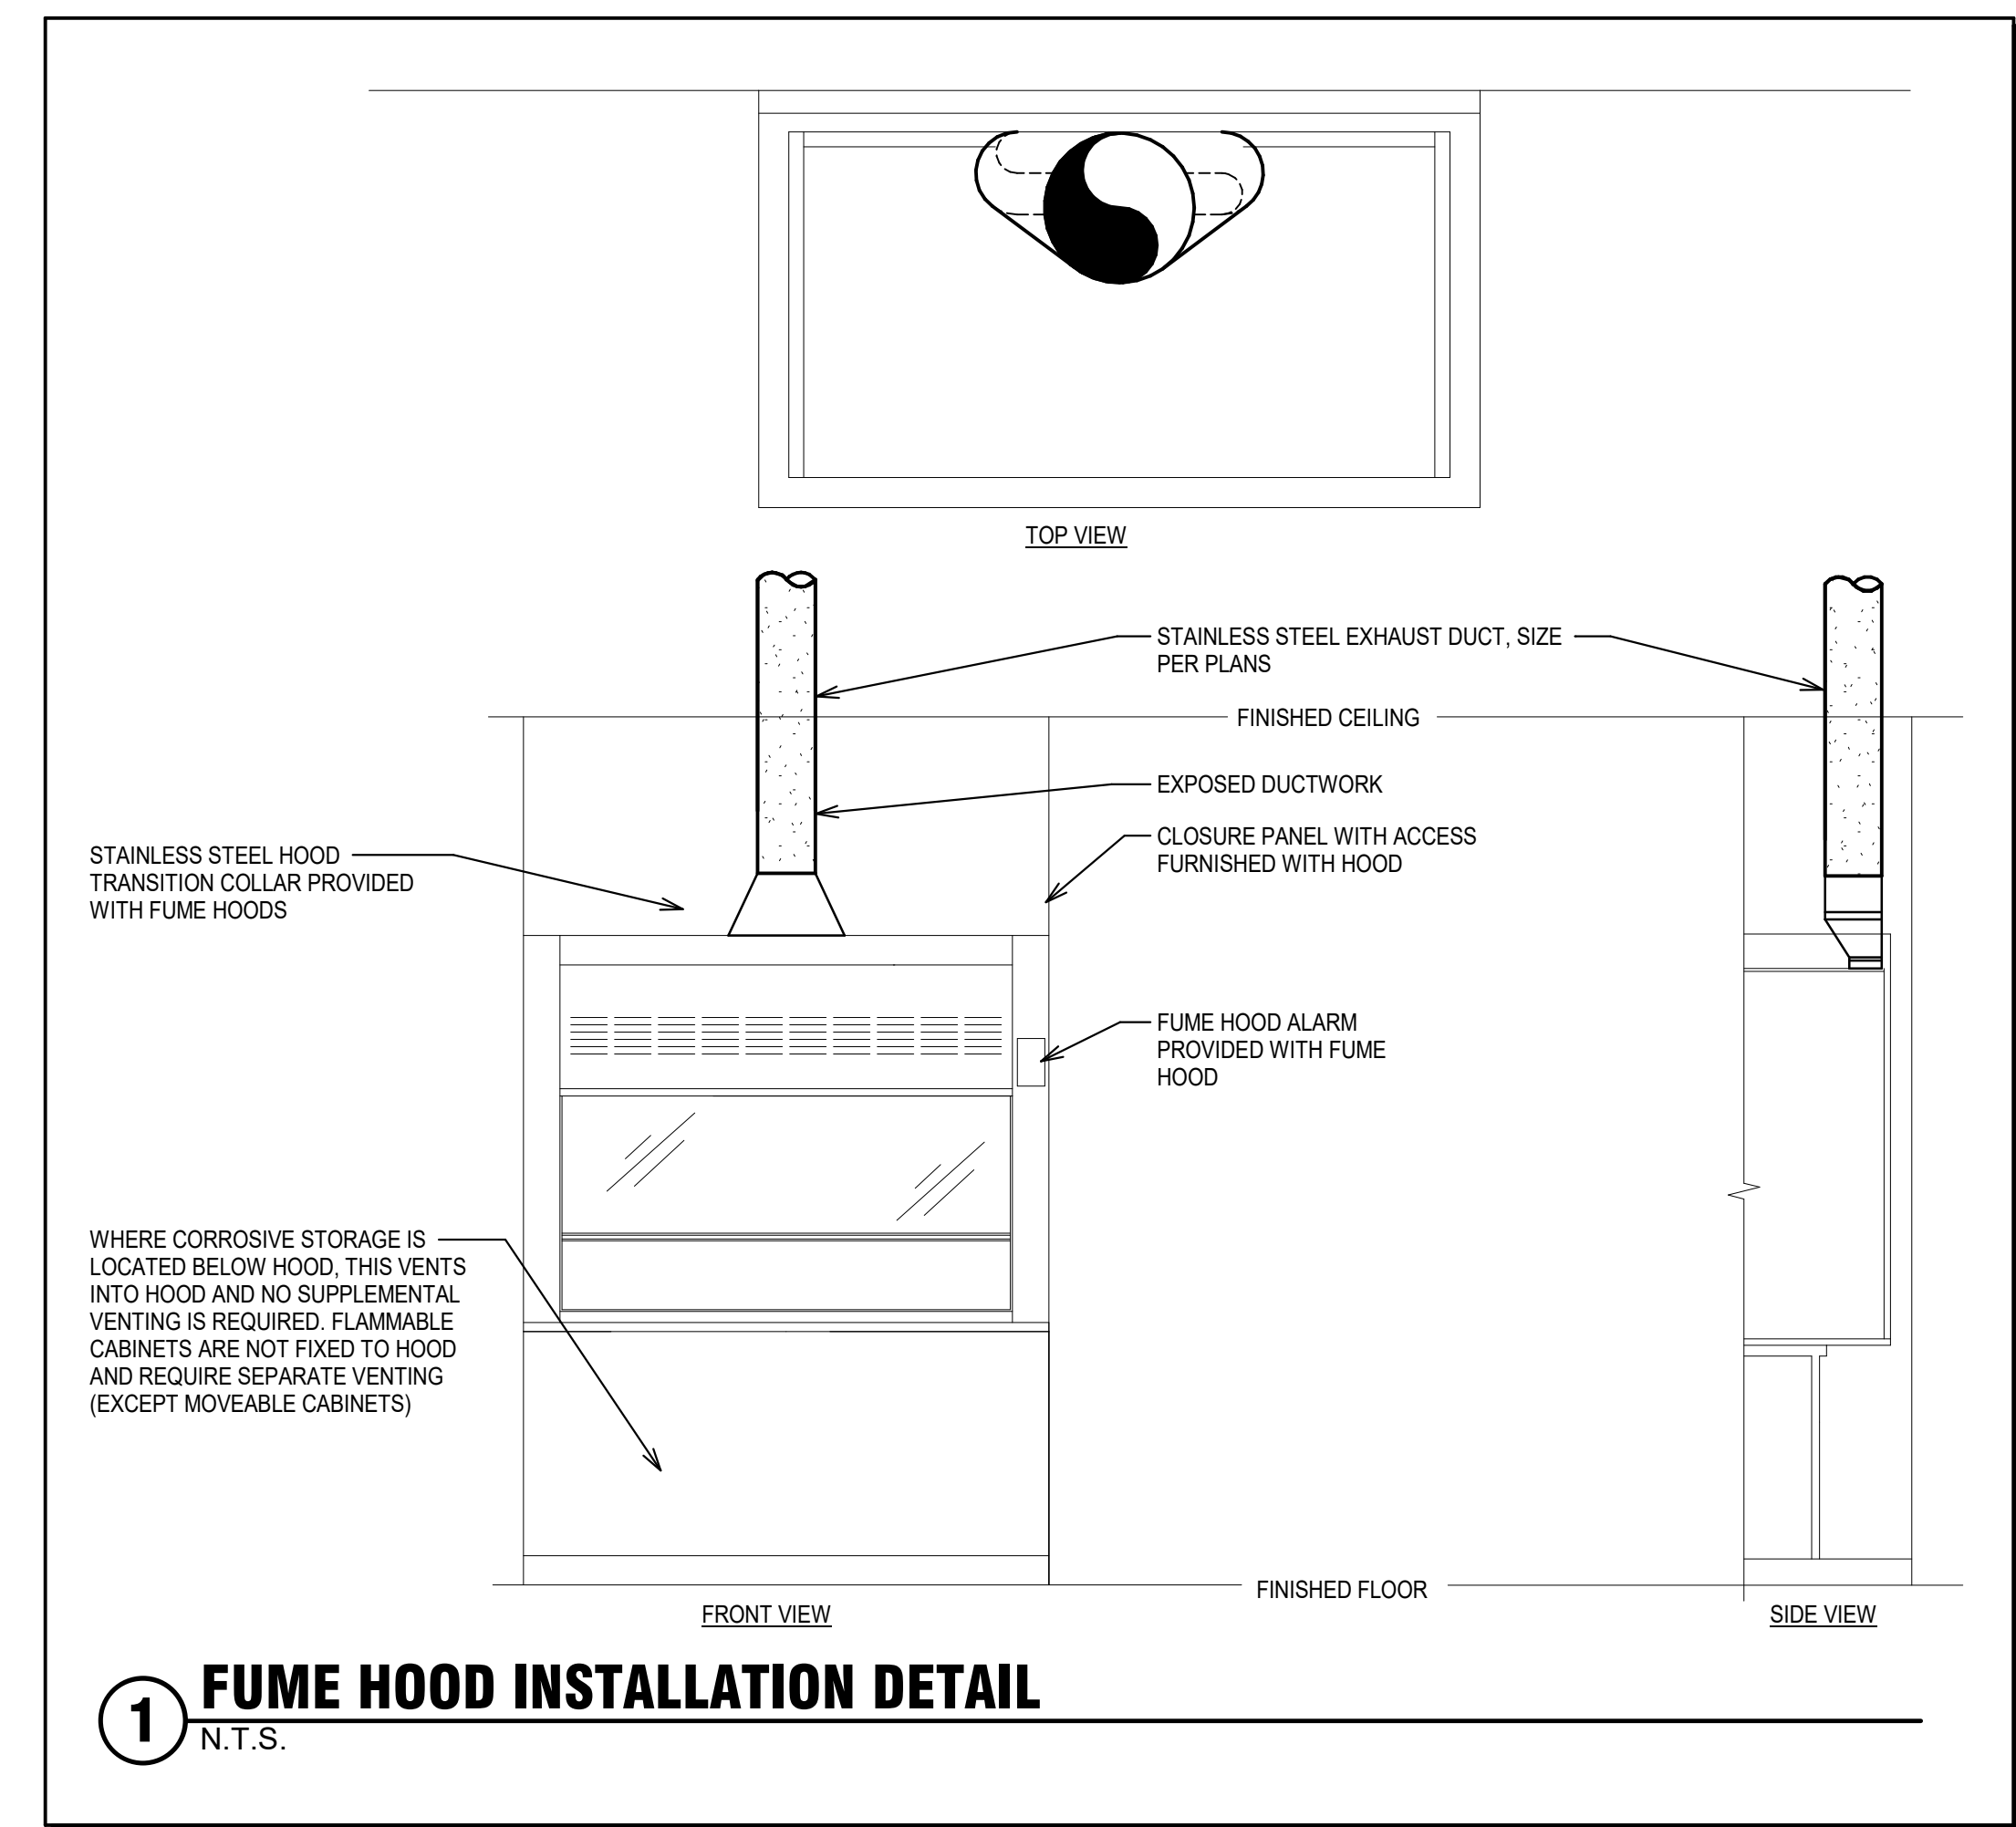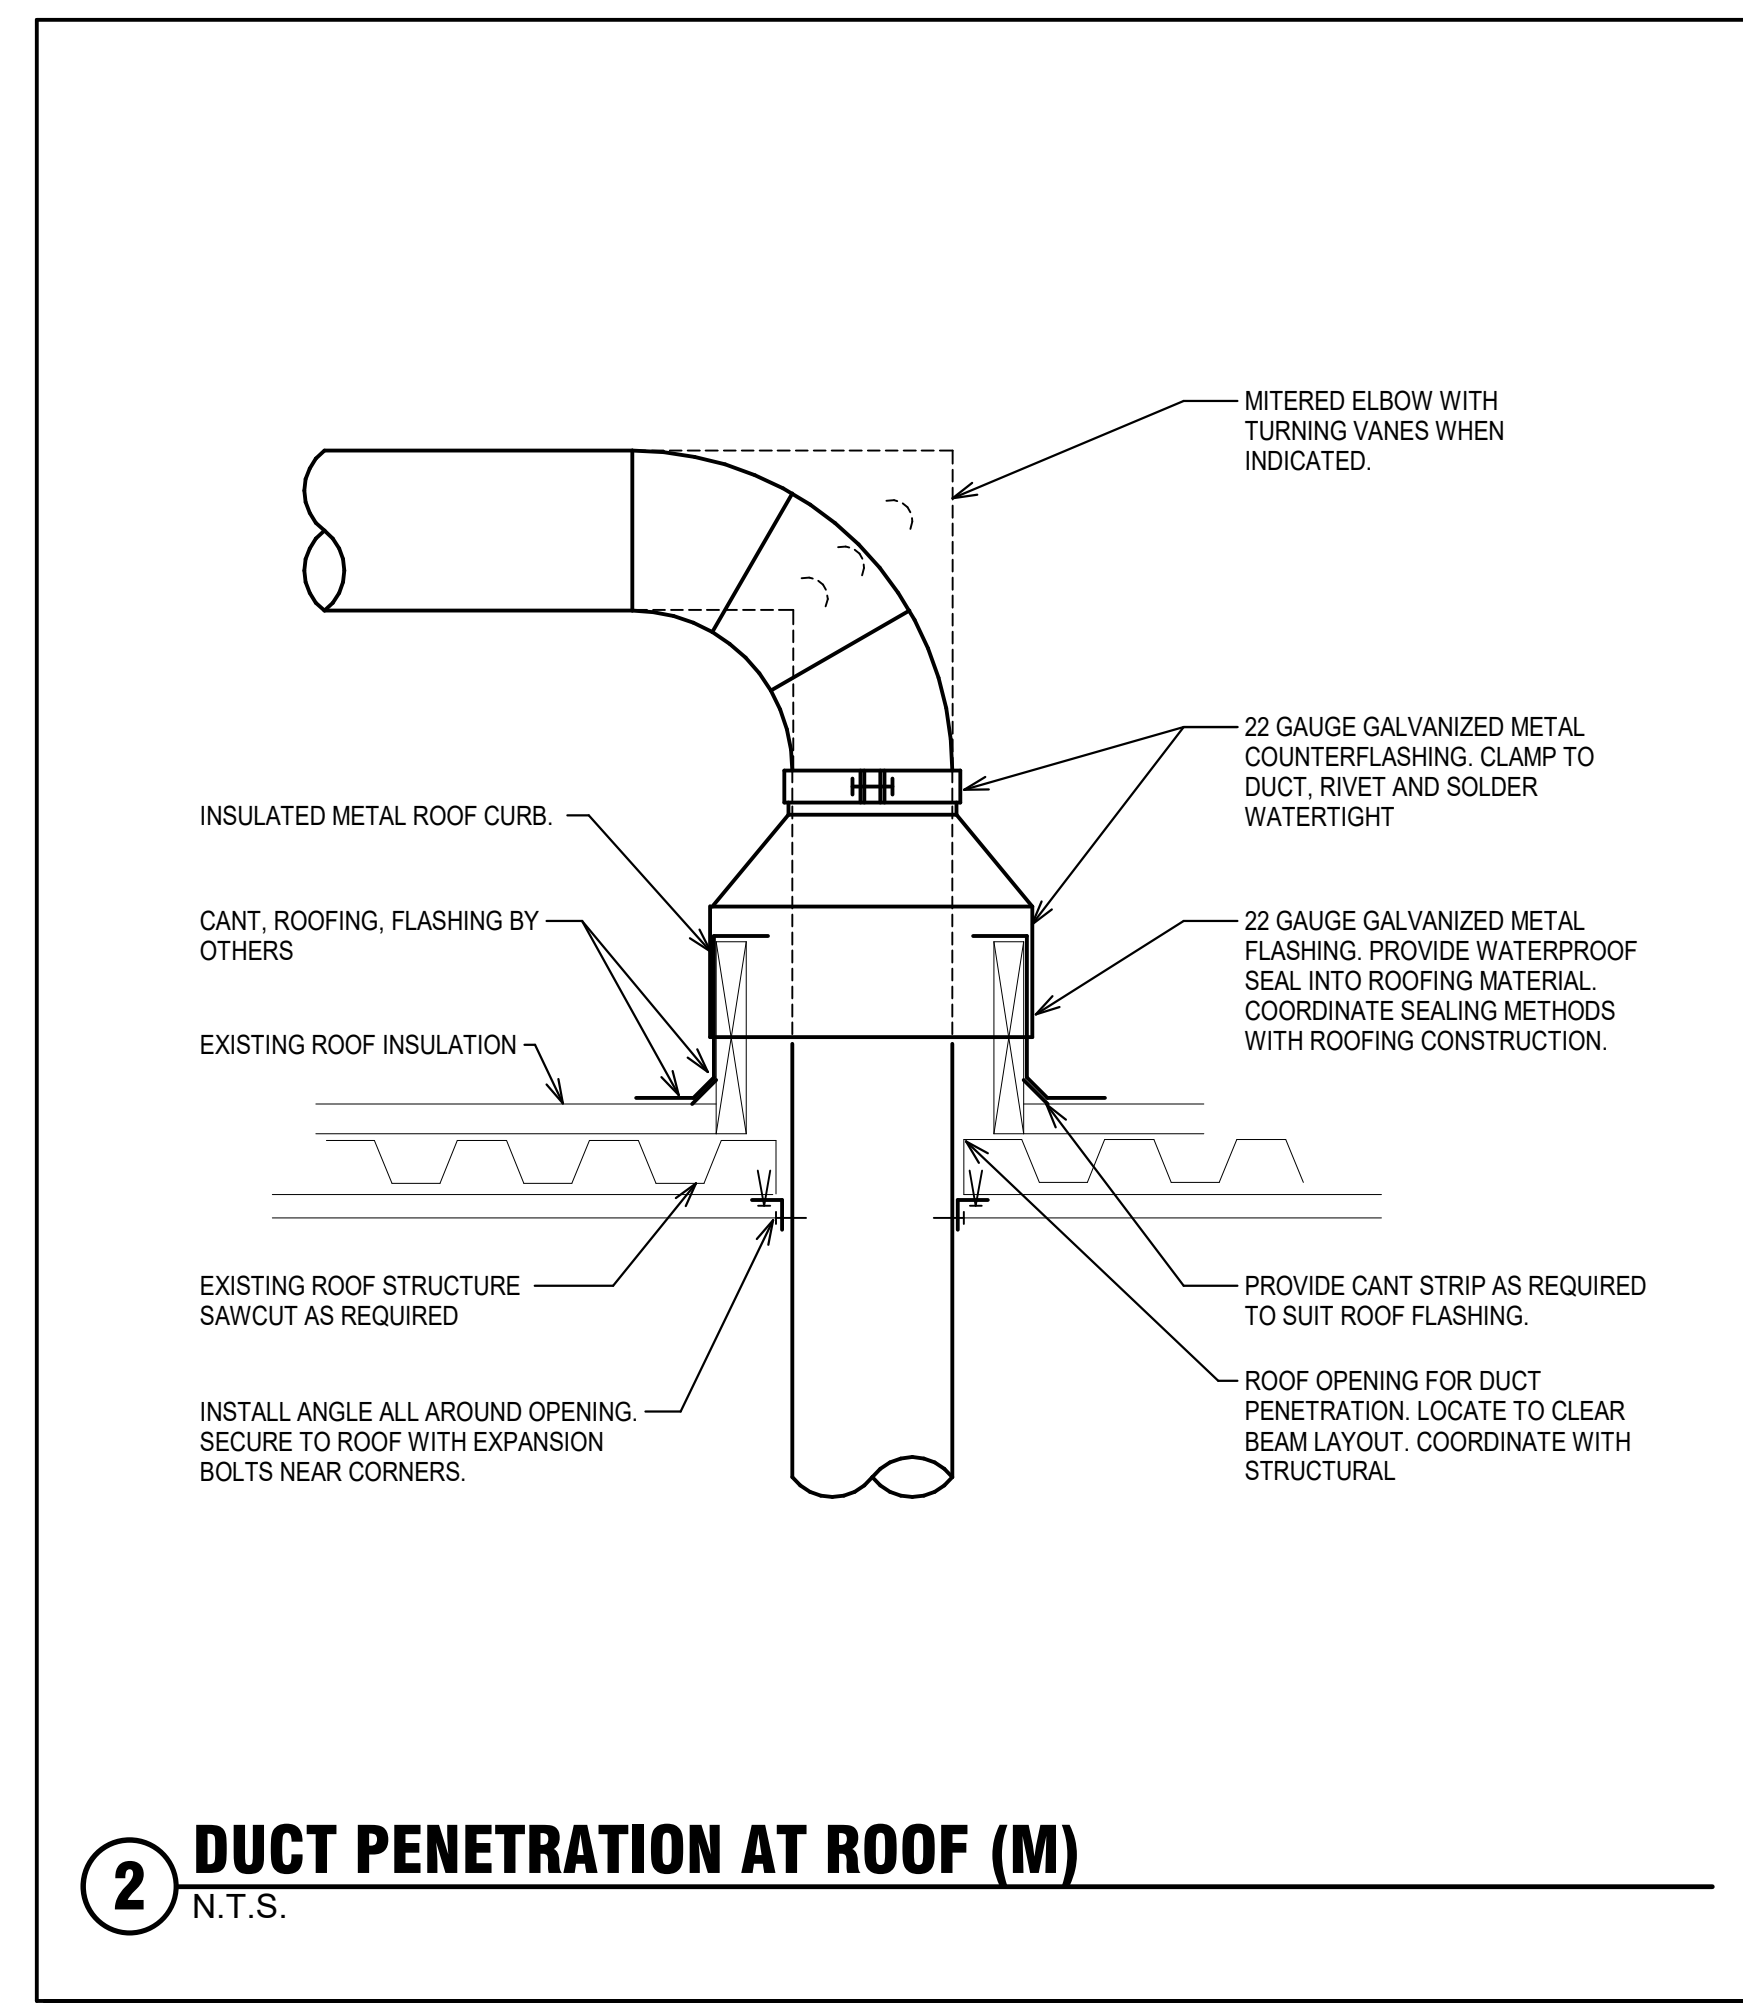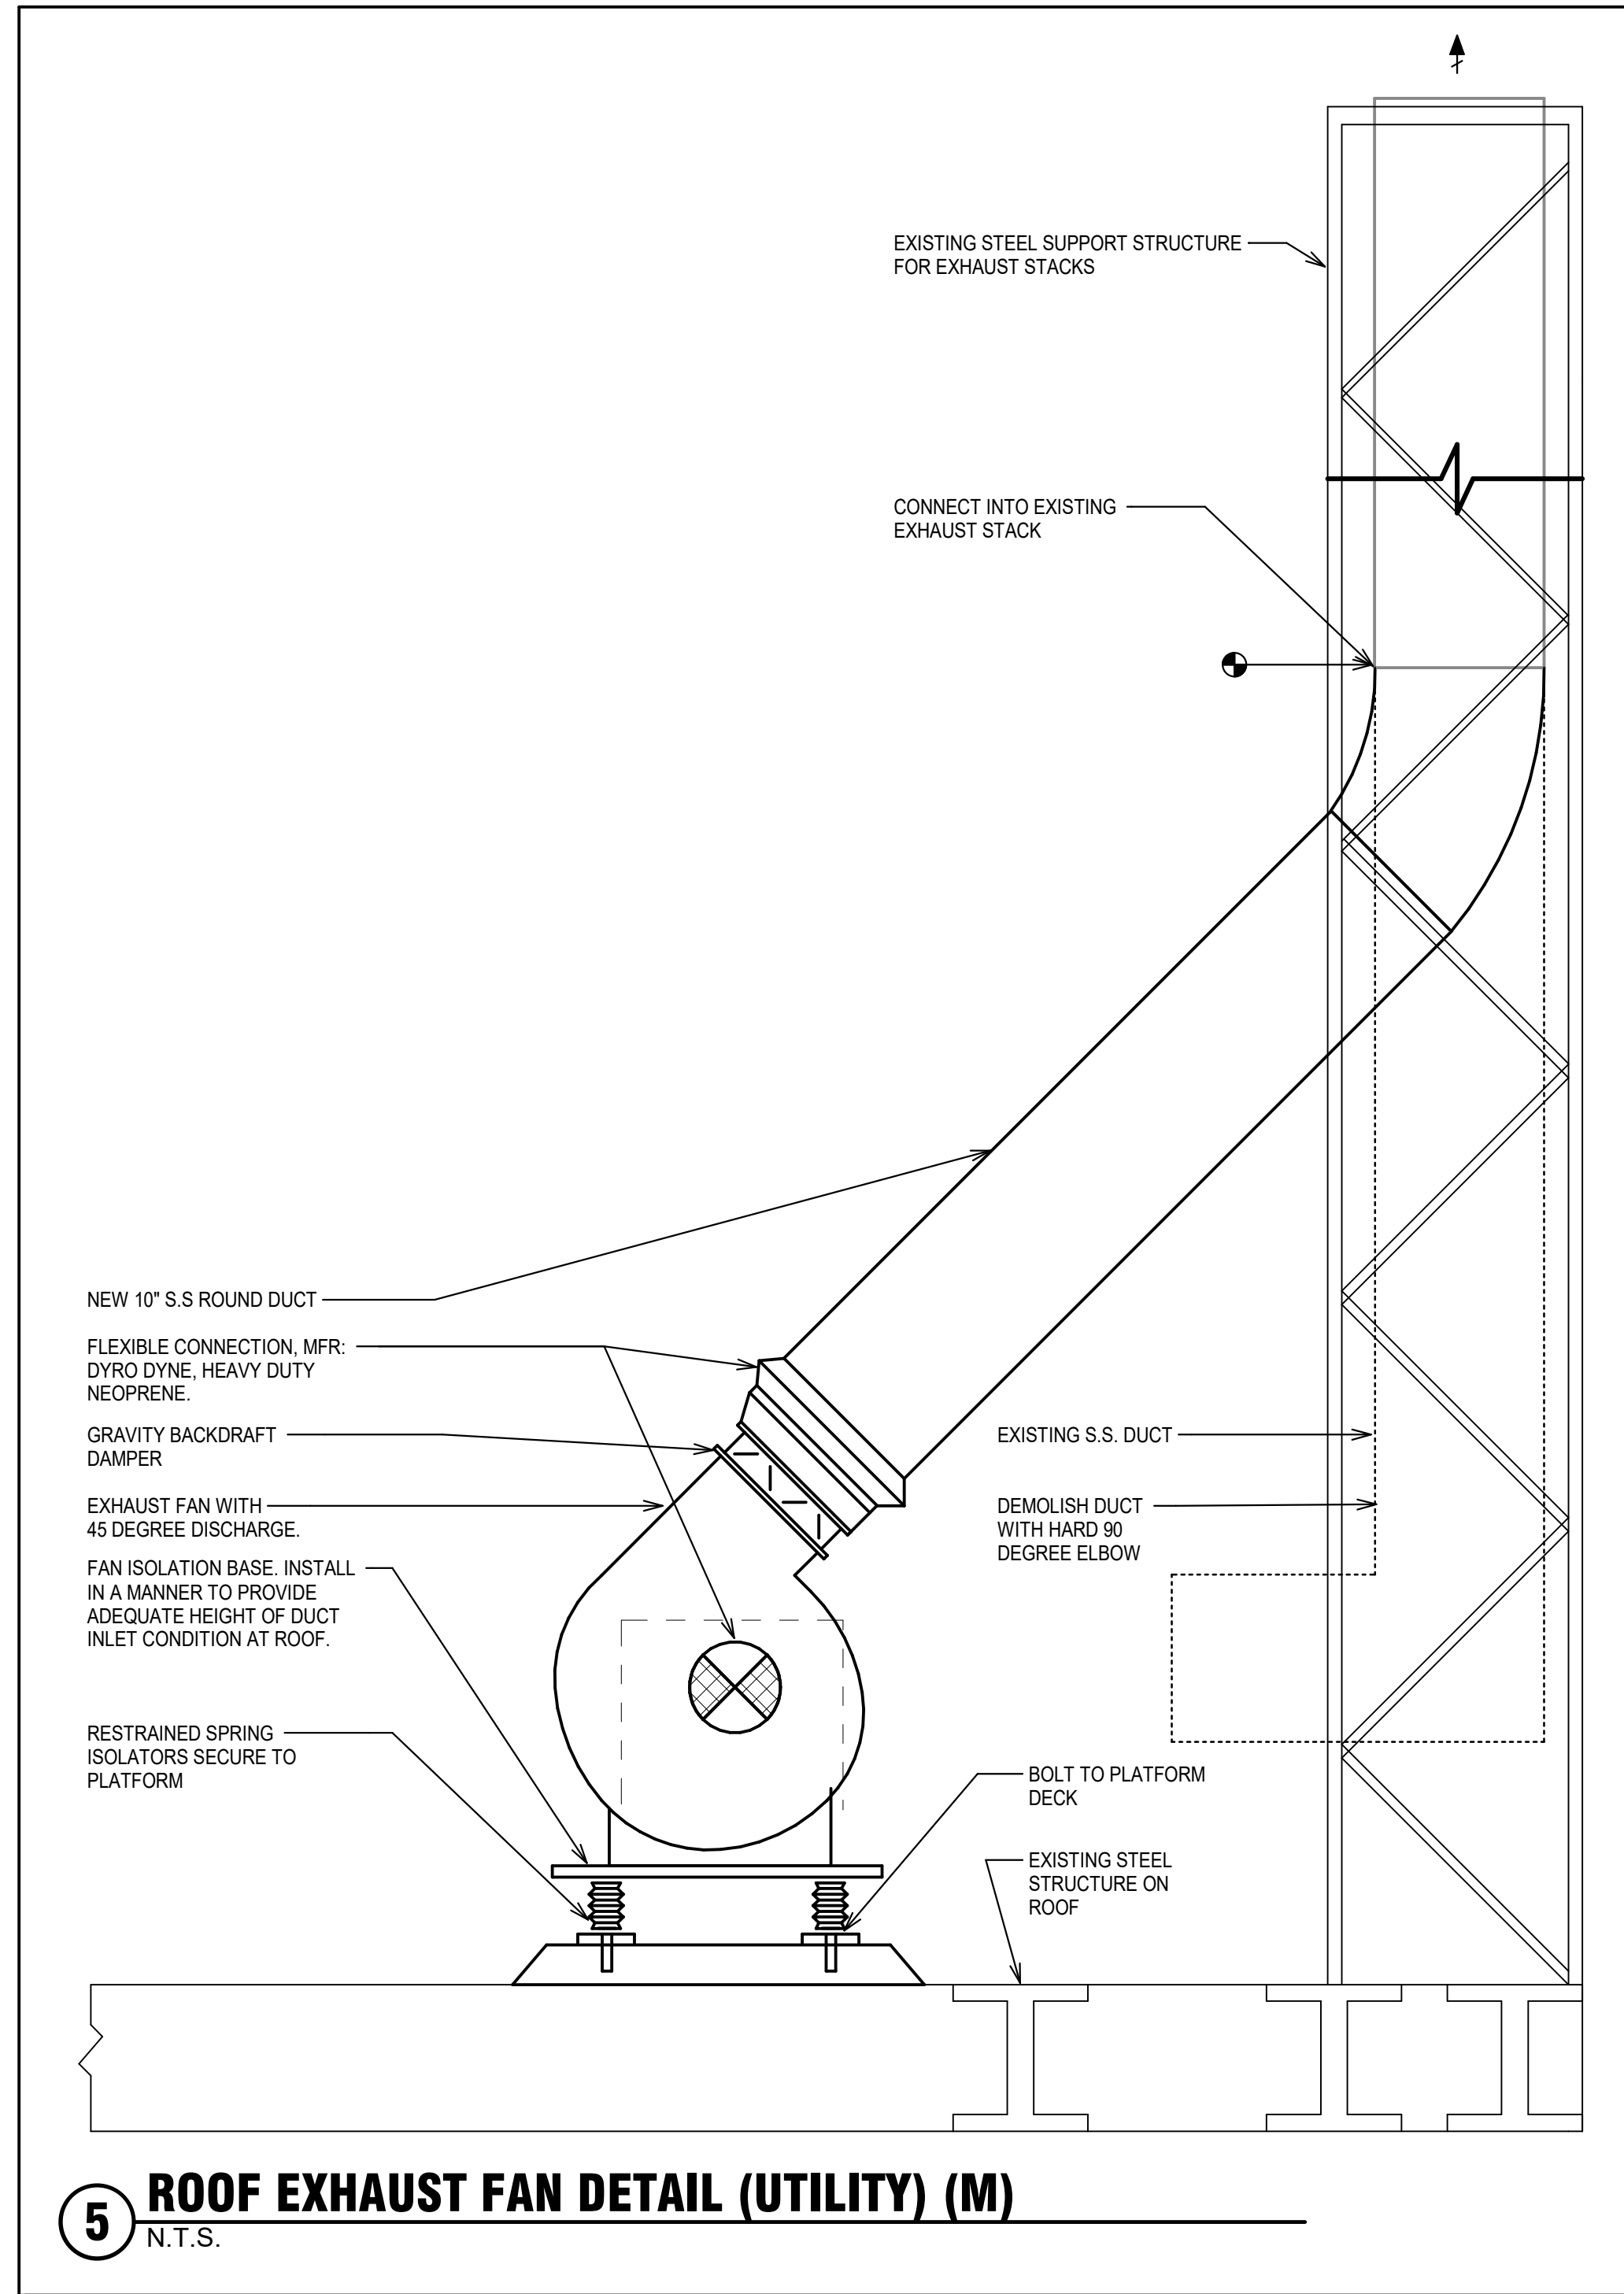

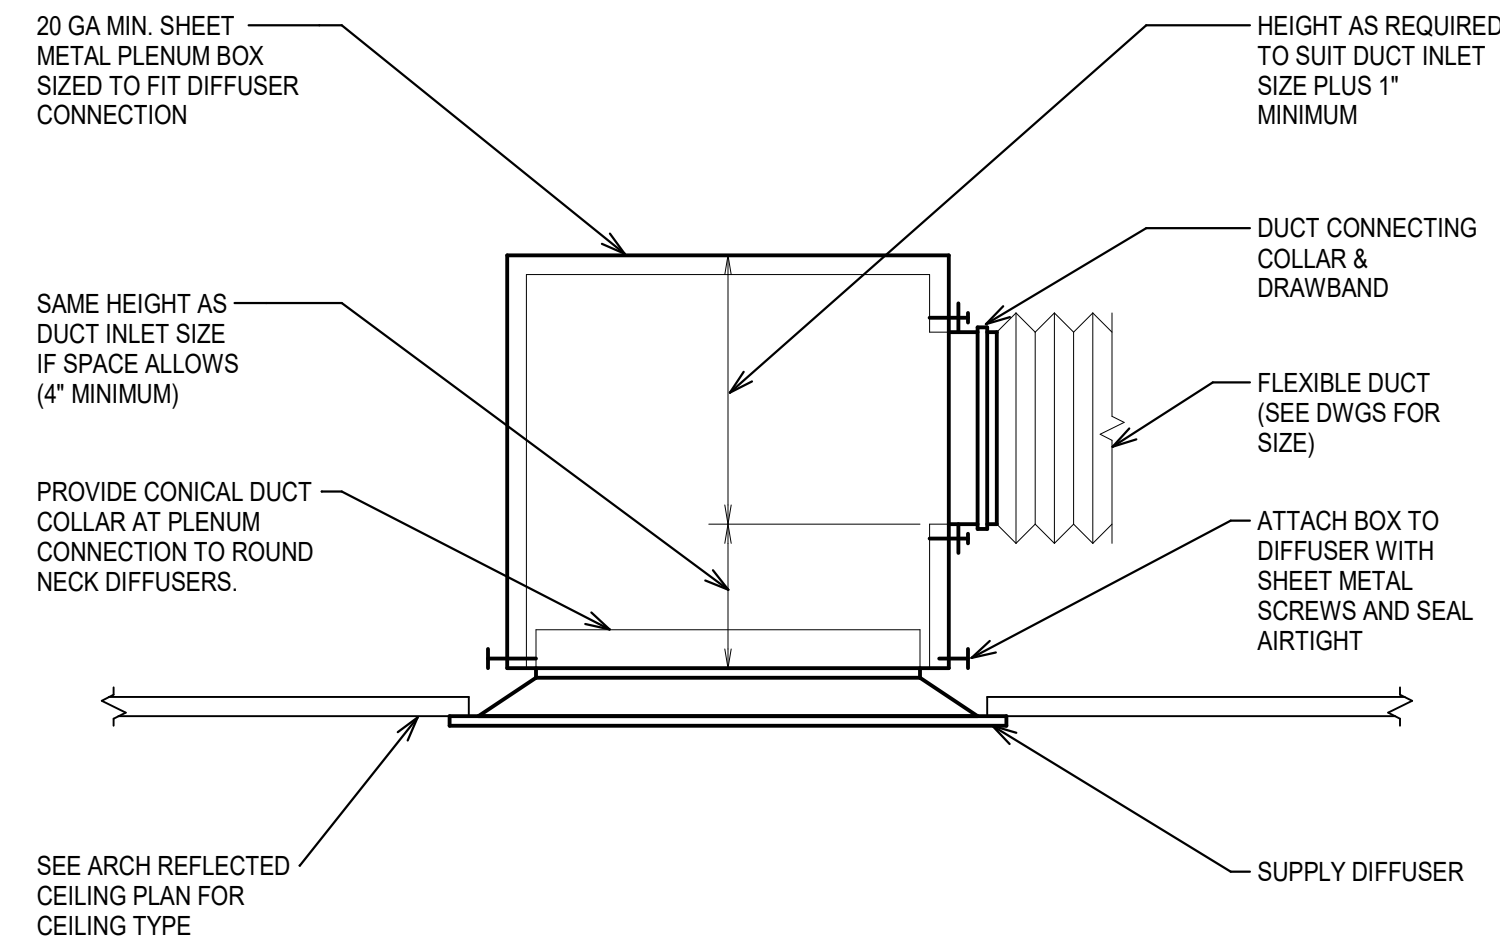


NOTES:


1. ONLY APPLICABLE WHEN SPACE CONDITIONS DO NOT ALLOW LONG RADIUS ELBOW AND STRAIGHT 12" AT DIFFUSER. SEE 'SUPPLY DIFFUSER CONNECTION DETAIL' FOR REQUIRED SUPPLY DIFFUSER INSTALLATION.

3 SUPPLY DIFFUSER BOX DETAIL (M)
N.T.S.

- NOTES:**
1. PRE-CHARGED, QUICK CONNECT HOSE KIT AVAILABLE FROM MANUFACTURER. CONTRACTOR OPTION TO USE.

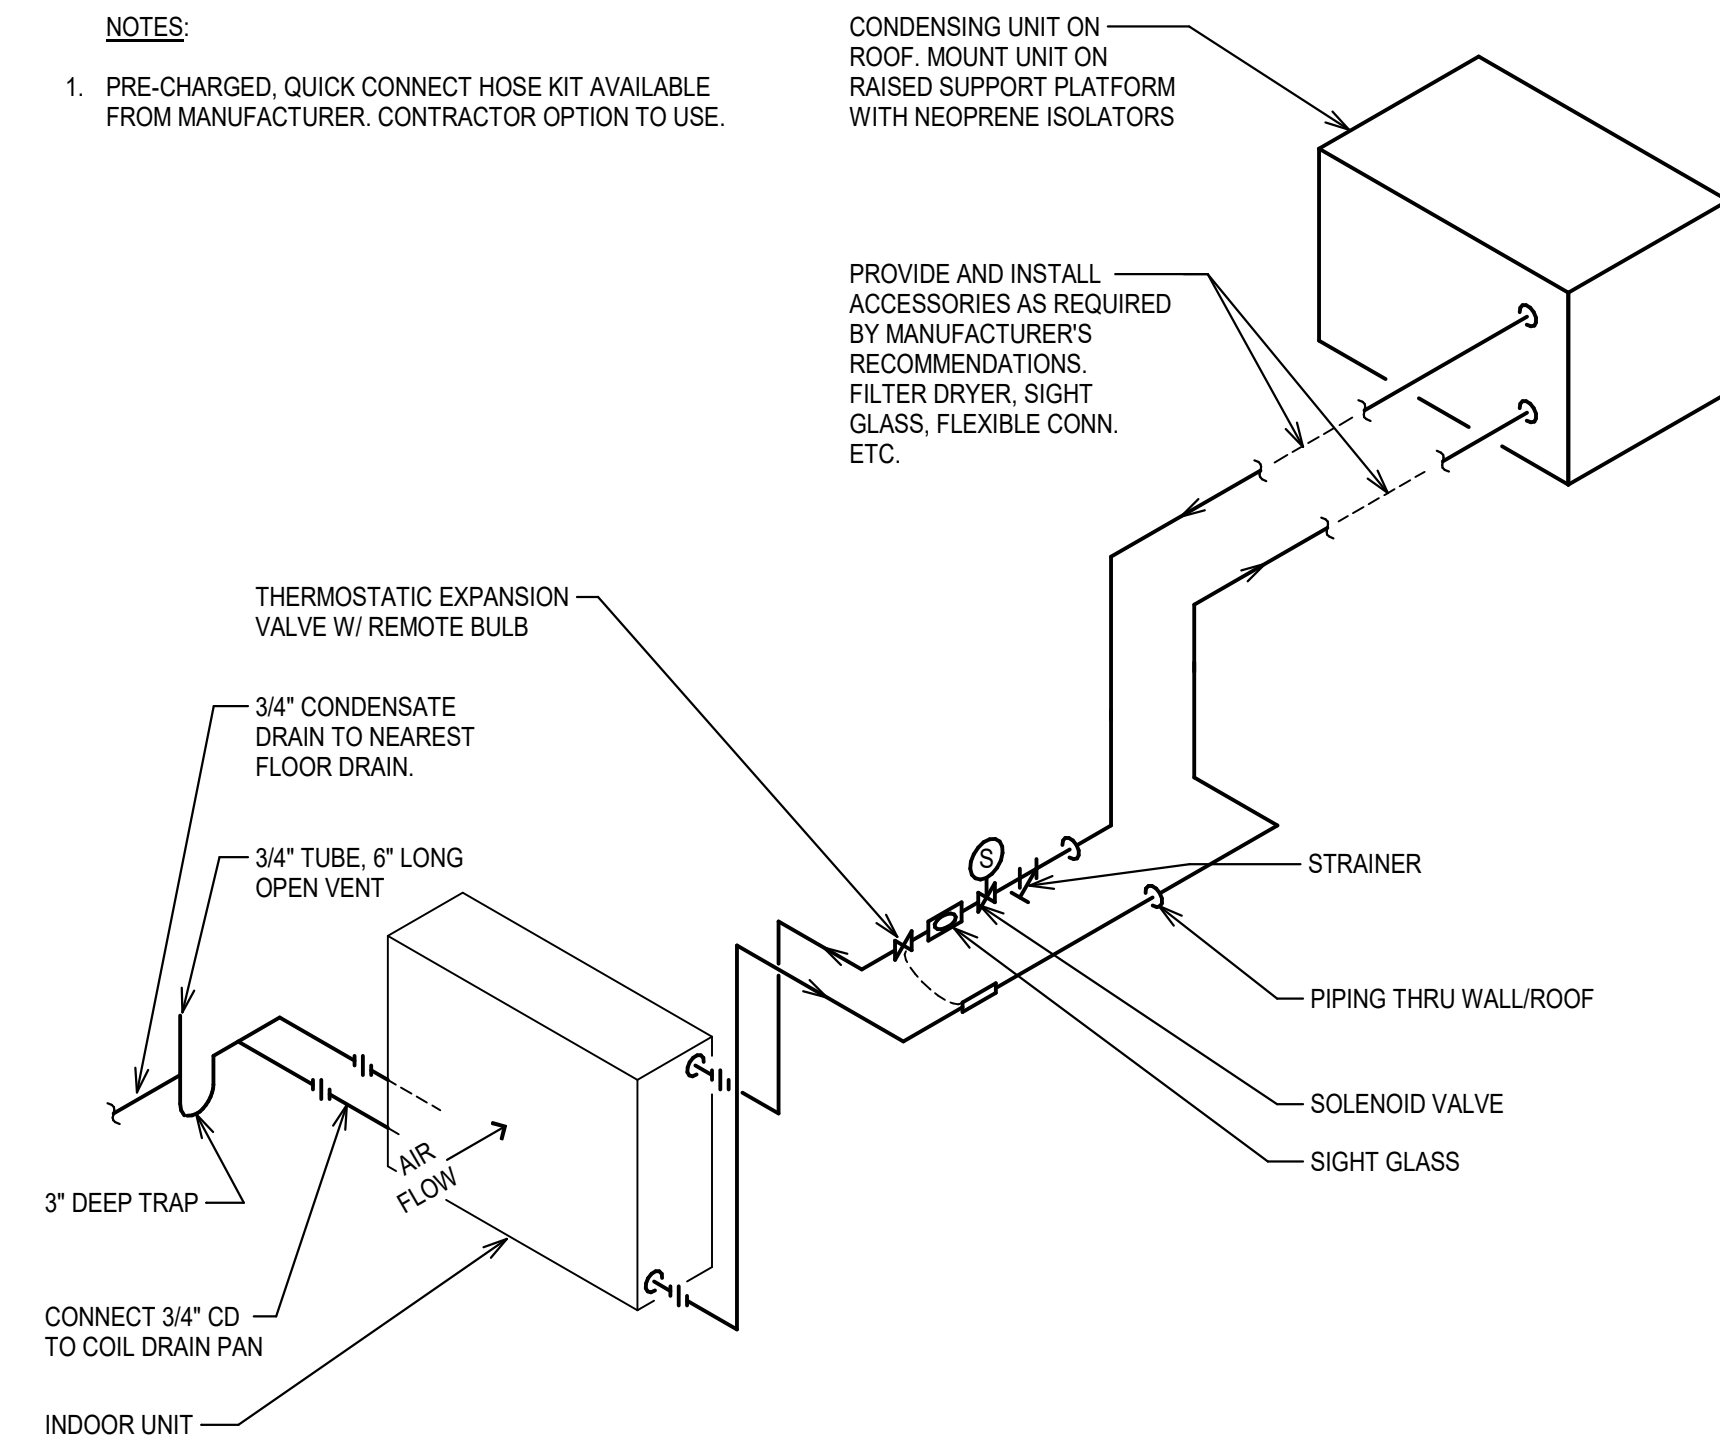


2 SPLIT SYSTEM REFRIGERANT PIPING DETAIL (M)
N.T.S.

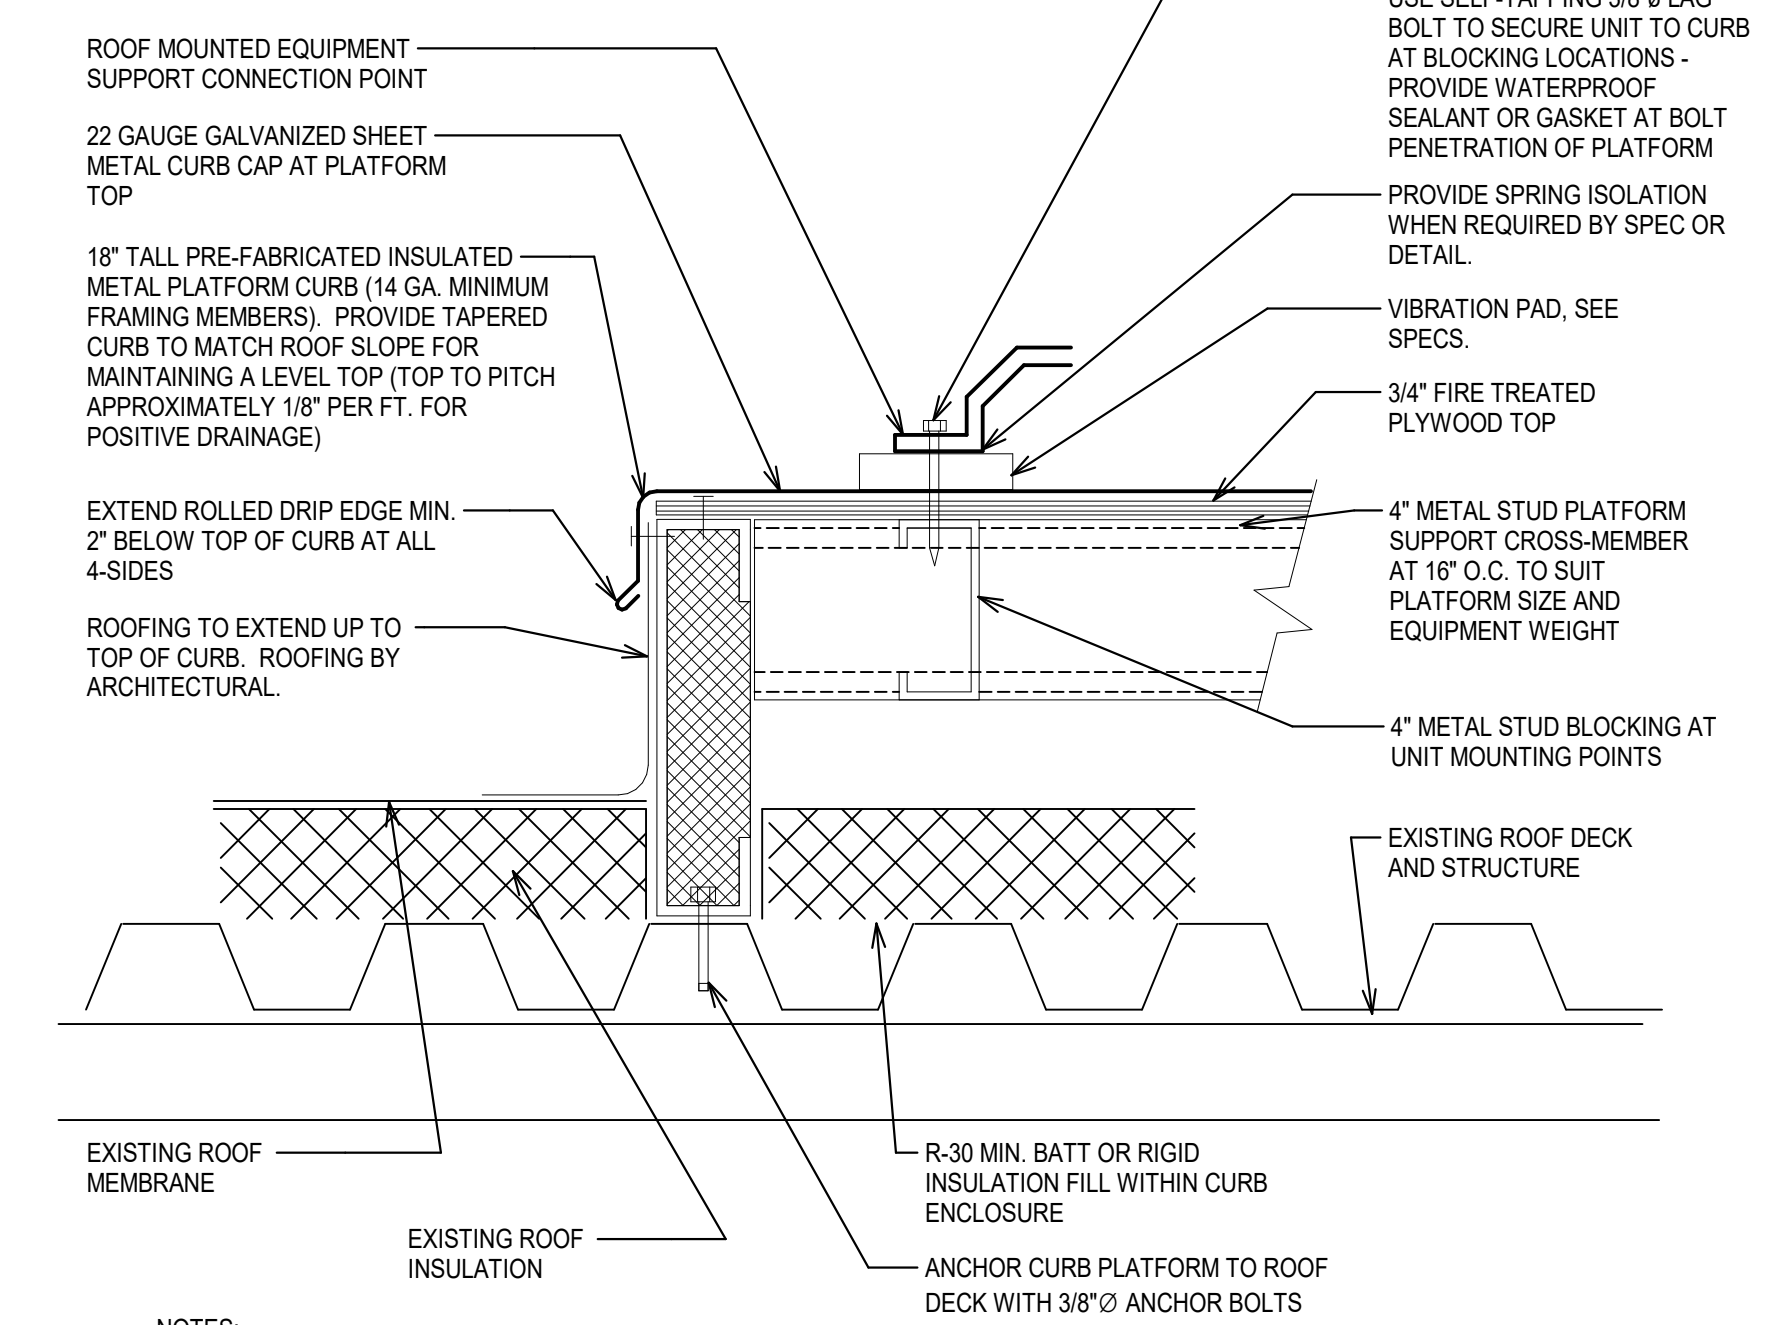

NOTES:

1. SIZE OF CURB TO EXTEND 6" BEYOND EQUIPMENT DIMENSIONS IN ALL DIRECTIONS AND A MINIMUM OF 8" ABOVE FINISHED ROOF.
2. SOLDER WATER-TIGHT ALL SHEET METAL SEAMS AND CORNER JOINTS OF CURB CAP.


1 ROOFTOP PLATFORM DETAIL
N.T.S.

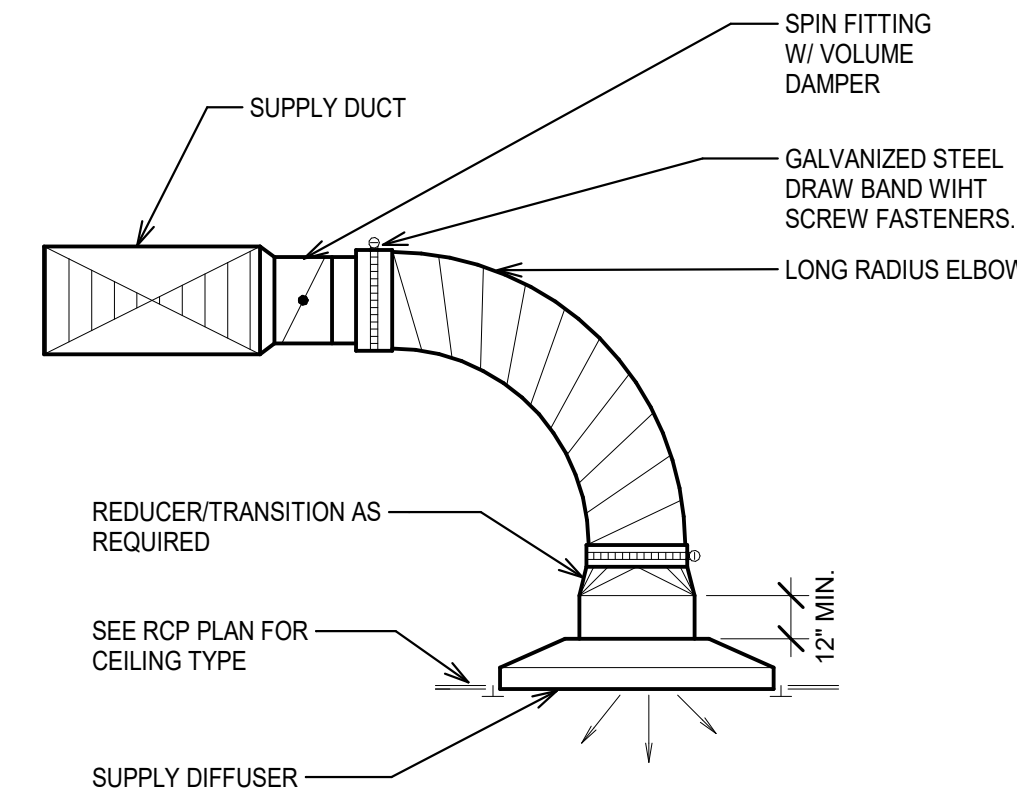

NOTES:


1. WHERE SPACE CONDITIONS DO NOT ALLOW LONG RADIUS ELBOW AND STRAIGHT 12" AT DIFFUSER, SEE 'SUPPLY DIFFUSER BOX (LINED) DETAIL'.

5 SUPPLY DIFFUSER CONNECTION DETAIL (M)
N.T.S.

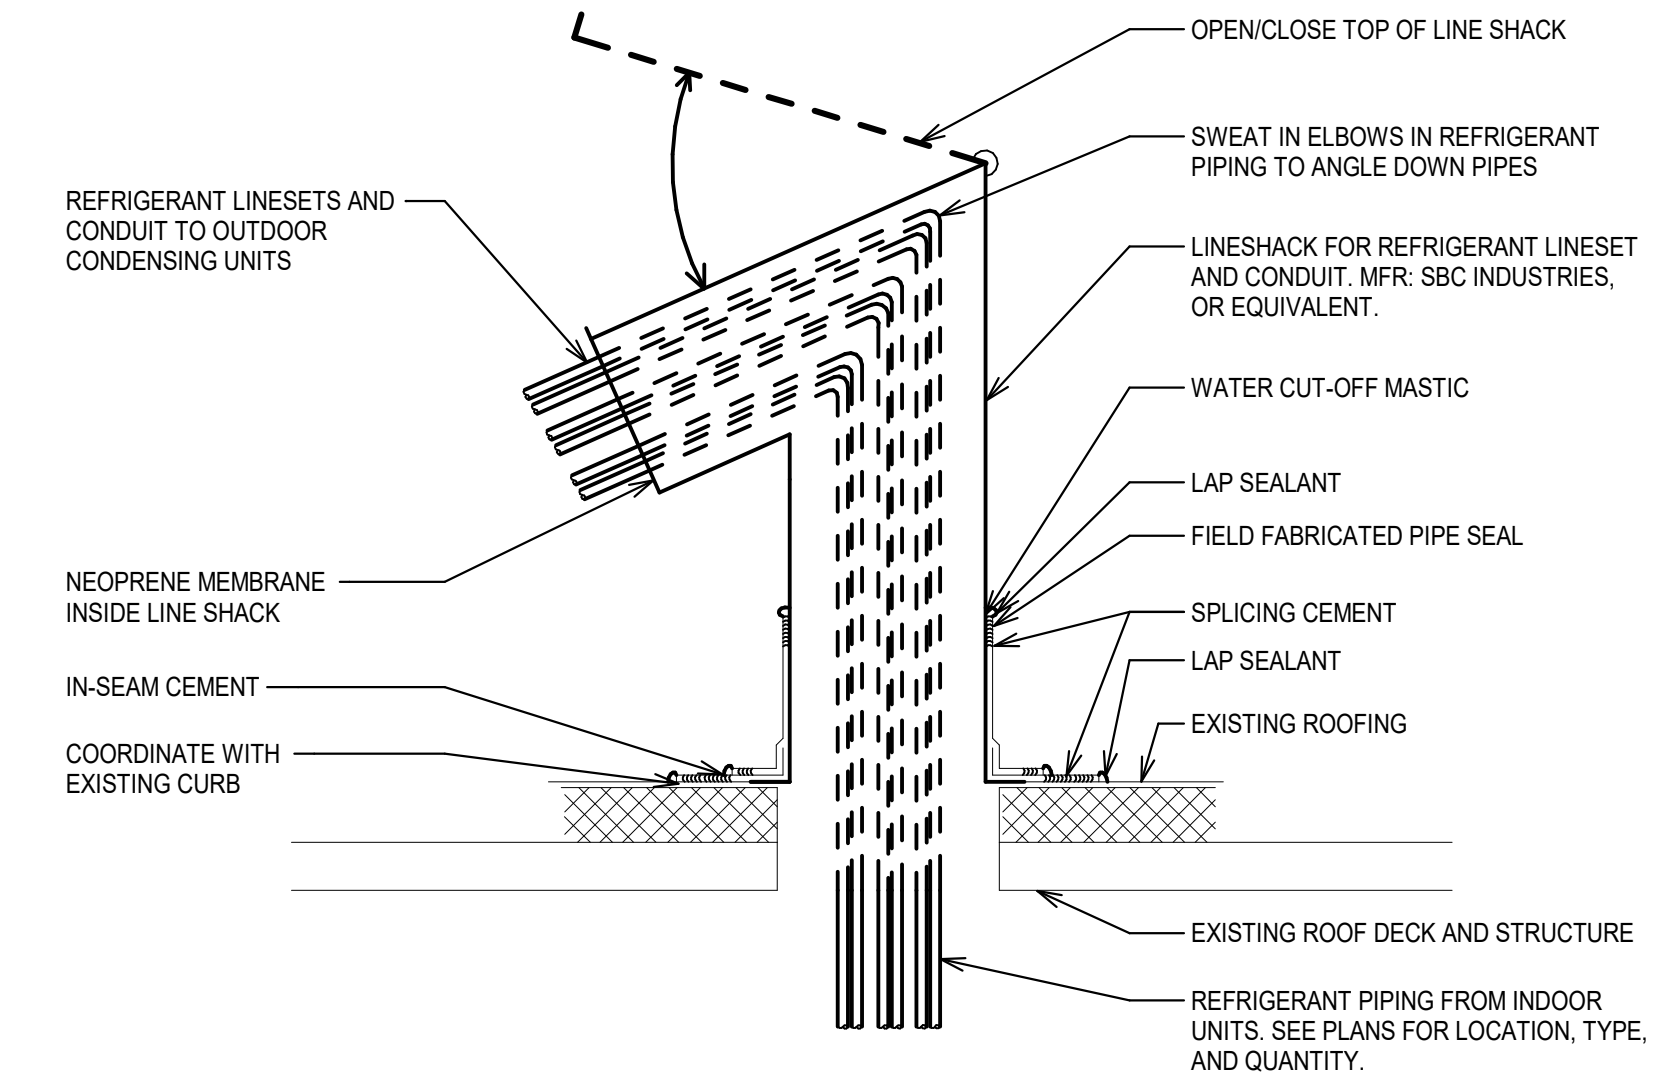


4 LINE SHACK DETAIL
N.T.S.

CLOUDED WORK IS ALTERNATE #1

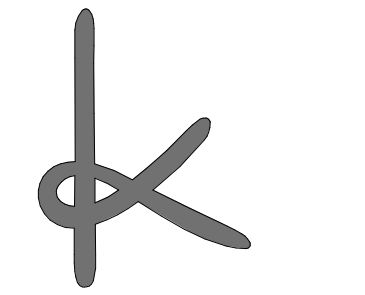


KNIT

knitstudios.com
THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSE OF CONTRACTING LINES AND MAINTAINING THE PROJECT HEREIN AS THE ARCHITECT OF RECORD FOR THE PROJECT RETAINS OWNERSHIP OF THESE DOCUMENTS.
 ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.
 REPRODUCTION OF THIS DOCUMENT IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.

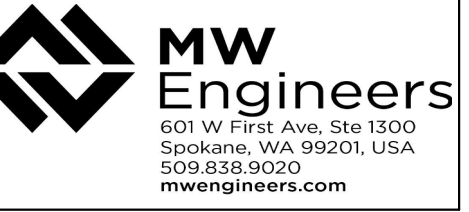

ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT
A	1/31/2025	Owner Revisions

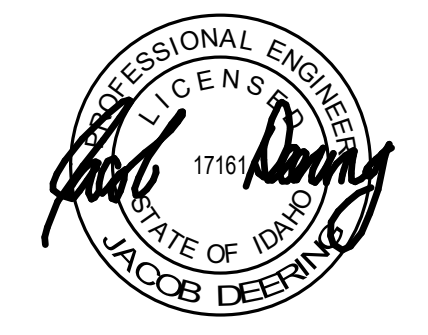

DETAILS - MECHANICAL
FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE., MOSCOW, ID 83844
UNIVERSITY OF IDAHO

TITLE	PROJECT	CLIENT

JOB NO: **240004**
 CAPITAL PROJECT NO: **CP220034**

M5-02

PACKAGED ROOFTOP AIR HANDLING UNITS WITH ELEC HEAT

Table with columns for TAG, MFR, SERIES, SUPPLY FAN, HEAT PUMP COOLING COIL, CONDENSER FANS, COMPRESSOR, HEAT PUMP AND ELECTRIC HEATING, ELECTRICAL, OPERATING WEIGHT (LBS), and NOTES.

SOUND ATTENUATOR

Table with columns for TAG, MFR, MODEL, SERVICE, STYLE, MATERIAL, ATTENUATOR DIMENSIONS, FLOW, VELOCITY, SILENCER APD, DYNAMIC INSERTION LOSS, SELF GENERATED NOISE, and NOTES.

AIR INLETS & OUTLETS

Table with columns for TAG, MFR, MODEL, SERVICE, TYPE, MATERIAL, MOUNTING, PATTERN, BLADE, and NOTES.

EXHAUST FANS

Table with columns for TAG, MFR, MODEL, TYPE, SERVICE, DRIVE, MAX CFM, ESP ("), FAN RPM, SONE LEVEL, MOTOR, and NOTES.

CONDENSING UNIT SCHEDULE

Table with columns for TAG, MFR, MODEL, INDOOR UNIT, COOLING CAPACITY, HEATING CAPACITY, AMBIENT HEATING, REFRIGERANT, MCA, MOCP, RLA, V, PH, SEER2/EER2, OPERATING WEIGHT (LBS), and NOTES.

FAN COIL UNIT SCHEDULE

Table with columns for TAG, MFR, MODEL, ASSOCIATED HP, SUPPLY FAN, COOLING CAPACITY, HEATING CAPACITY, ELECTRICAL, and NOTES.

CHEMICAL FUME HOODS

Table with columns for TAG #, MFR, MODEL, HOOD SIZE AND TYPE, TYPE OF SASH, TYPE OF SILL, NUMBER OF VERTICAL SASHES, NOMINAL SASH HEIGHT, DESIGN OPERATING CONDITIONS, SASH OPENING, FACE VELOCITY, AIRFLOW, MIN AIR FLOW, MAX HOOD STATIC PRESSURE DROP, EXH CONN. SIZE, ELECTRICAL CONNECTION, and NOTES.

DUCTLESS SPLIT SYSTEM IS ALTERNATE #1

THE FUME HOOD IS ALTERNATE #2. FUME HOOD INSTALLATION IS BASE BID.



ISSUE DATE 12.20.2024

Table with columns for REV, DATE, COMMENT.



SCHEDULES - MECHANICAL
FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)
860 IDAHO AVE., MOSCOW, ID 83844
UNIVERSITY OF IDAHO

Table with columns for TITLE, PROJECT, CLIENT.



JOB NO: 240004
CAPITAL PROJECT NO: CP220034

M6-01

Energy Management & Control System Points Identification					
Name/Function	AI	AO	DI	DO	Remarks
1 Space Temp	✓				
2 Heat Sensor	✓				
3 Disable Fan Coil Cooling				✓	

SEQUENCE OF OPERATION:

INDOOR FAN COIL AND CONDENSING UNIT SHALL CYCLE UPON DEMAND FOR COOLING FROM UNIT PROVIDED SPACE SENSOR. WHEN THE RADIATOR SENSOR SENSES HEAT (ABOVE 110 DEGREES) ADJ. THE FAN COIL COOLING SHALL BE LOCKED OUT.

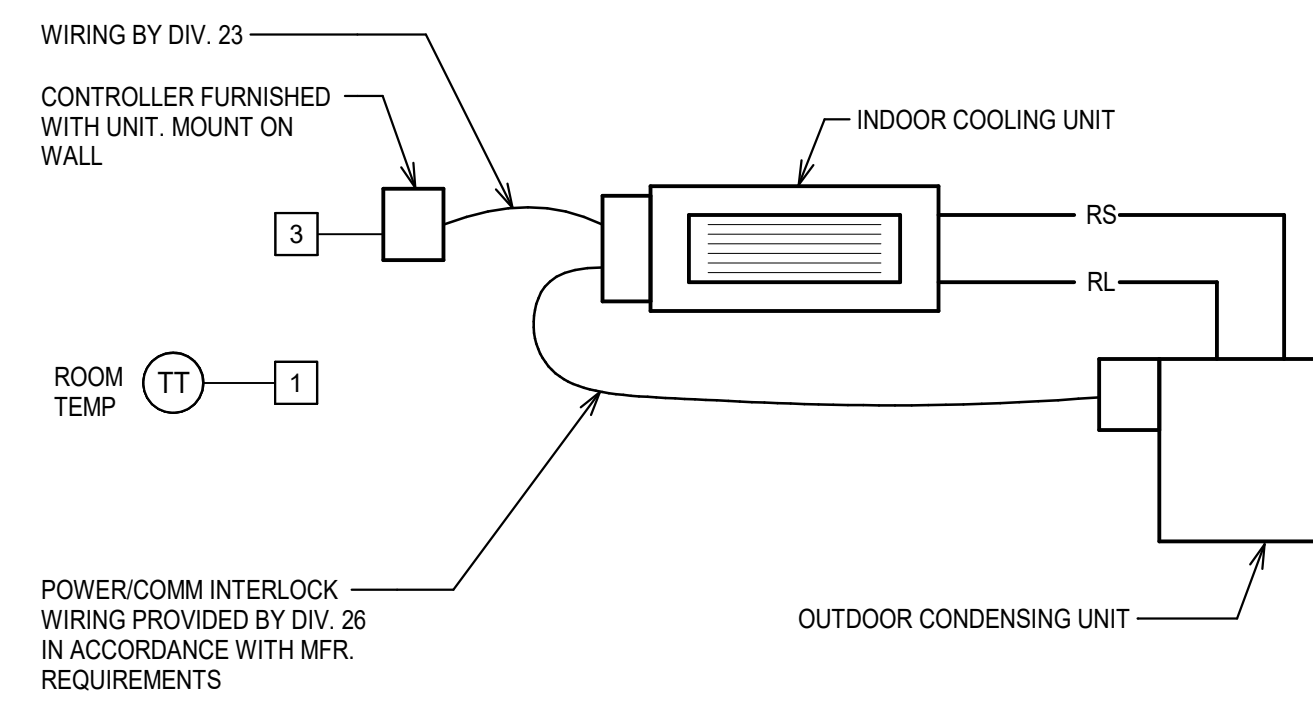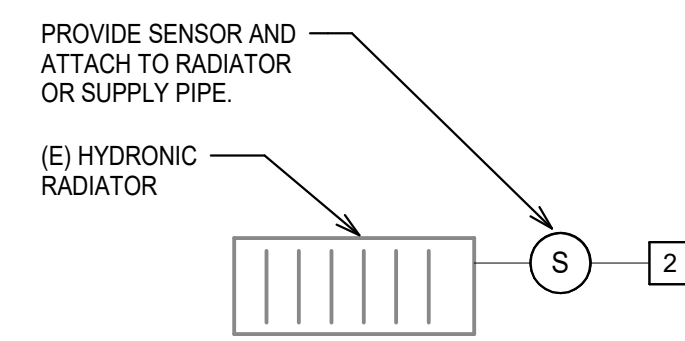

3 DUCTLESS SPLIT SYSTEM CONTROL DIAGRA
N.T.S.

Energy Management & Control System Points Identification					
Name/Function	AI	AO	DI	DO	Remarks
1 Space Temp	✓				
2 OSA Temp	✓				
3 Discharge Temp	✓				
4 Heat Pump Status/Alarm			✓		
5 Heat Pump Enable/Disable				✓	
6 Heat/Cool Enable/Disable				✓	
7 Heat/Cool Enable/Disable	✓				

SEQUENCE OF OPERATION:

FAILURE OF FUME HOOD EXHAUST FAN EF-1 SHALL DISABLE THE RTU.

OCCUPIED MODE:

THE SUPPLY FAN SHALL BE ON AND SHALL OPERATE CONTINUOUSLY.


WITH NO DEMAND FOR COOLING (SPACE TEMPERATURE SATISFIED) AND A CALL FOR HEATING, THE HEAT PUMP SHALL OPERATE AS THE FIRST STAGE OF HEATING. ADDITIONAL CALL FOR HEAT SHALL ENABLE THE ELECTRIC RESISTANCE HEATING. THE HEATING COIL SHALL MODULATE STAGES OF HEAT TO MAINTAIN THE LEAVING AIR TEMPERATURE SETPOINT. THE REVERSE SHALL OCCUR UPON A REDUCED DEMAND FOR HEATING.

A CALL FOR COOLING TO MAINTAIN THE DISCHARGE AIR TEMPERATURE SHALL ENABLE THE HEAT PUMP COOLING. COOLING SETPOINT SHALL BE RESET BETWEEN 59 AND 60 (ADJ.). THE COMPRESSOR SHALL BE ENABLED AND SHALL MODULATE TO MAINTAIN THE REQUIRED DISCHARGE AIR TEMPERATURE. THE REFRIGERATION CONTROLS SHALL BE SENSITIVE TO RAPID CYCLING OF COMPRESSORS AS IT AFFECTS COOLING COIL DISCHARGE AIR TEMPERATURE STABILITY. WHEN THE RADIATOR SENSOR SENSES HEAT (ABOVE 110 DEGREES) ADJ. THE RTU COOLING SHALL BE LOCKED OUT.

THE CONDENSING UNIT FACTORY CONTROLS SHALL START/STOP/MODULATE THE CONDENSING UNIT FAN.

OUTSIDE AIR DAMPER SHALL BE SET TO A FIXED POSITION TO SUPPLY MAKE-UP AIR TO THE FUME HOOD EXHAUST.

UNOCCUPIED MODE:
DEMAND FOR UNOCCUPIED PERIOD HEATING/COOLING SHALL OPERATE AS DESCRIBED IN OCCUPIED MODE. UNOCCUPIED HEATING SETPOINTS SHALL BE 10 DEGREES LOWER AND COOLING SHALL BE 10 DEGREES HIGHER THEN OCCUPIED SETPOINTS. UNIT IS EXPECTED TO OPERATE 24 HOURS A DAY TO PROVIDE MAKEUP AIR TO THE FUME HOOD EXHAUST FAN.

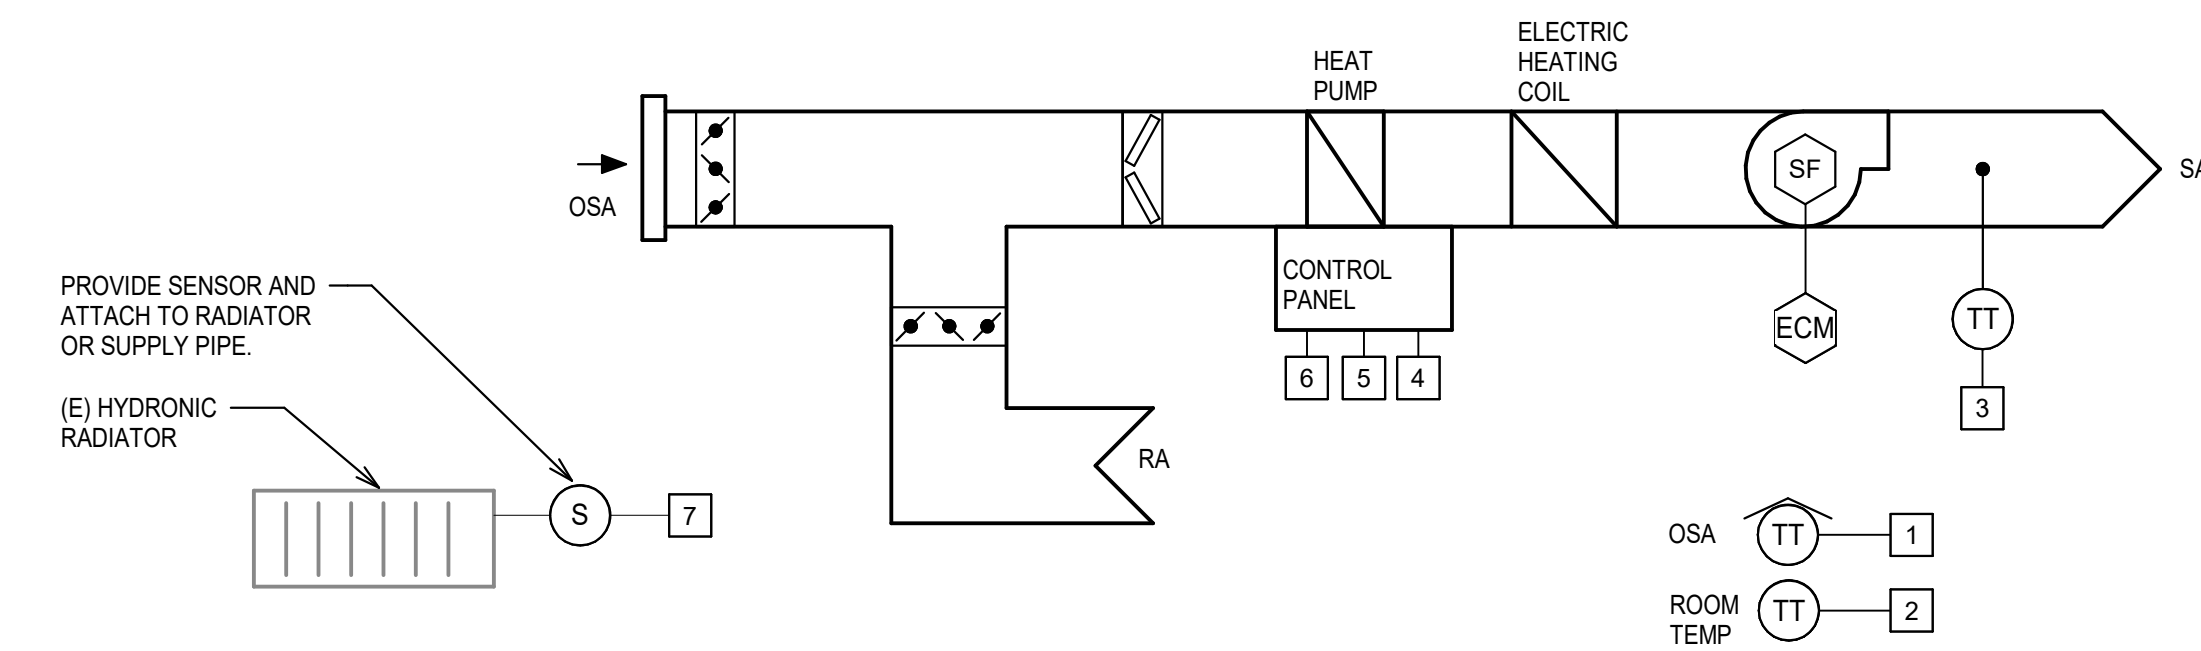

1 HEAT PUMP ROOFTOP UNIT RTU-1
N.T.S.

Energy Management & Control System Points Identification					
Name/Function	AI	AO	DI	DO	Remarks
1 Fan Start/Stop				✓	
2 Status/Alarm			✓		

SEQUENCE OF OPERATION:


FUME HOOD CONTROL: FUME HOODS ARE CONSTANT VOLUME WITH A SASH BYPASS.

FUME HOOD AND LAB ARE EXPECTED TO OPERATE IN OCCUPIED MODE 24/7.

OCCUPIED MODE: THE EXHAUST FAN SHALL MAINTAIN MAXIMUM SCHEDULED CFM.

FAILURE OF EXHAUST FAN SHALL ALARM THE BAS.

UNOCCUPIED MODE: THE EXHAUST FAN SHALL BE OFF

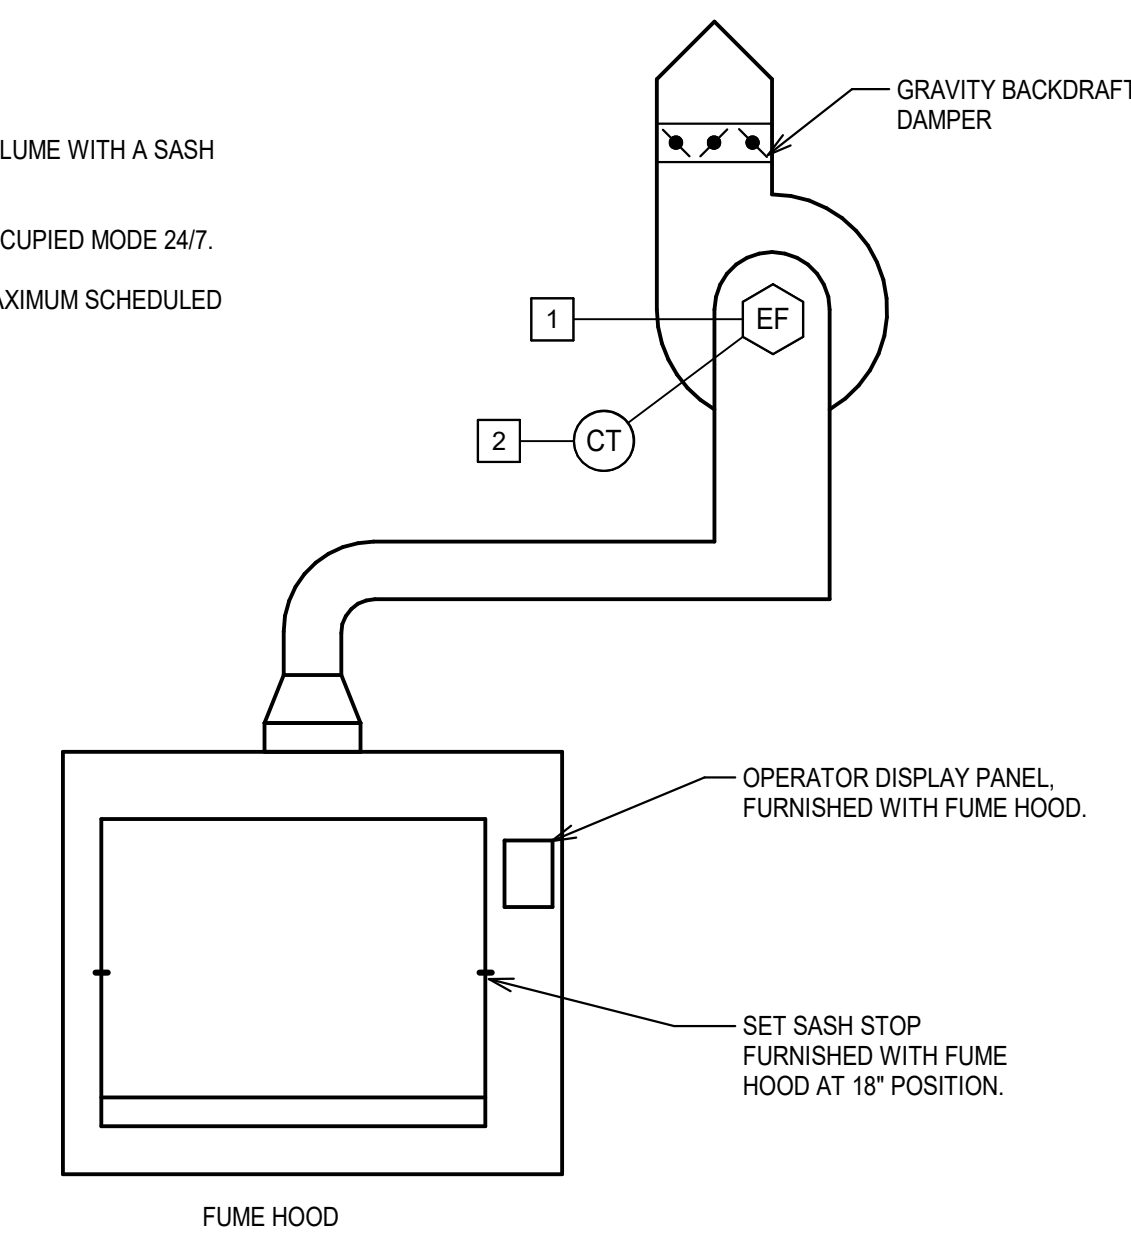

2 FUME HOOD EXHAUST FAN CONTROL DIAGRAM
N.T.S.




knitstudios.com
THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSE OF CONTRACTING UNDER AND MAINTAINING THE PROJECT. ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY OTHER PARTY IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.
REPRODUCTION OF THIS DOCUMENT IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.



ISSUE DATE: **12.20.2024**


REV	DATE	COMMENT
A	1/31/2025	Owner Revisions

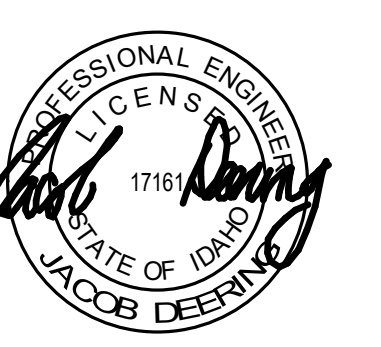

CONTROLS - MECHANICAL
FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)
860 IDAHO AVE., MOSCOW, ID 83844
UNIVERSITY OF IDAHO

TITLE	PROJECT	CLIENT

JOB NO: **240004**
CAPITAL PROJECT NO: **CP220034**
M7-01

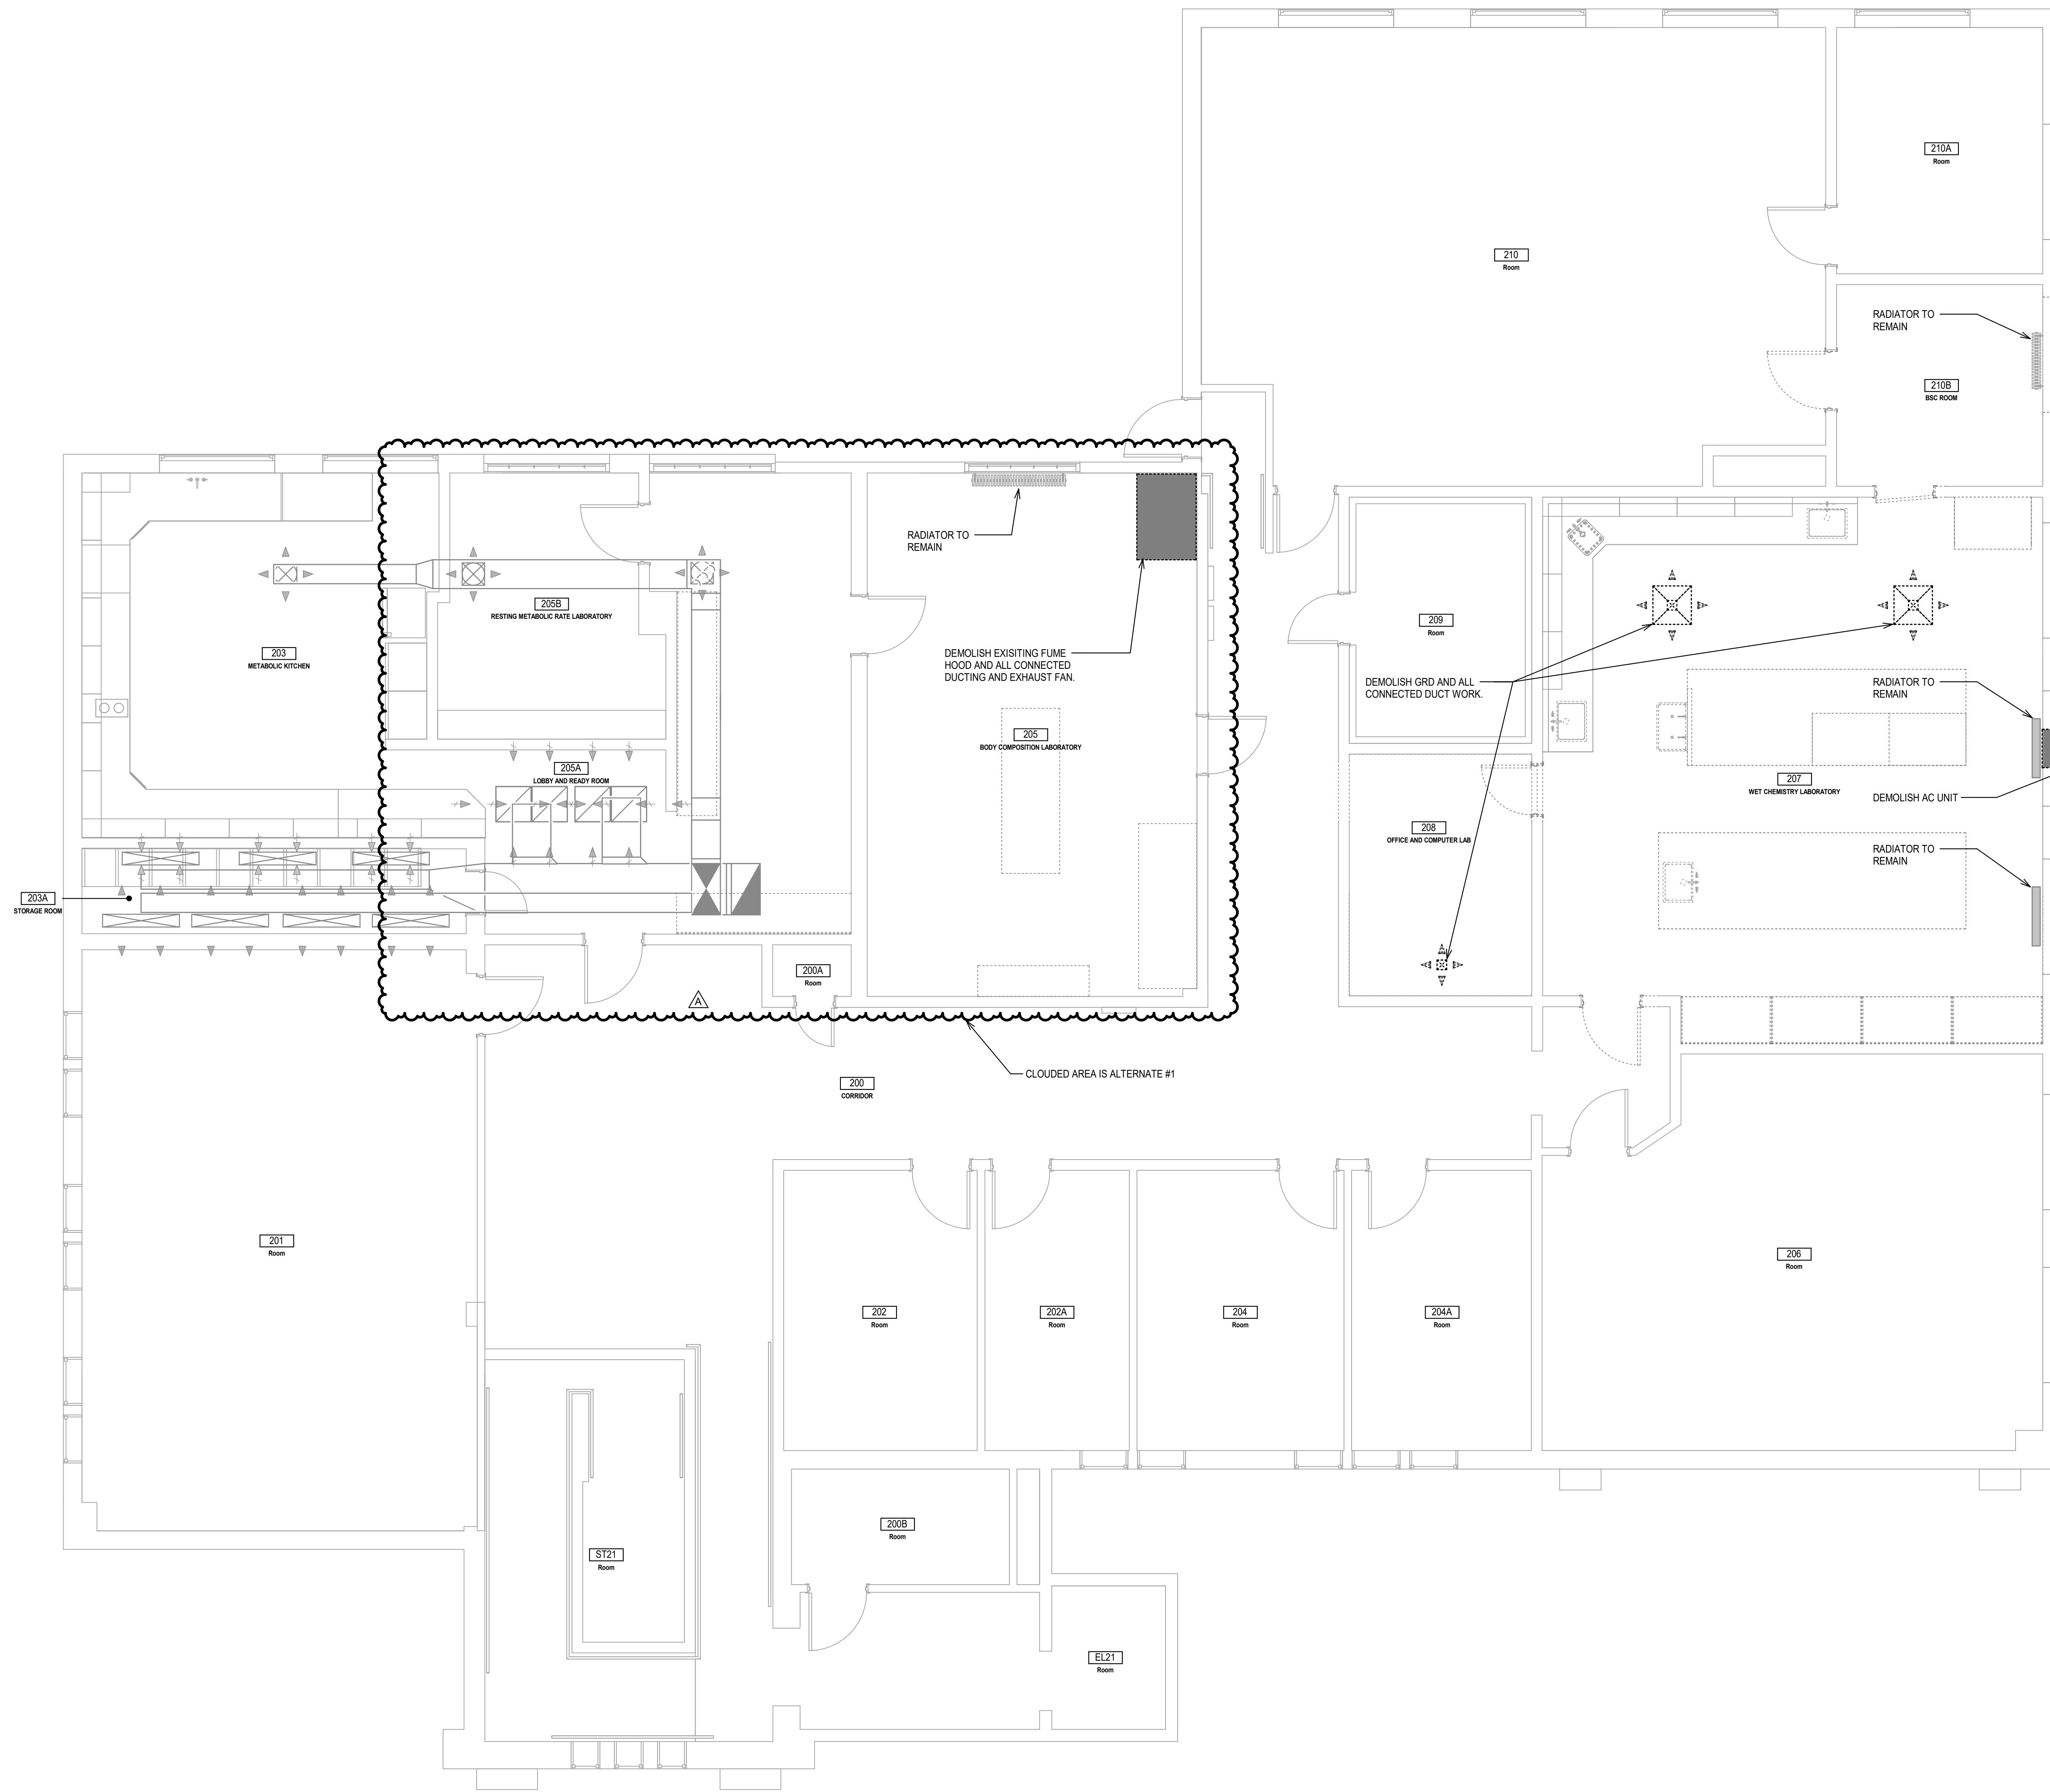

LEVEL 2 - DEMOLITION PLAN - MECHANICAL
 1/4" = 1'-0"




knitstudios.com
 THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSE OF CONTRACTING UNDER AND MAINTAINING THE PROJECT. ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY OTHER PARTY WITHOUT THE WRITTEN CONSENT OF KNIT IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.



ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT
A	1/31/2025	Owner Revisions

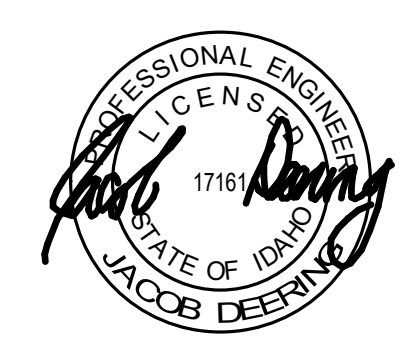

DEMO FLOOR PLAN - MECHANICAL
FOOD RESEARCH CENTER TI - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE., MOSCOW, ID 83844
UNIVERSITY OF IDAHO



TITLE	PROJECT	CLIENT

JOB NO: **240004**
 CAPITAL PROJECT NO: **CP220034**
MD2-11

PHOTO #1



EXHAUST FAN TO BE DEMOLISHED

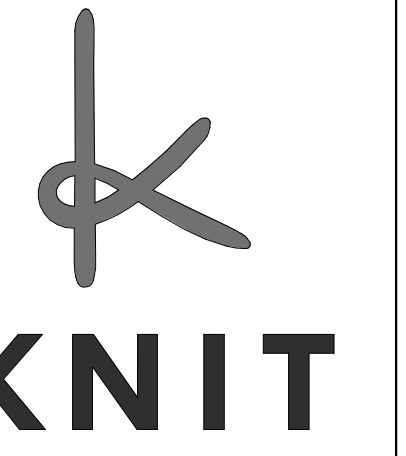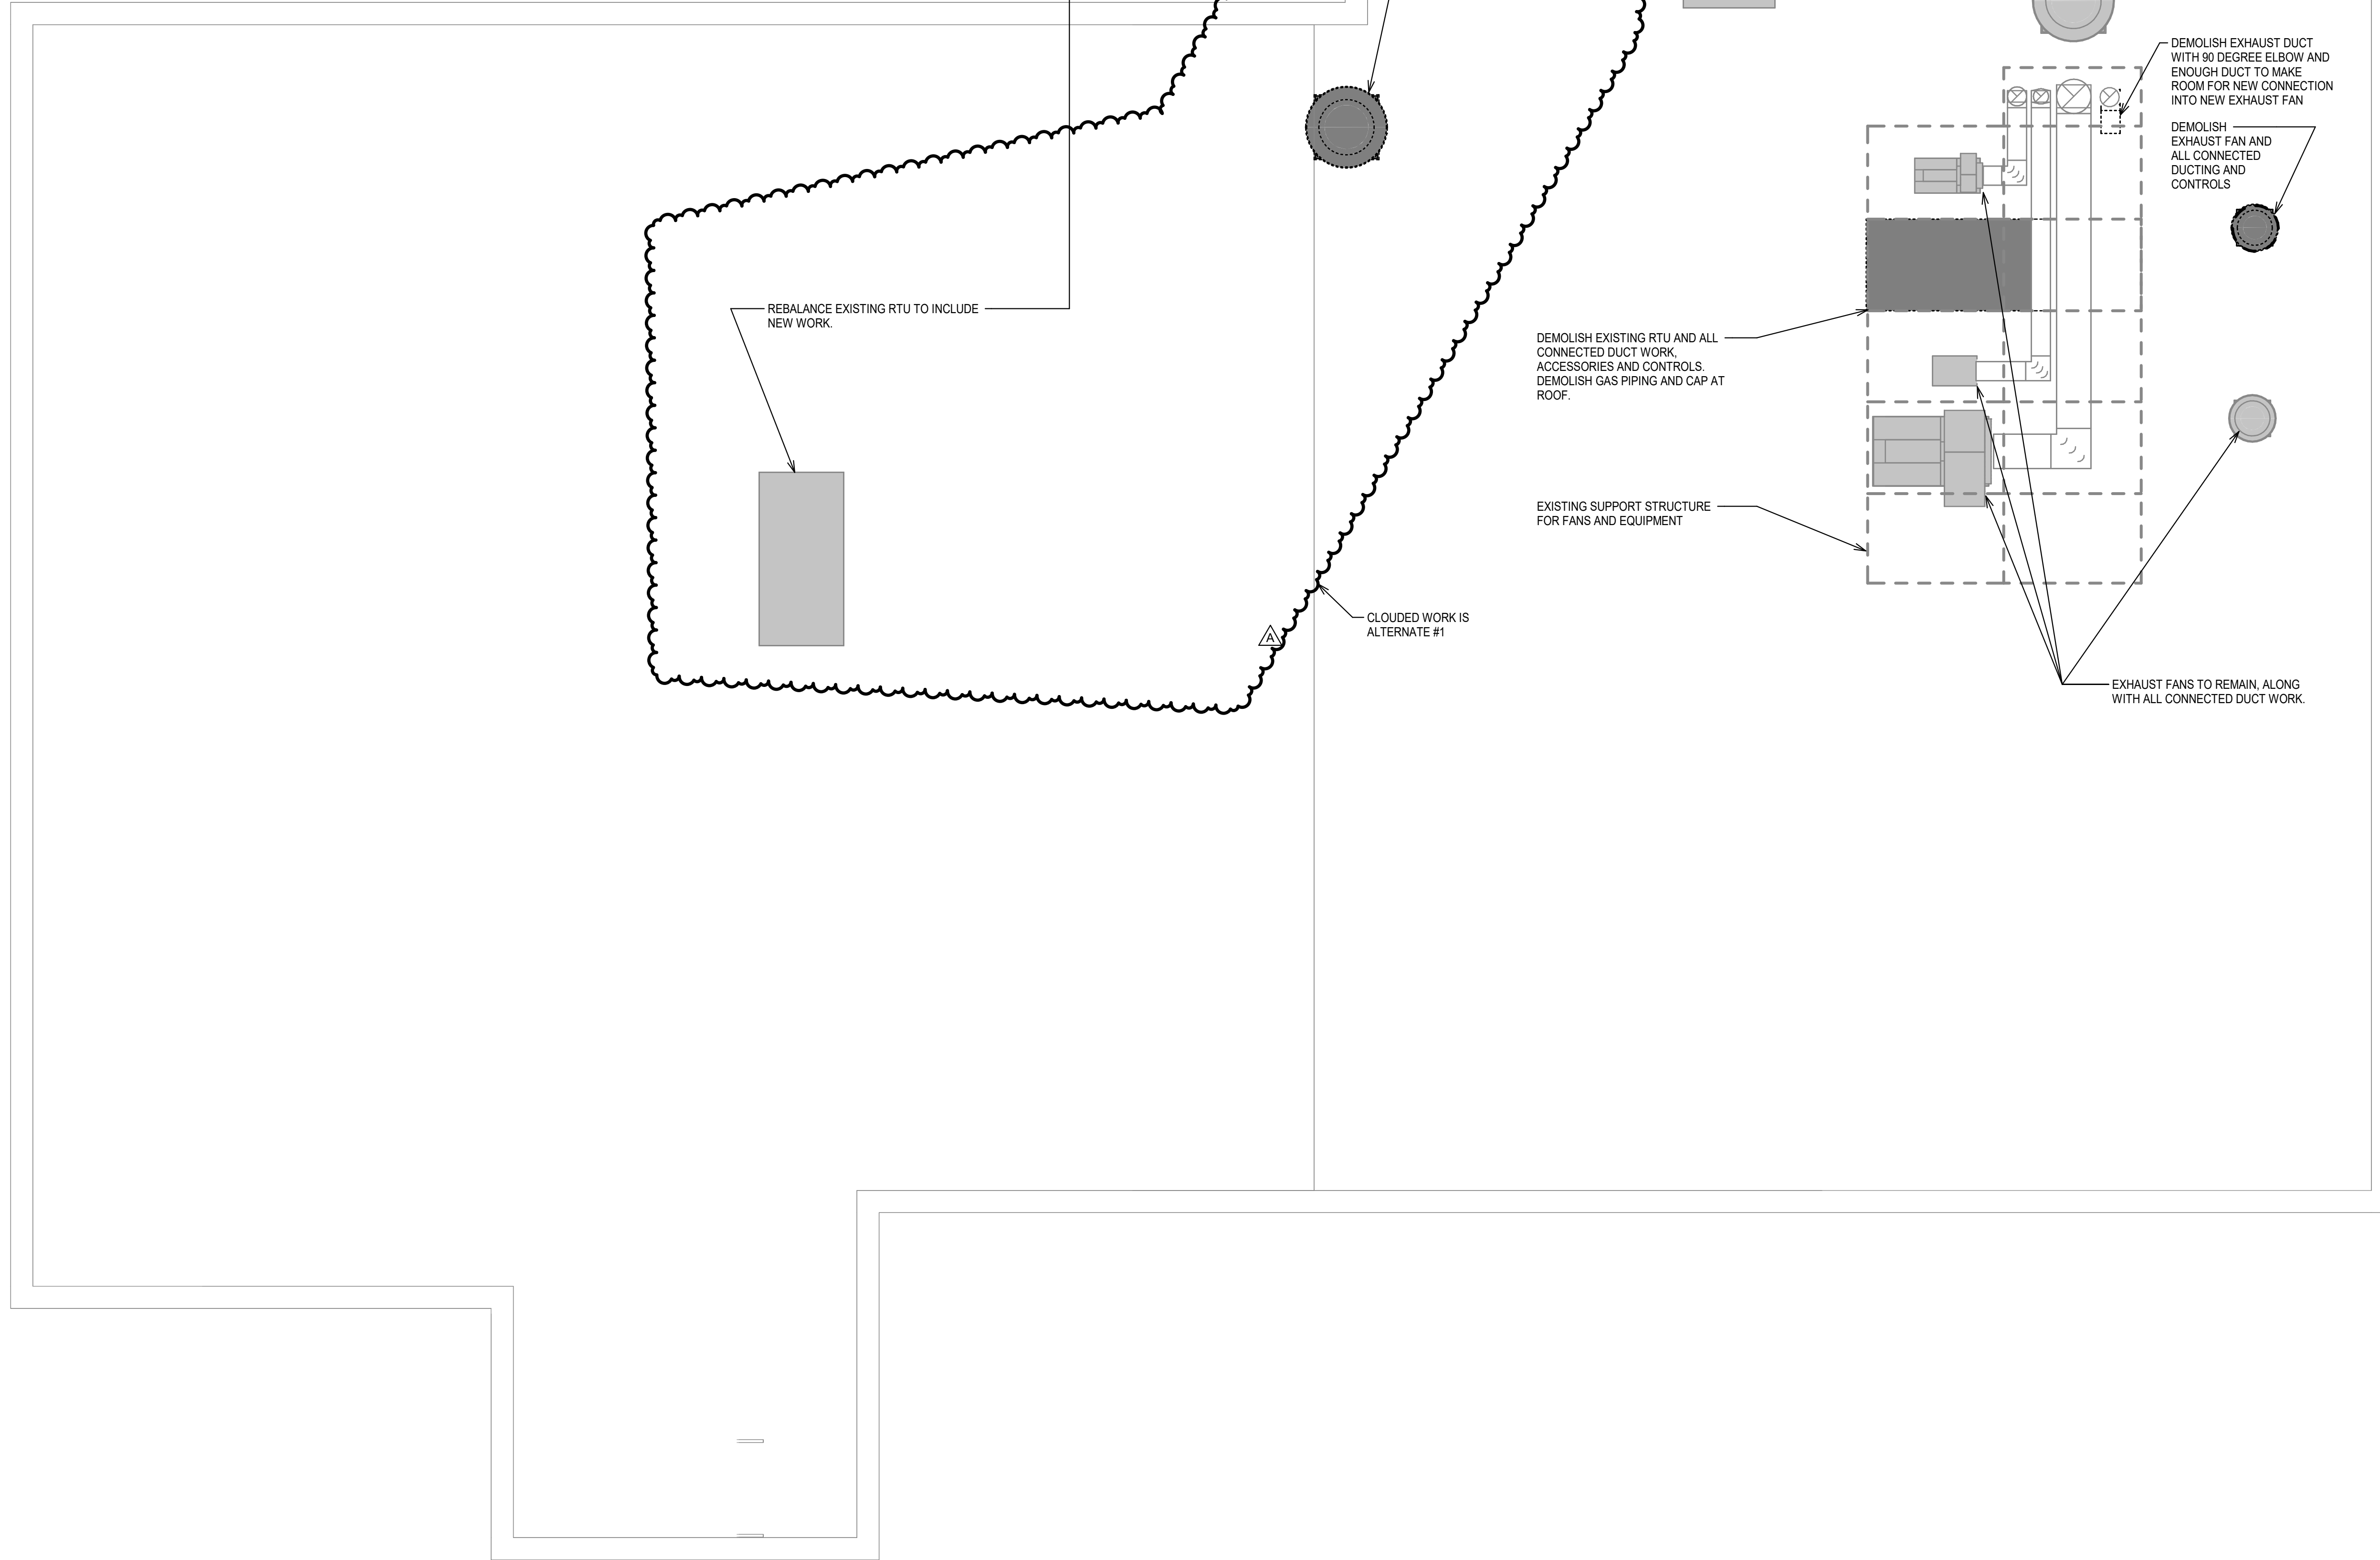

knitstudios.com


THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSES OF CONTRACTING, DESIGN AND MAINTAINING THE PROJECT. ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.

REPRODUCTION OF THESE DOCUMENTS IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.



ISSUE DATE: 12.20.2024

REV	DATE	COMMENT
A	1/31/2025	Owner Revisions

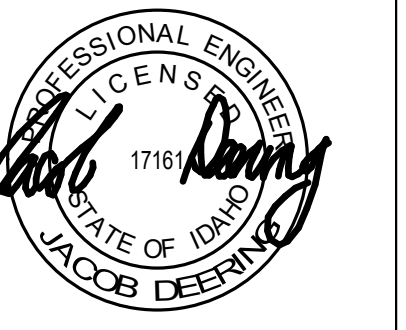

DEMO ROOF PLAN - MECHANICAL

FOOD RESEARCH CENTER TI - PHASE 1 (BUILDING #: 005)

860 IDAHO AVE., MOSCOW, ID 83844

UNIVERSITY OF IDAHO


DEMO ROOF PLAN - MECHANICAL

1/4" = 1'-0"

TITLE PROJECT CLIENT

JOB NO: 240004
CAPITAL PROJECT NO: CP220034

MD2-12

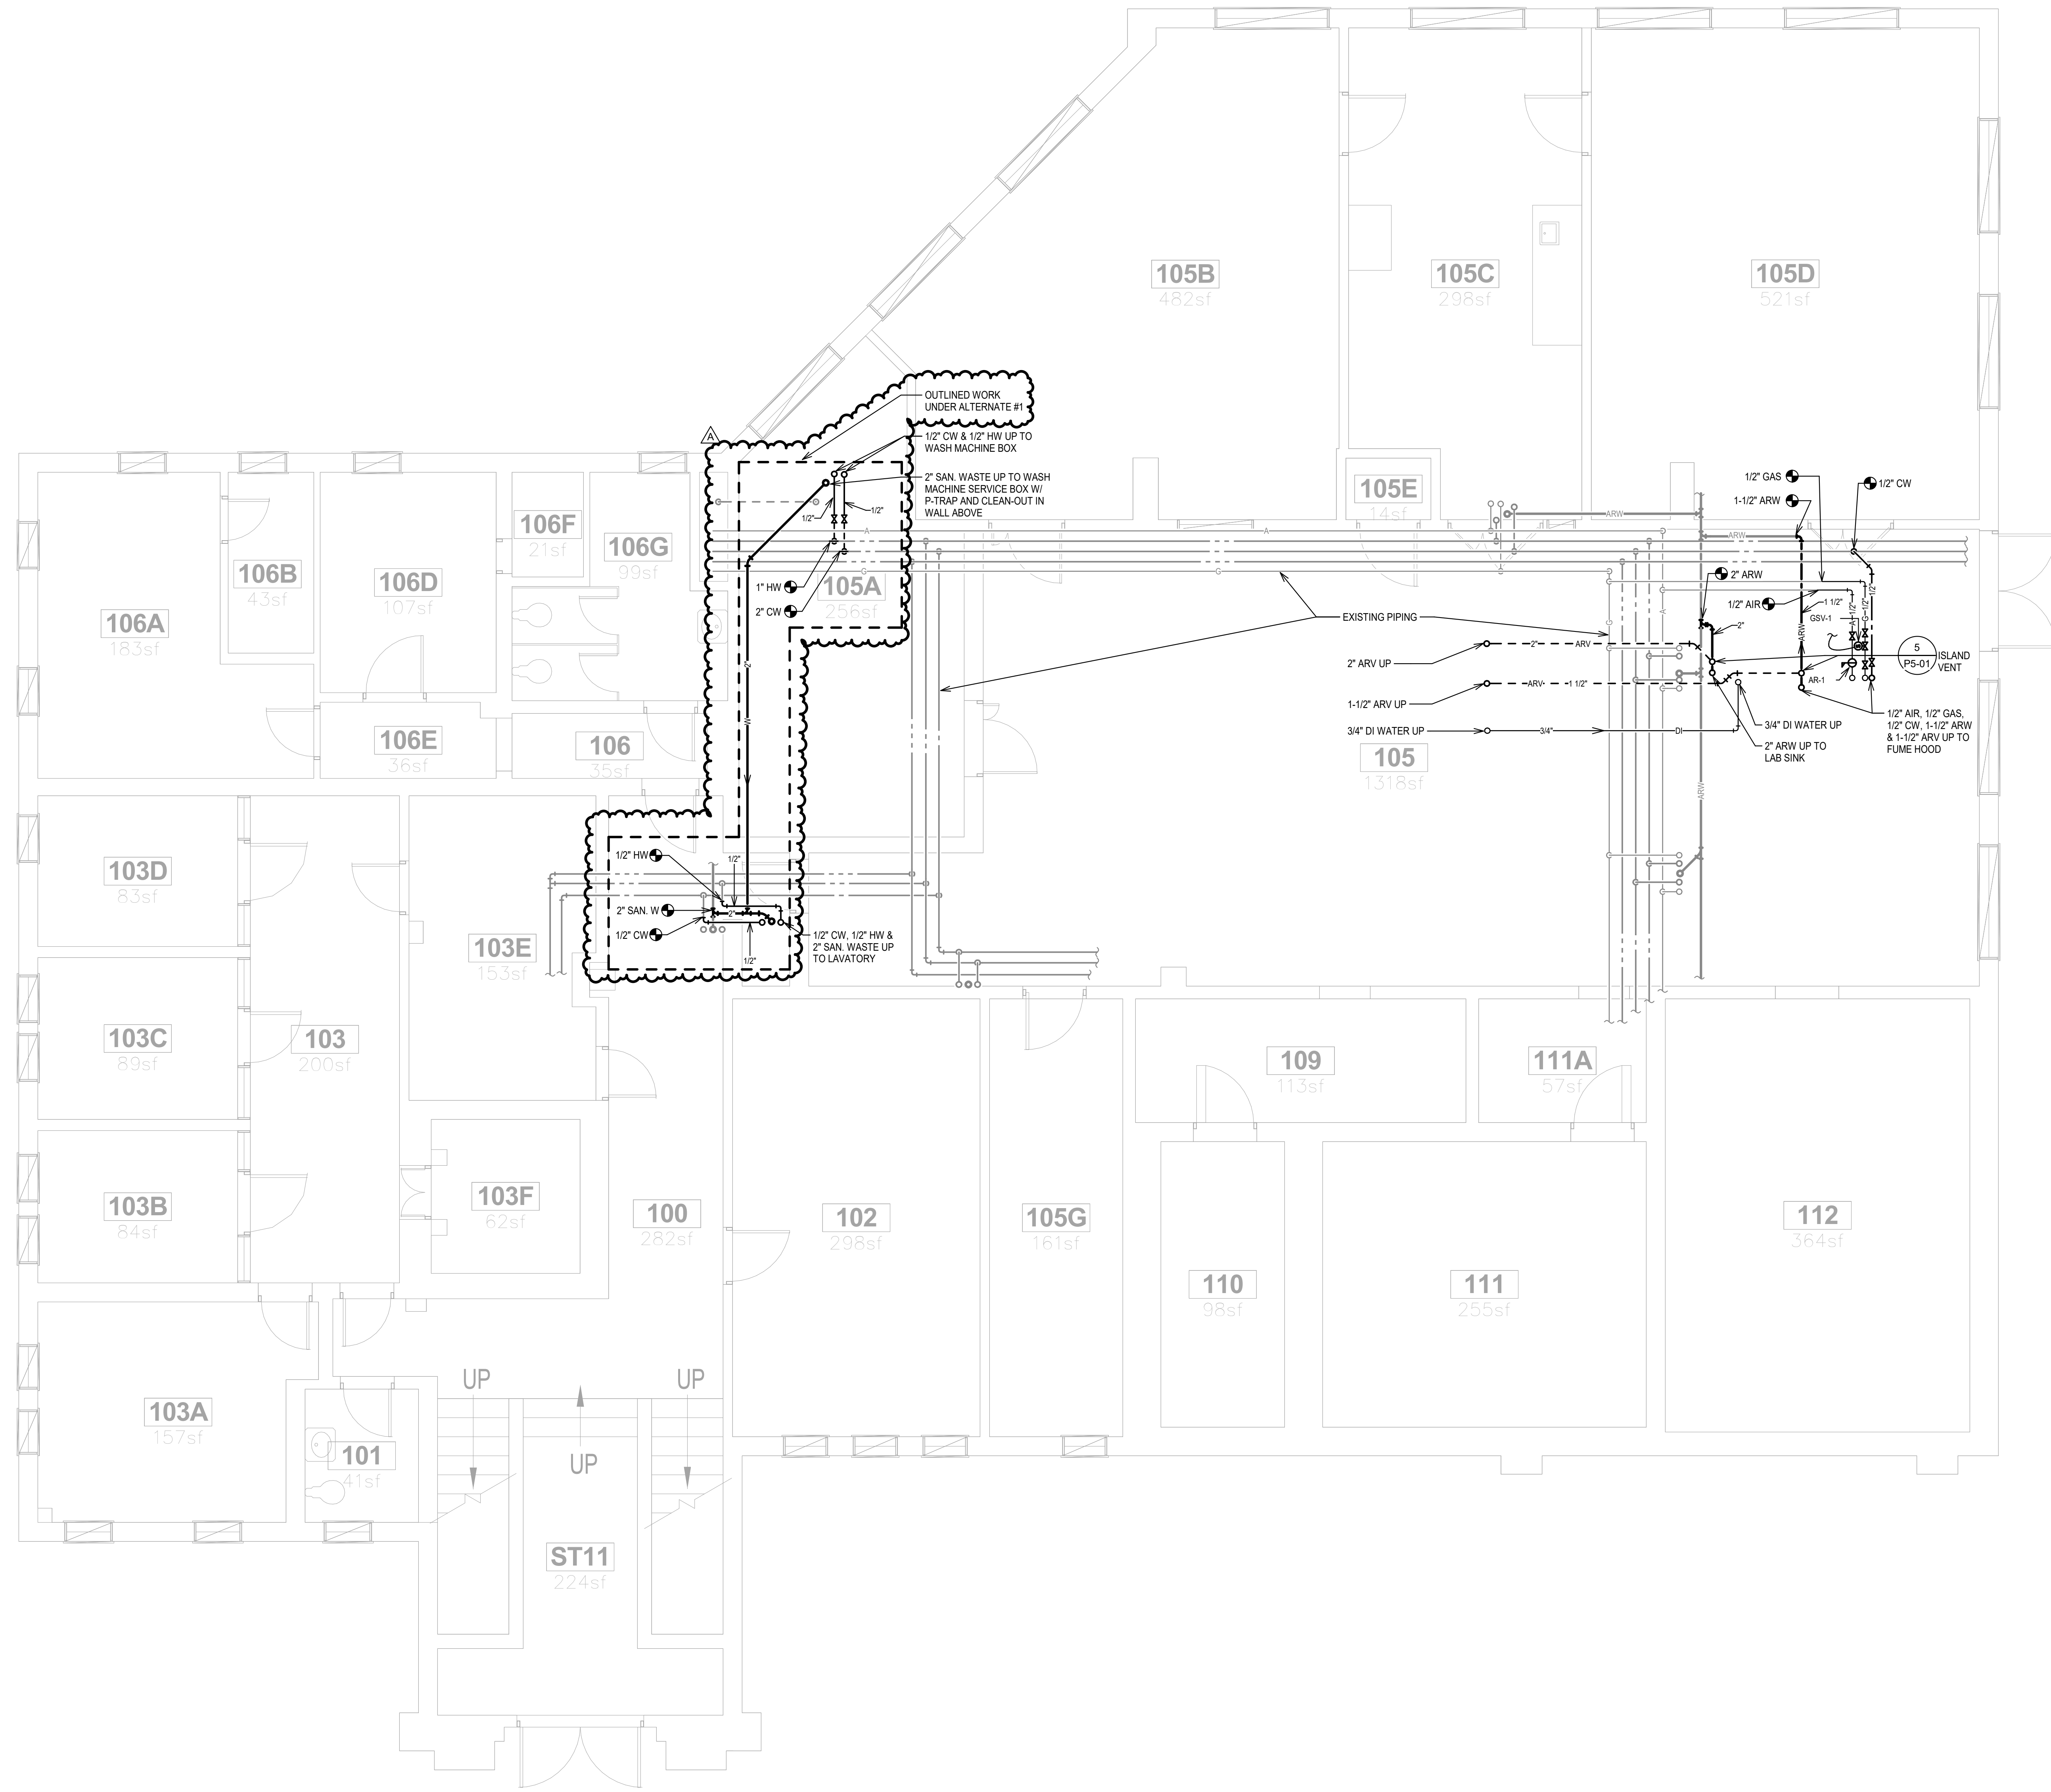

GENERAL NOTES:
 1. ALL WASTE PIPING 4" AND LARGER IN SIZE SHALL SLOPE AT 1% GRADE.
 2. ALL WASTE PIPING 3" AND LESS IN SIZE SHALL SLOPE AT 2% GRADE.
 3. ALL VENT PIPING SHALL SLOPE AT 1% GRADE OR FLAT.
 4. ALL PLUMBING FIXTURES SHALL BE PROVIDED WITH WATER HAMMER ARRESTORS WHETHER INDICATED ON PLANS OR DETAILS OR NOT PER DIV. 22 SPECIFICATIONS.

knitstudios.com
 THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSES OF CONTRACTING UNDER AND MAINTAINING THE PROJECT HEREIN AS THE ARCHITECT OF RECORD FOR THE PROJECT. RETAINERSHIP OF THESE DOCUMENTS, ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY OTHER PARTY WITHOUT THE WRITTEN CONSENT OF KNIT IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.
 REPRODUCTION OF THESE DOCUMENTS IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.

MW Engineers
 601 W First Ave, Ste 1200
 Spokane, WA 99201, USA
 509.326.8223
 mwengineers.com

ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT
A	1/31/2025	Owner Revisions




LEVEL 1 FLOOR PLAN - PLUMBING
 FOOD RESEARCH CENTER TI - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE., MOSCOW, ID 83844
 UNIVERSITY OF IDAHO

LEVEL 1 - PLUMBING
 1/4" = 1'-0"

TITLE	PROJECT	CLIENT

JOB NO: **240004**
 CAPITAL PROJECT NO: **CP220034**

P2-10

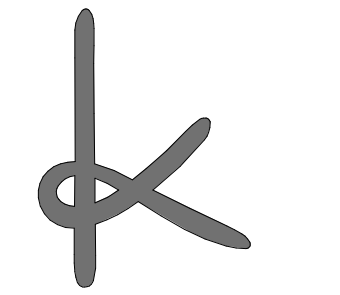


KNIT

knitstudios.com
THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSE OF CONTRACTING WORK AND MAINTAINING THE PROJECT. ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.
REPRODUCTION OF THESE DOCUMENTS IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.




ISSUE DATE: 12.20.2024

REV DATE COMMENT
A 1/31/2025 Owner Revisions

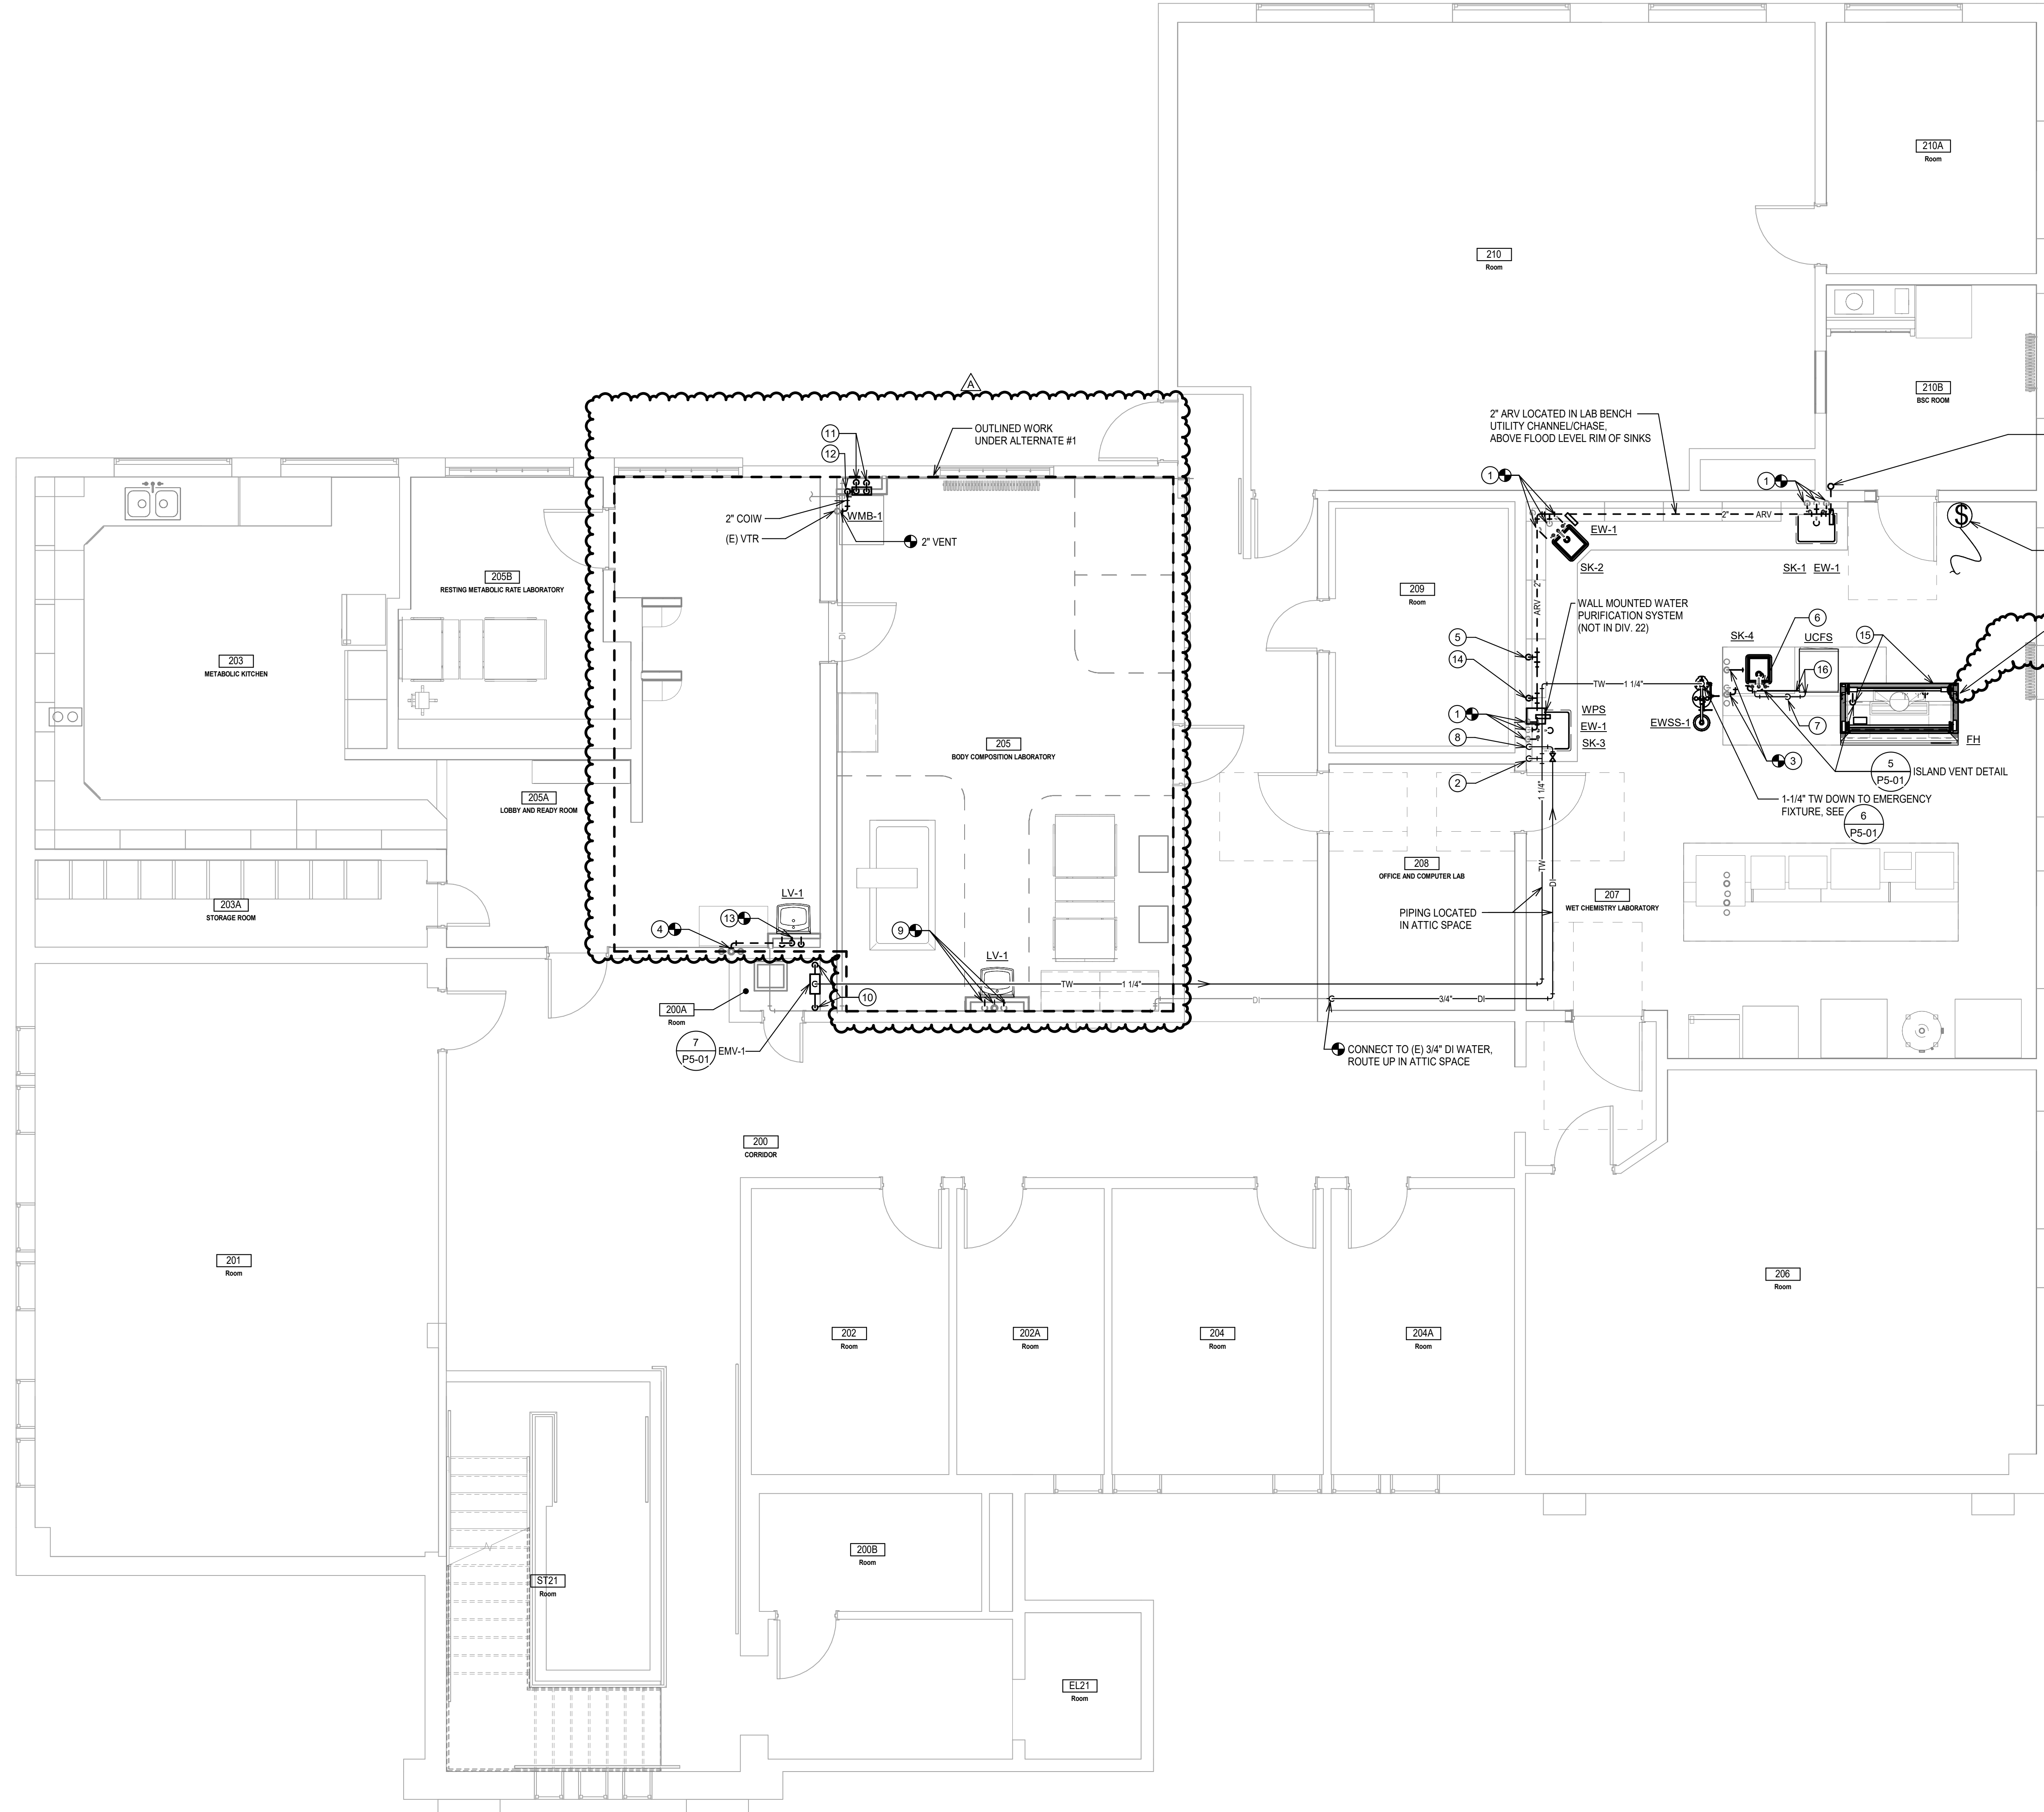

GENERAL NOTES:
1. ALL WASTE PIPING 4" AND LARGER IN SIZE SHALL SLOPE AT 1% GRADE.
2. ALL WASTE PIPING 3" AND LESS IN SIZE SHALL SLOPE AT 2% GRADE.
3. ALL VENT PIPING SHALL SLOPE AT 1% GRADE OR FLAT.
4. ALL PLUMBING FIXTURES SHALL BE PROVIDED WITH WATER HAMMER ARRESTORS WHETHER INDICATED ON PLANS OR DETAILS OR NOT PER DIV. 22 SPECIFICATIONS.

- KEY NOTES:**
- CONNECT NEW LAB SINK TO EXISTING 1/2" CW, 1/2" HW & 1-1/2" ARW IN LAB BENCH. PROVIDE NEW WATER SUPPLY STOPS. PROVIDE NEW ARW ROUTED THRU ROOF IN LIEU OF EXISTING DRUM TRAPS.
 - 1/2" TW DOWN ON WALL AND ROUTED INSIDE LAB BENCH CABINET SPACE W/ 1/2" TW TO EACH EMERGENCY EYEWASH.
 - CONNECT NEW LAB SINK TO EXISTING 1/2" CW & 1/2" HW UNDER LAB BENCH. PROVIDE NEW 2" ARW AND 2" ACID RESISTANT ISLAND VENT THRU ROOF IN ATTIC SPACE.
 - CONNECT NEW 1-1/2" VENT FROM LAVATORY TO EXISTING VENT THRU ROOF IN ATTIC SPACE.
 - 2" ARW DOWN THRU FLOOR.
 - 2" ARW ISLAND VENT DOWN THRU FLOOR.
 - 3/4" DI WATER DOWN THRU FLOOR.
 - 3/4" DI WATER DOWN ON WALL TO BELOW LAB BENCH. ROUTE 3/4" DI WATER TO WATER PURIFICATION SYSTEM AND 3/4" DI WATER CONTINUING DOWN IN LAB BENCH CABINET SPACE TO BELOW FLOOR.
 - CONNECT NEW LAVATORY TO EXISTING 1/2" CW, 1/2" HW, 1-1/2" VENT & 2" WASTE IN WALL. PROVIDE NEW WATER SUPPLY STOPS.
 - ROUTE & CONNECT NEW 3/4" CW & 3/4" HW TO NEAREST (E) 3/4" HW & CW PIPES.
 - 1/2" CW & 1/2" HW DOWN IN CHASE THRU FLOOR.
 - 1/2" CW, 1/2" HW & 2" VENT DOWN IN WALL TO WASH MACHINE BOX. PROVIDE 2" WASTE OUTLET FROM BOX W/ P-TRAP IN WALL.
 - 1/2" CW, 1/2" HW & 2" WASTE UP FROM BELOW SLAB TO LAVATORY.
 - 1-1/2" ARW DOWN THRU FLOOR.
 - 1/2" AIR, 1/2" GAS, 1/2" CW, 1-1/2" ARW & 1-1/2" ACID RESISTANT ISLAND VENT UP THRU FLOOR TO FUME HOOD UTILITY CHASE.
 - EXTEND 1/2" DI WATER AND 1/2" HW TO FLASK SCRUBBER.

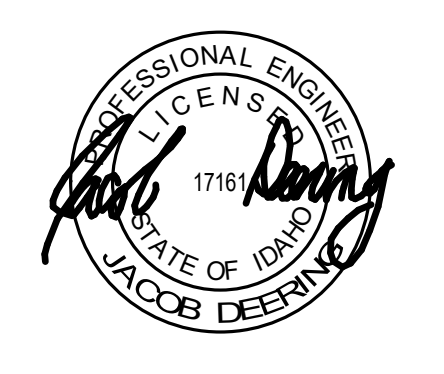


LEVEL 2 FLOOR PLAN - PLUMBING
FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)
860 IDAHO AVE., MOSCOW, ID 83844
UNIVERSITY OF IDAHO


LEVEL 2 - PLUMBING
1/4" = 1'-0"

TITLE PROJECT CLIENT
JOB NO: 240004
CAPITAL PROJECT NO: CP220034


P2-11

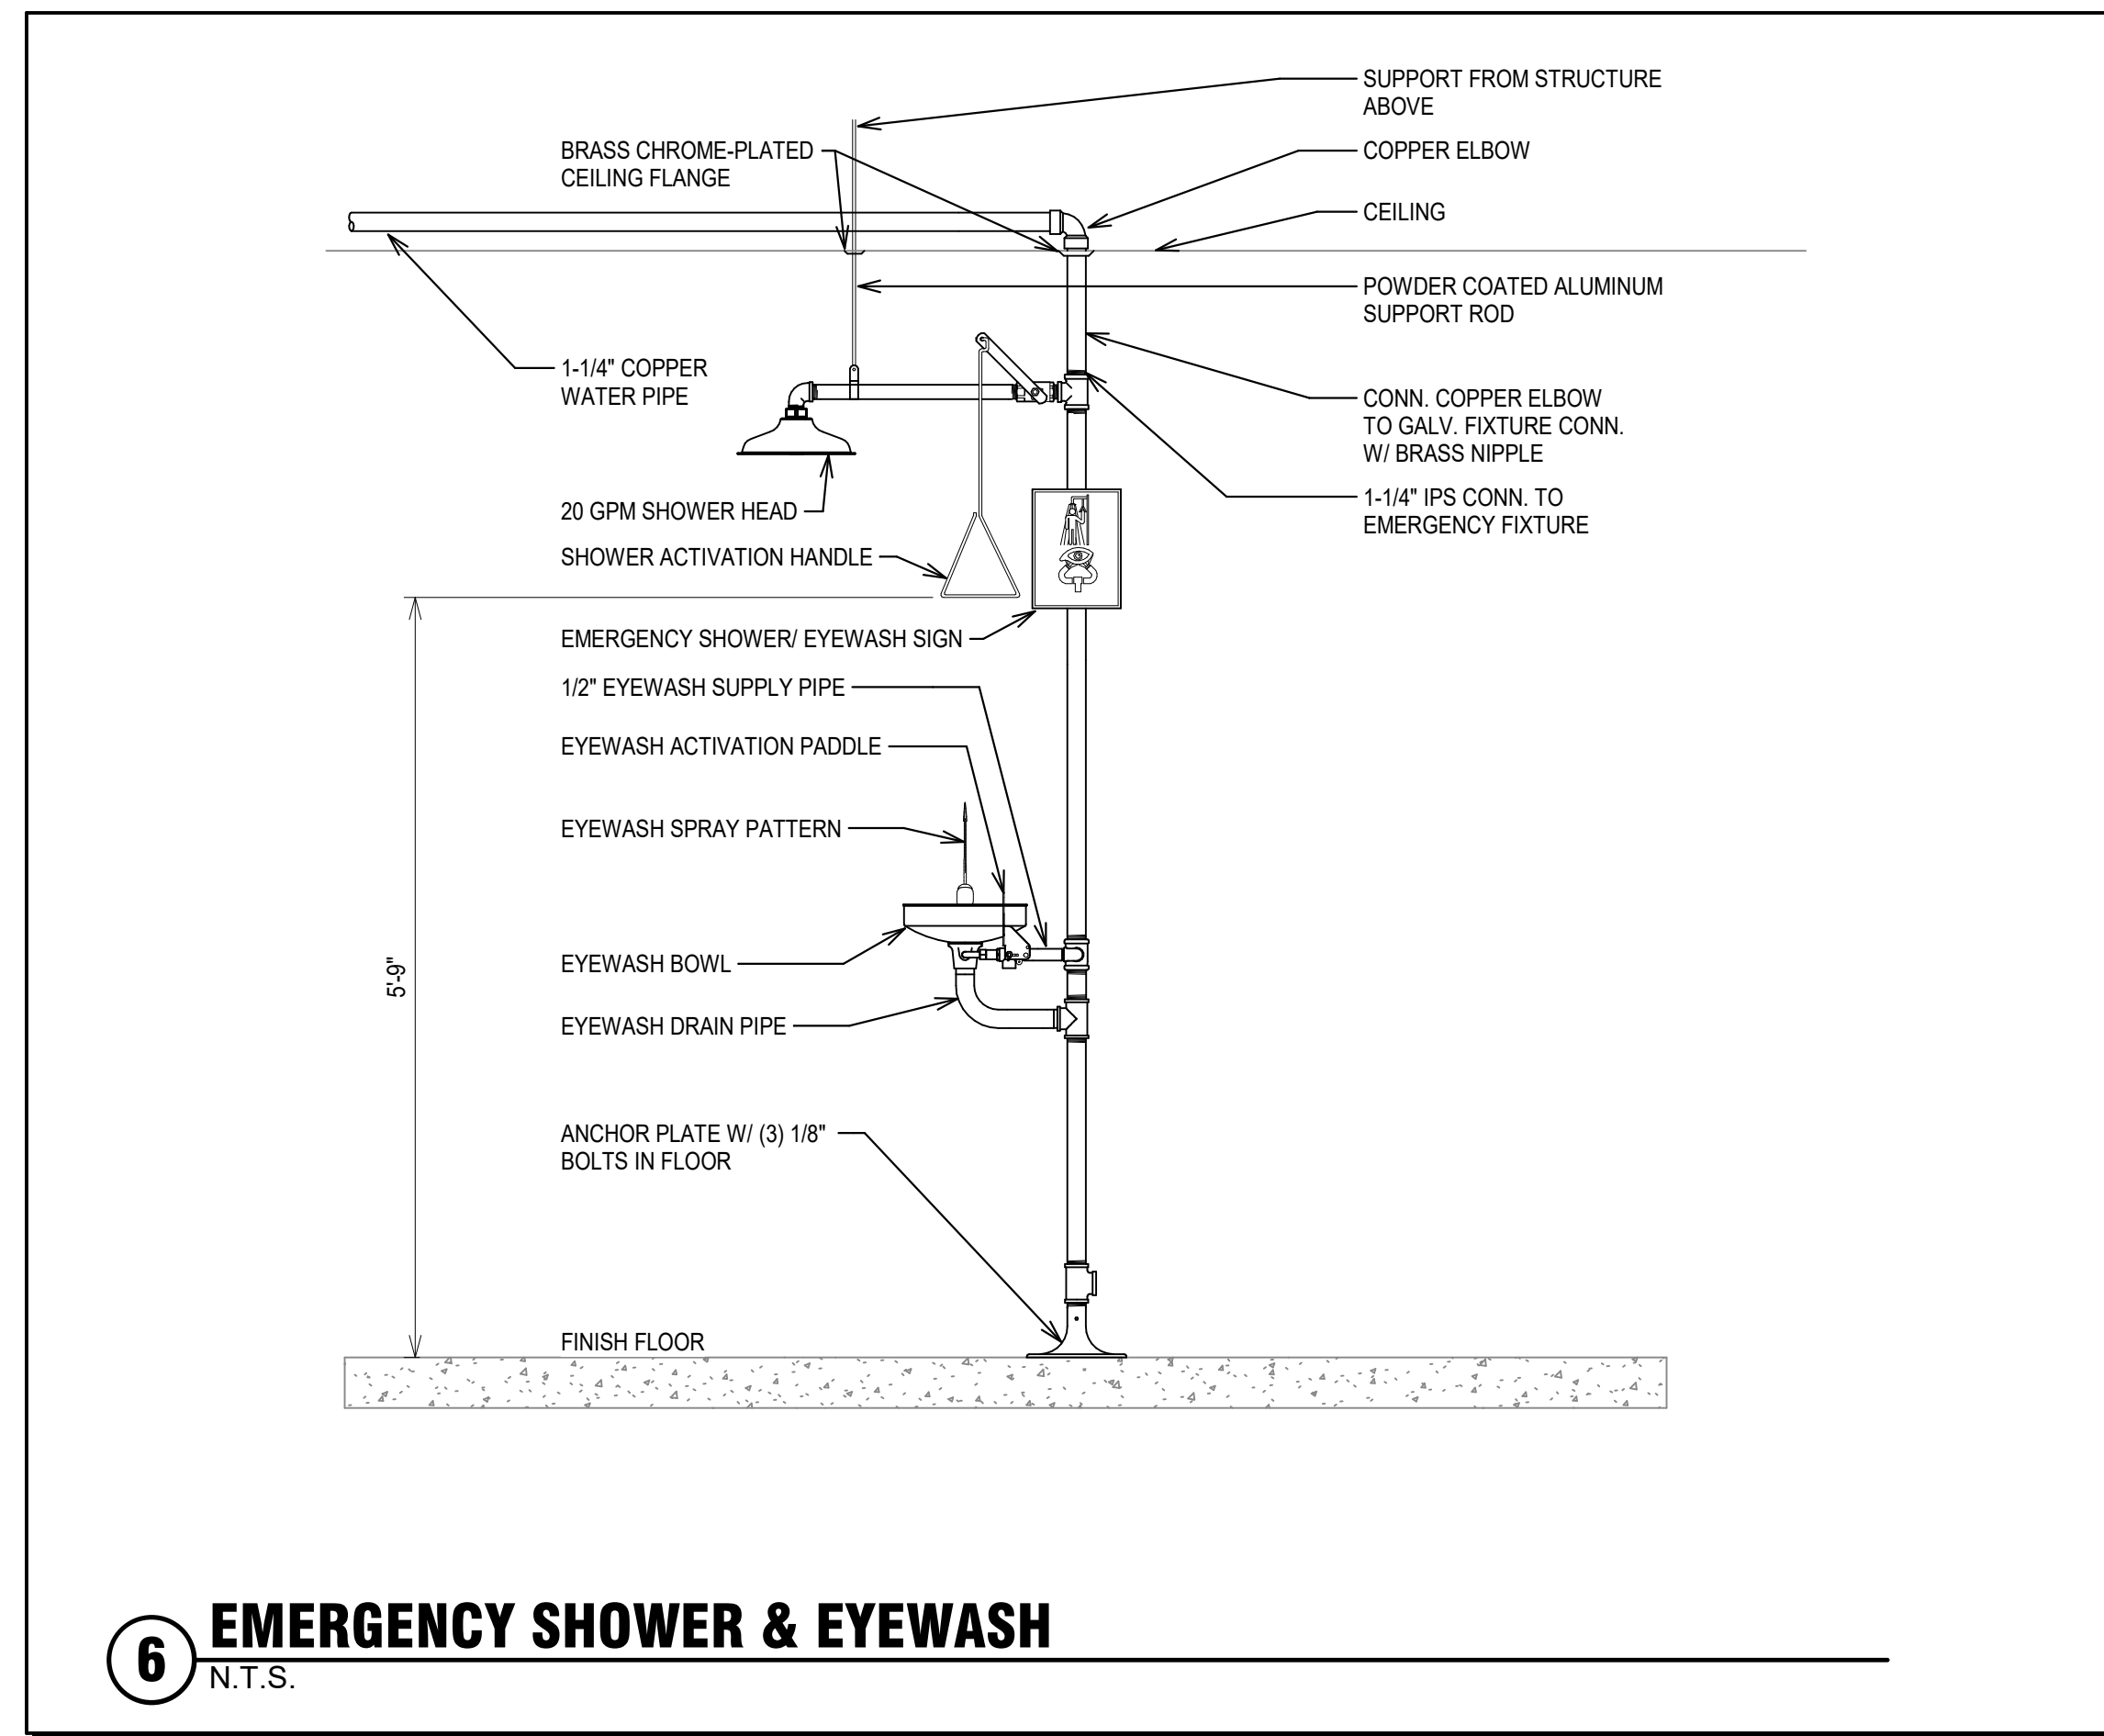


6 EMERGENCY SHOWER & EYEWASH
N.T.S.

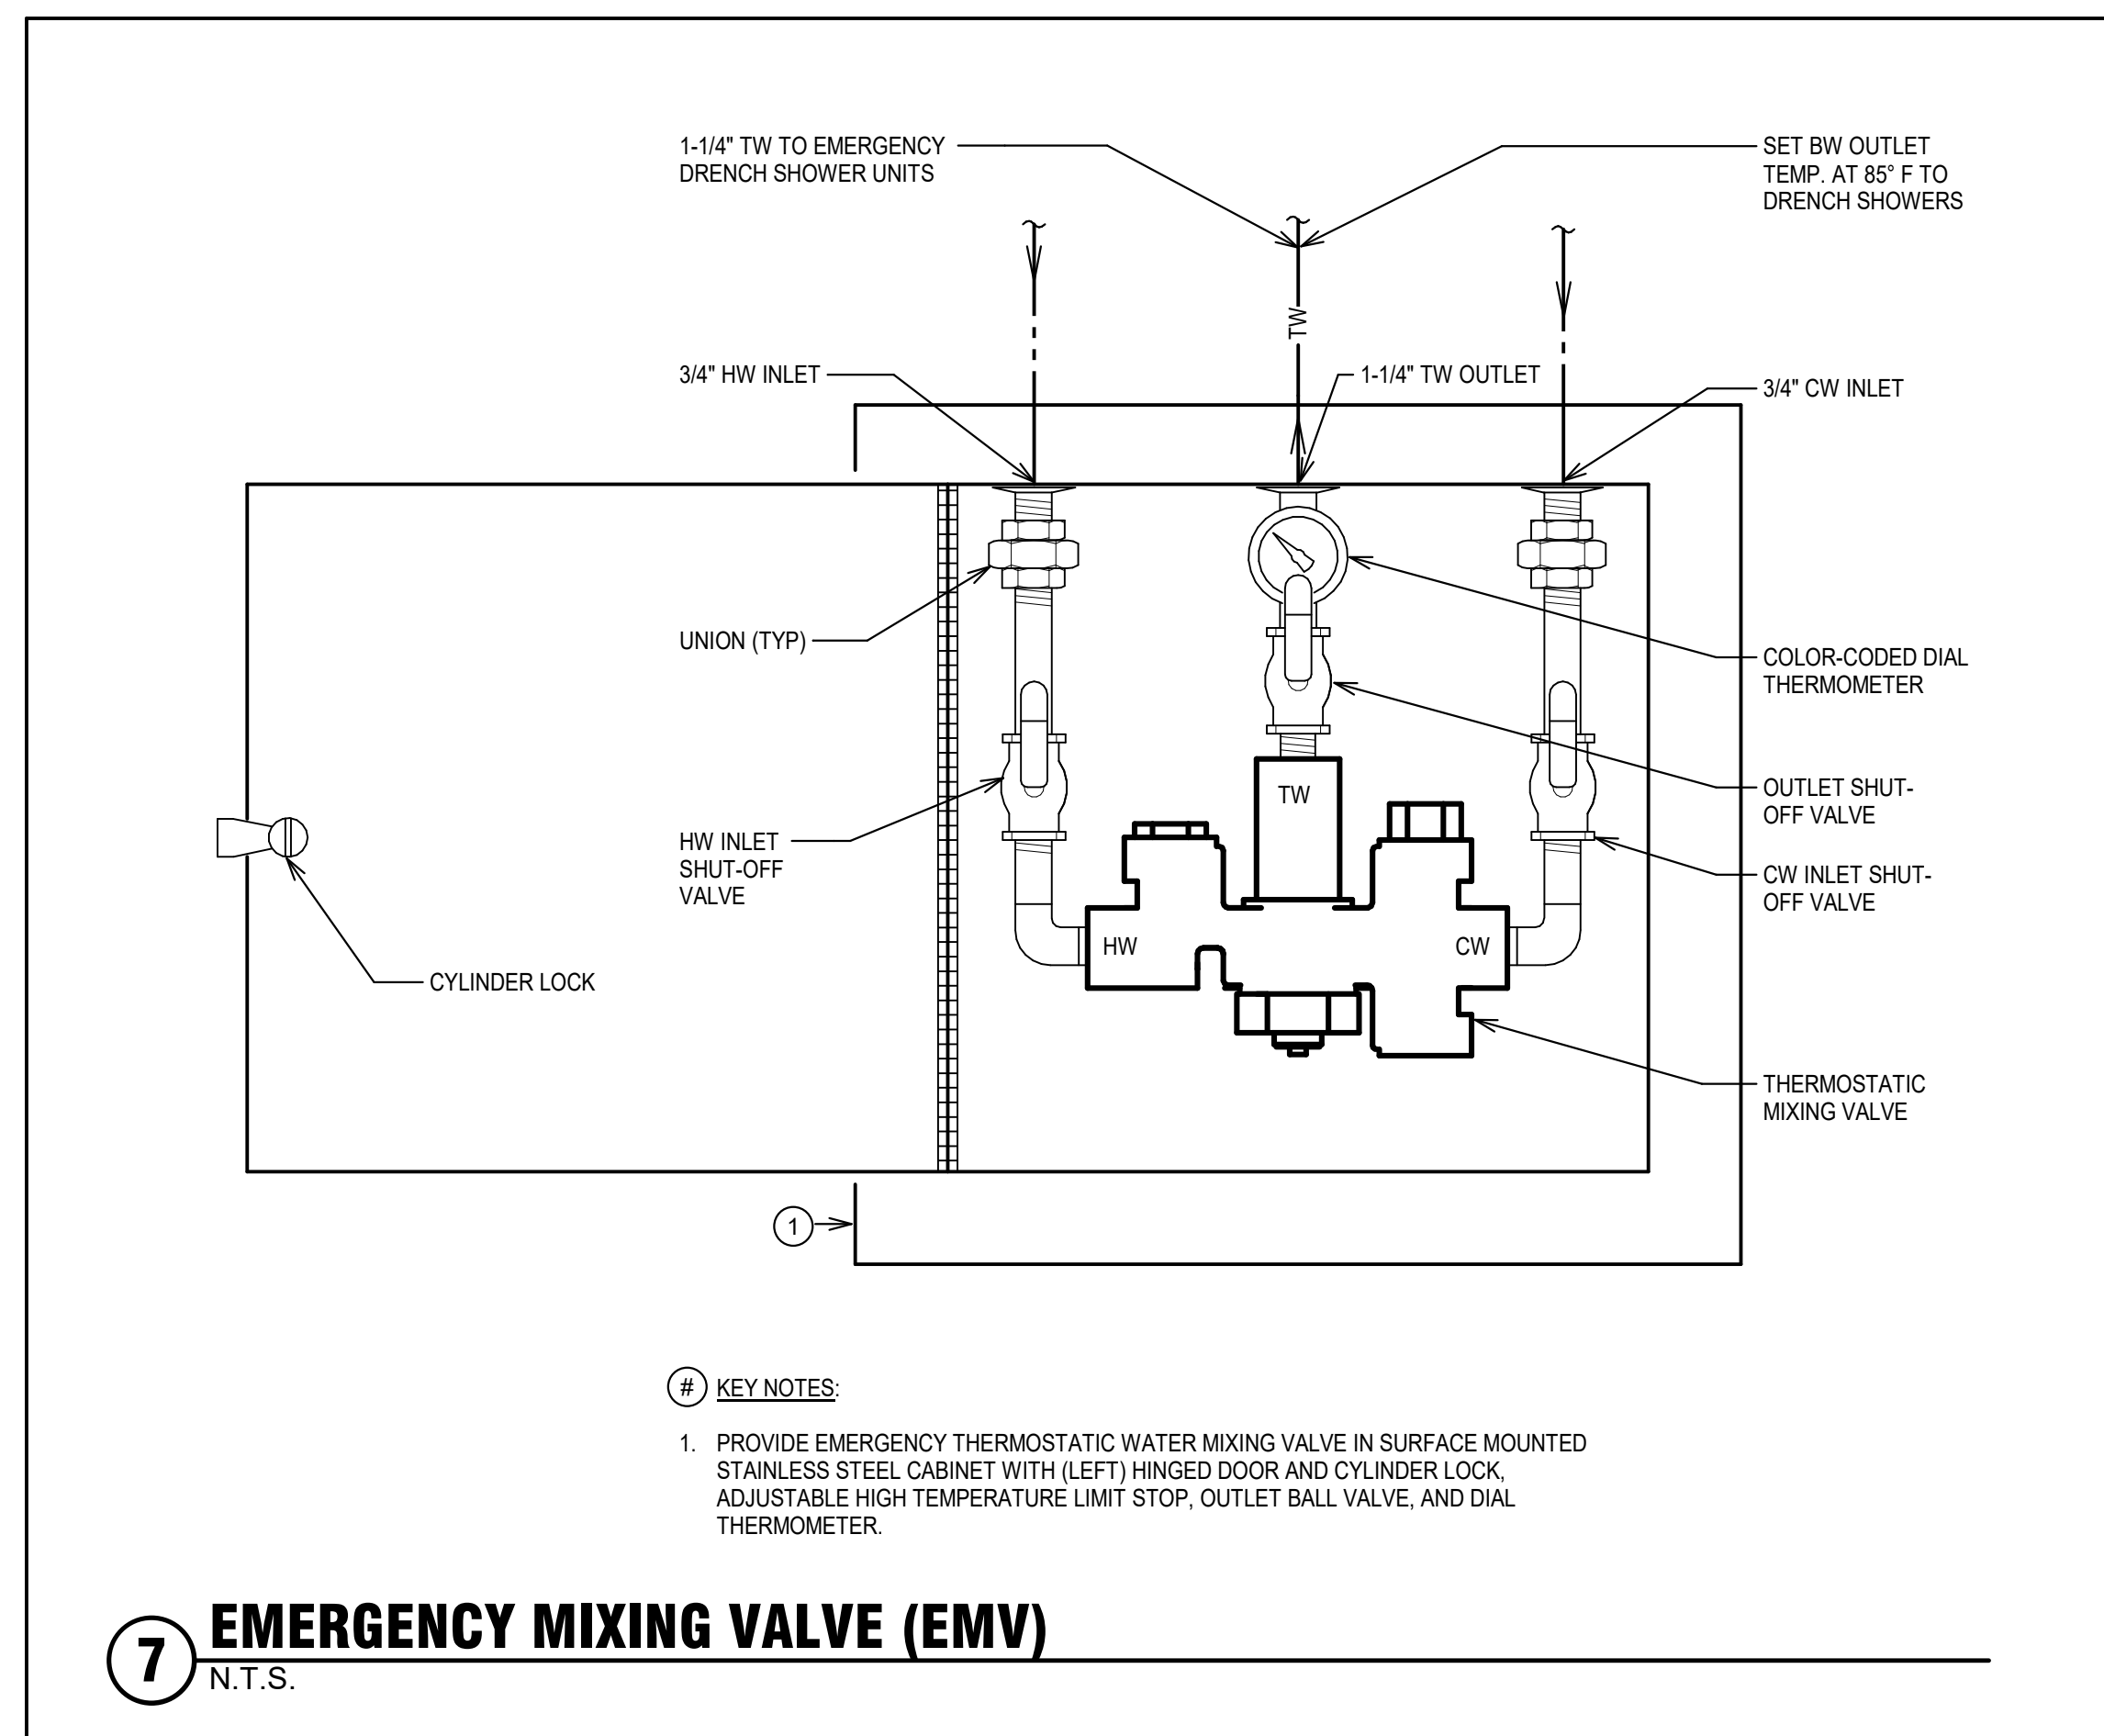


7 EMERGENCY MIXING VALVE (EMV)
N.T.S.

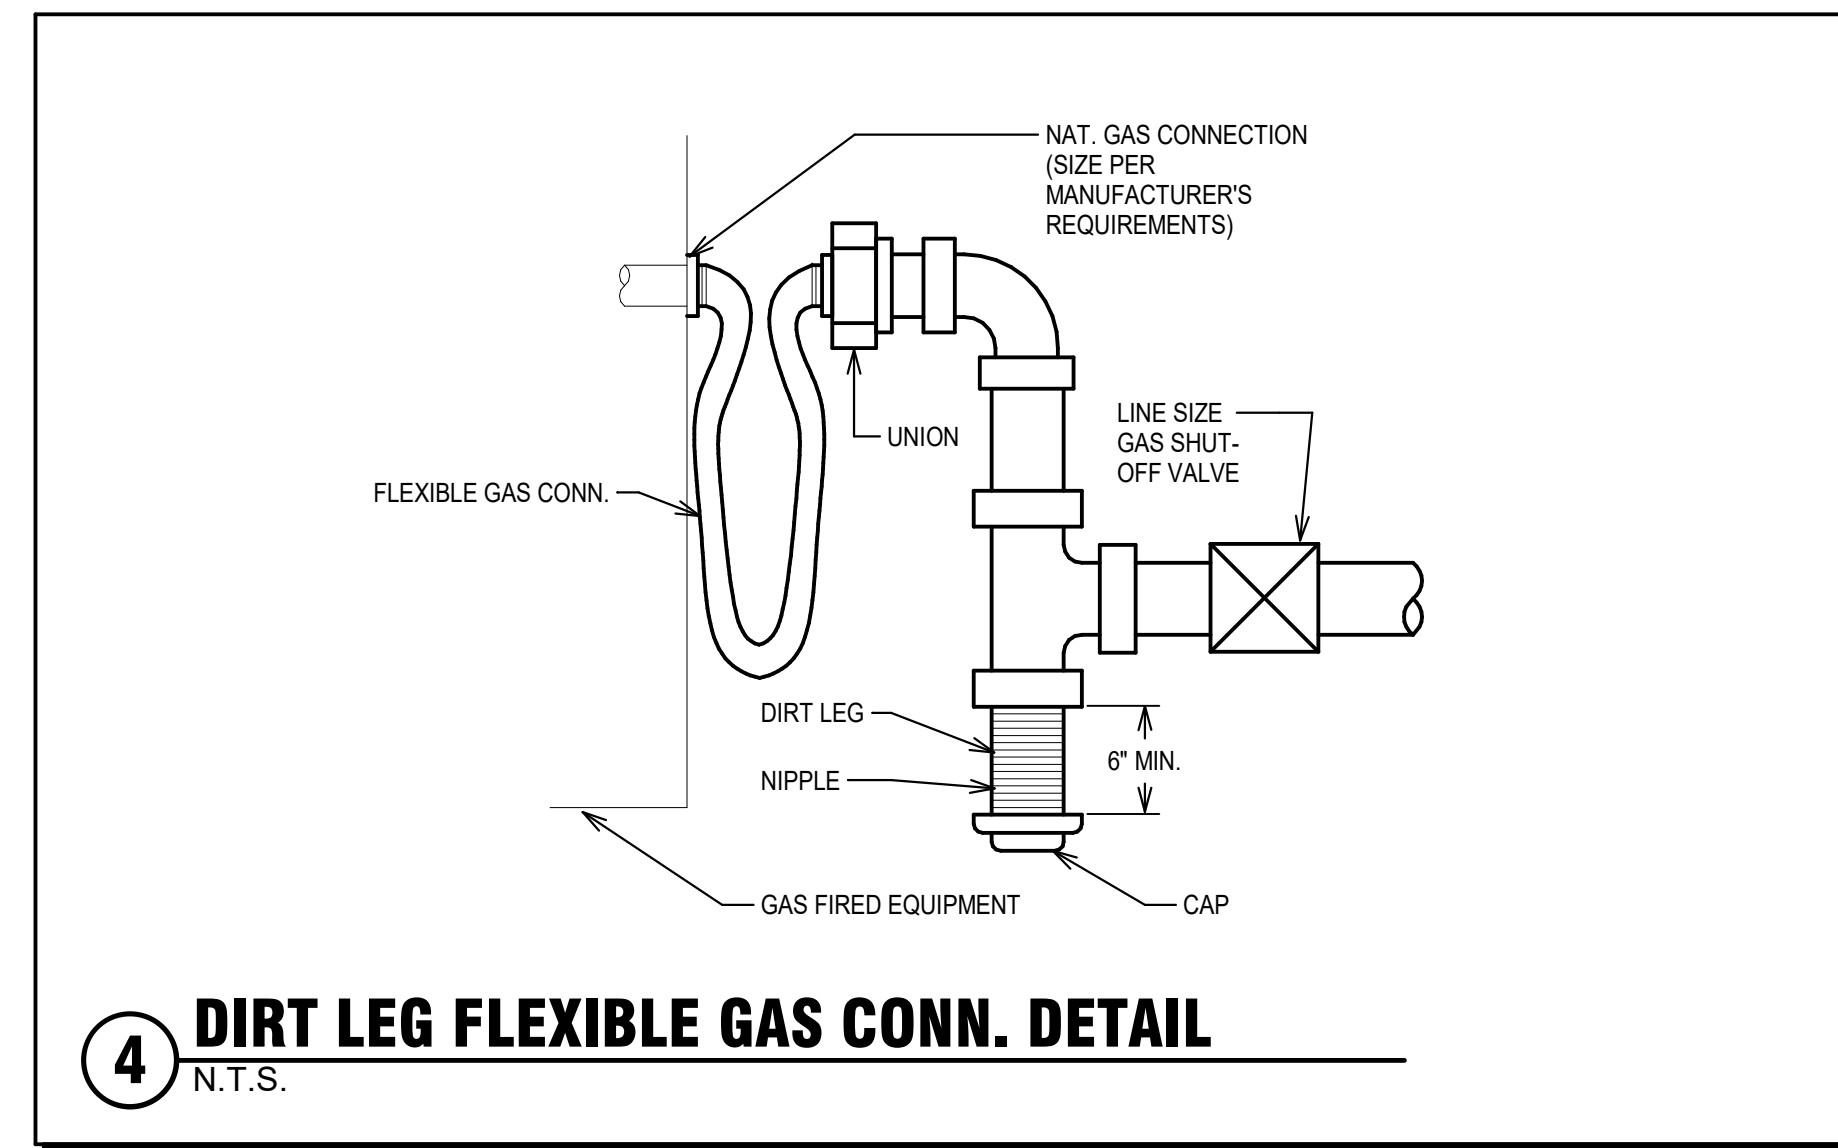


4 DIRT LEG FLEXIBLE GAS CONN. DETAIL
N.T.S.

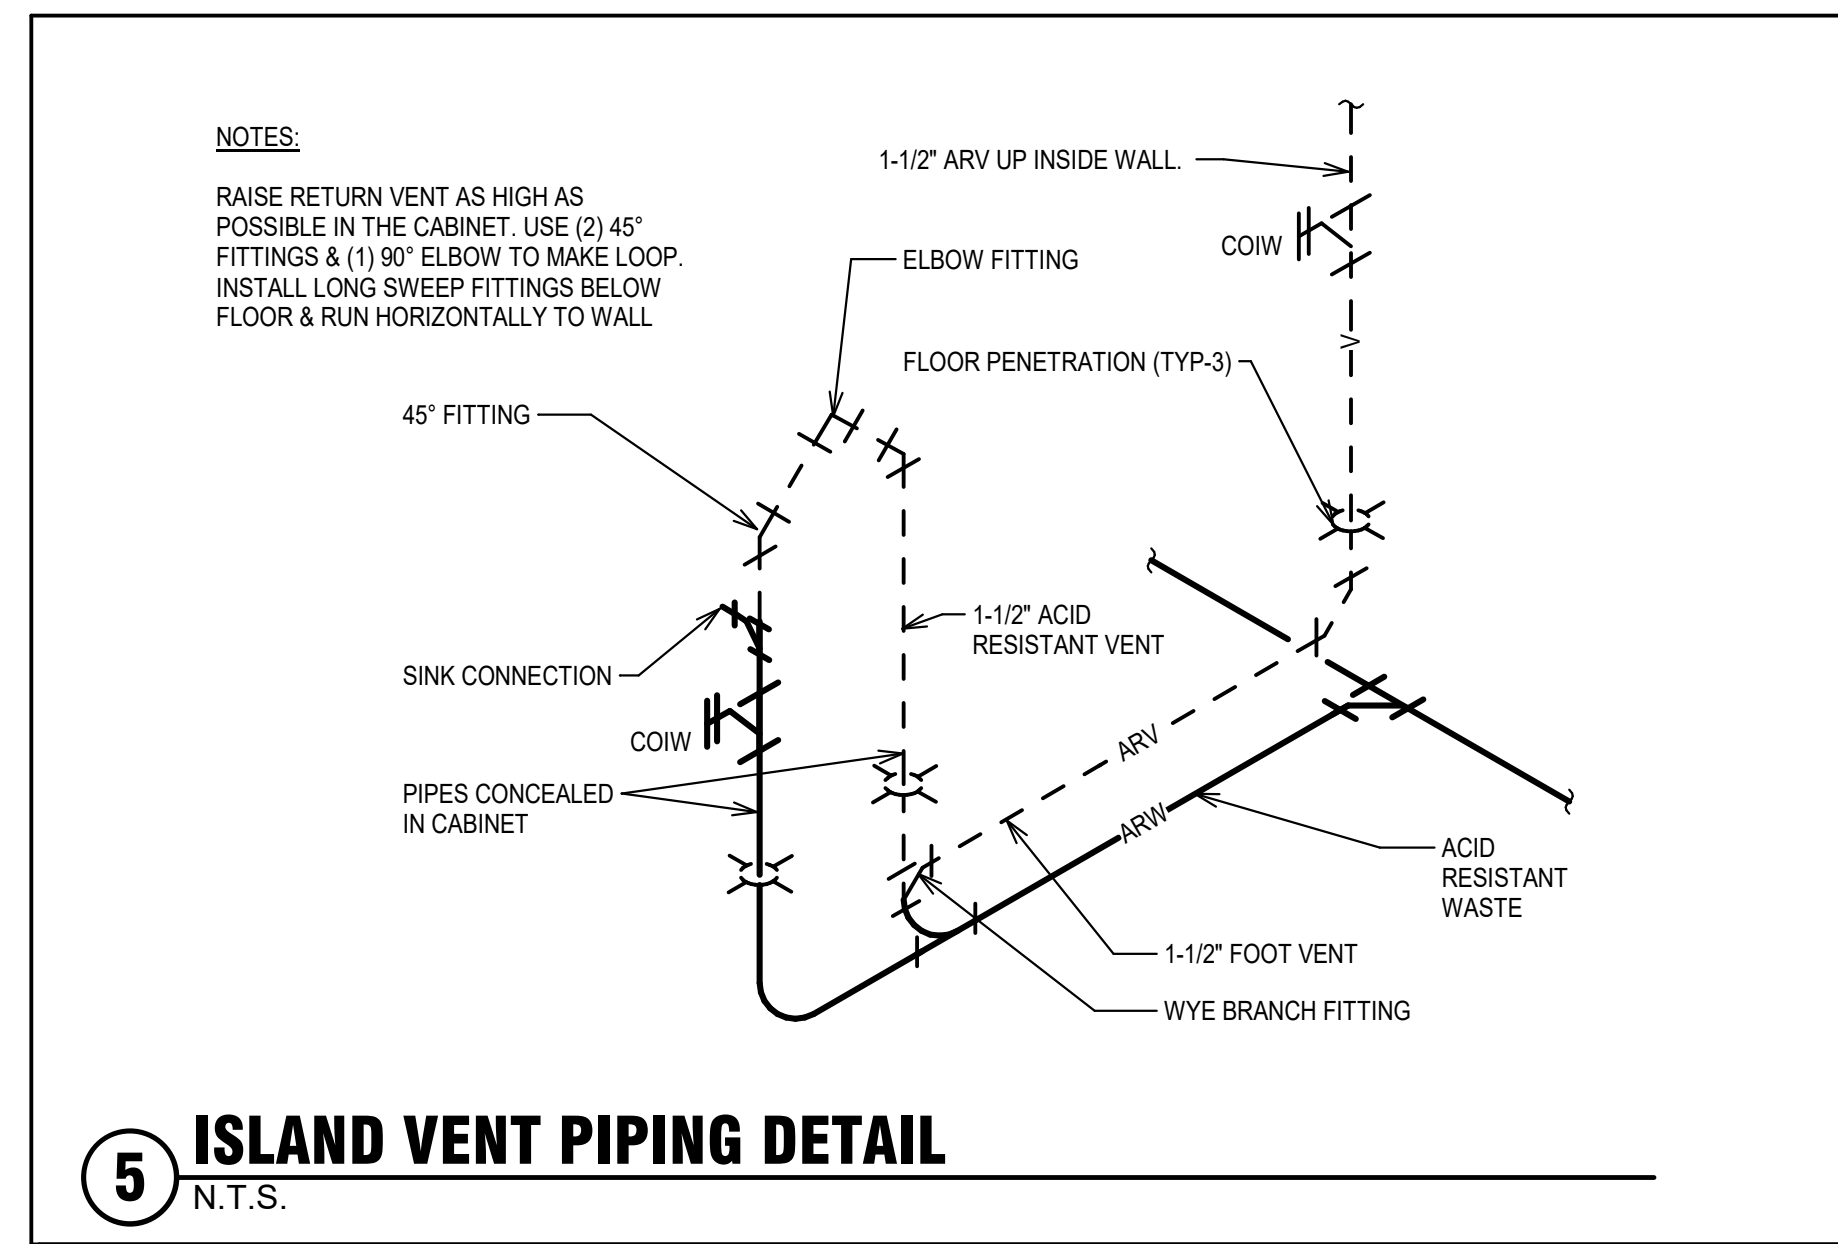


5 ISLAND VENT PIPING DETAIL
N.T.S.

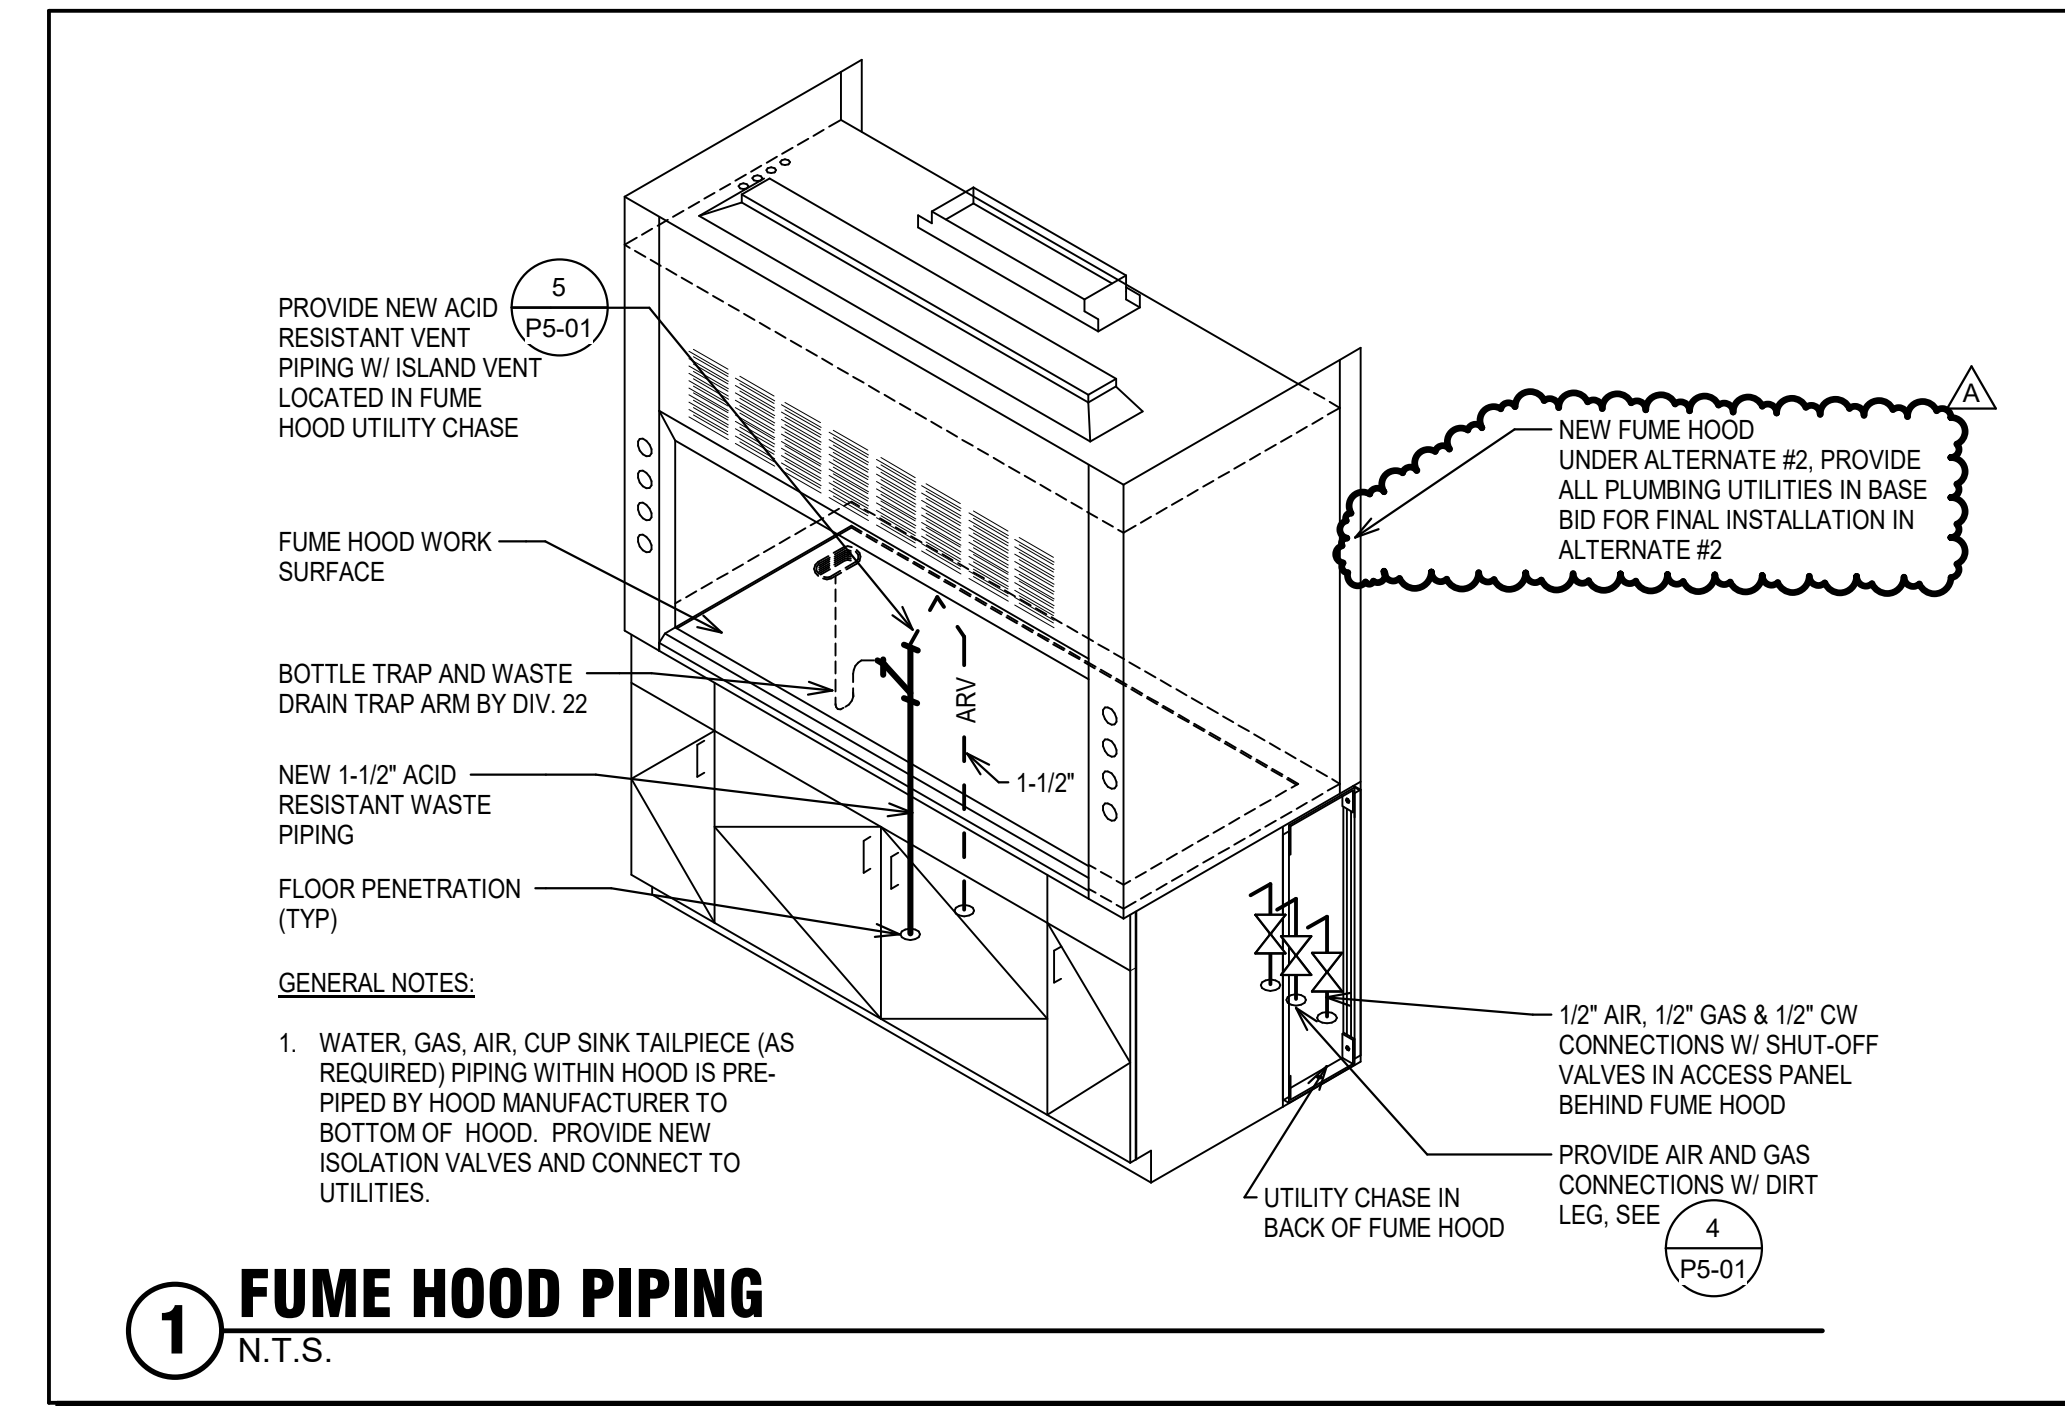

1 FUME HOOD PIPING
N.T.S.

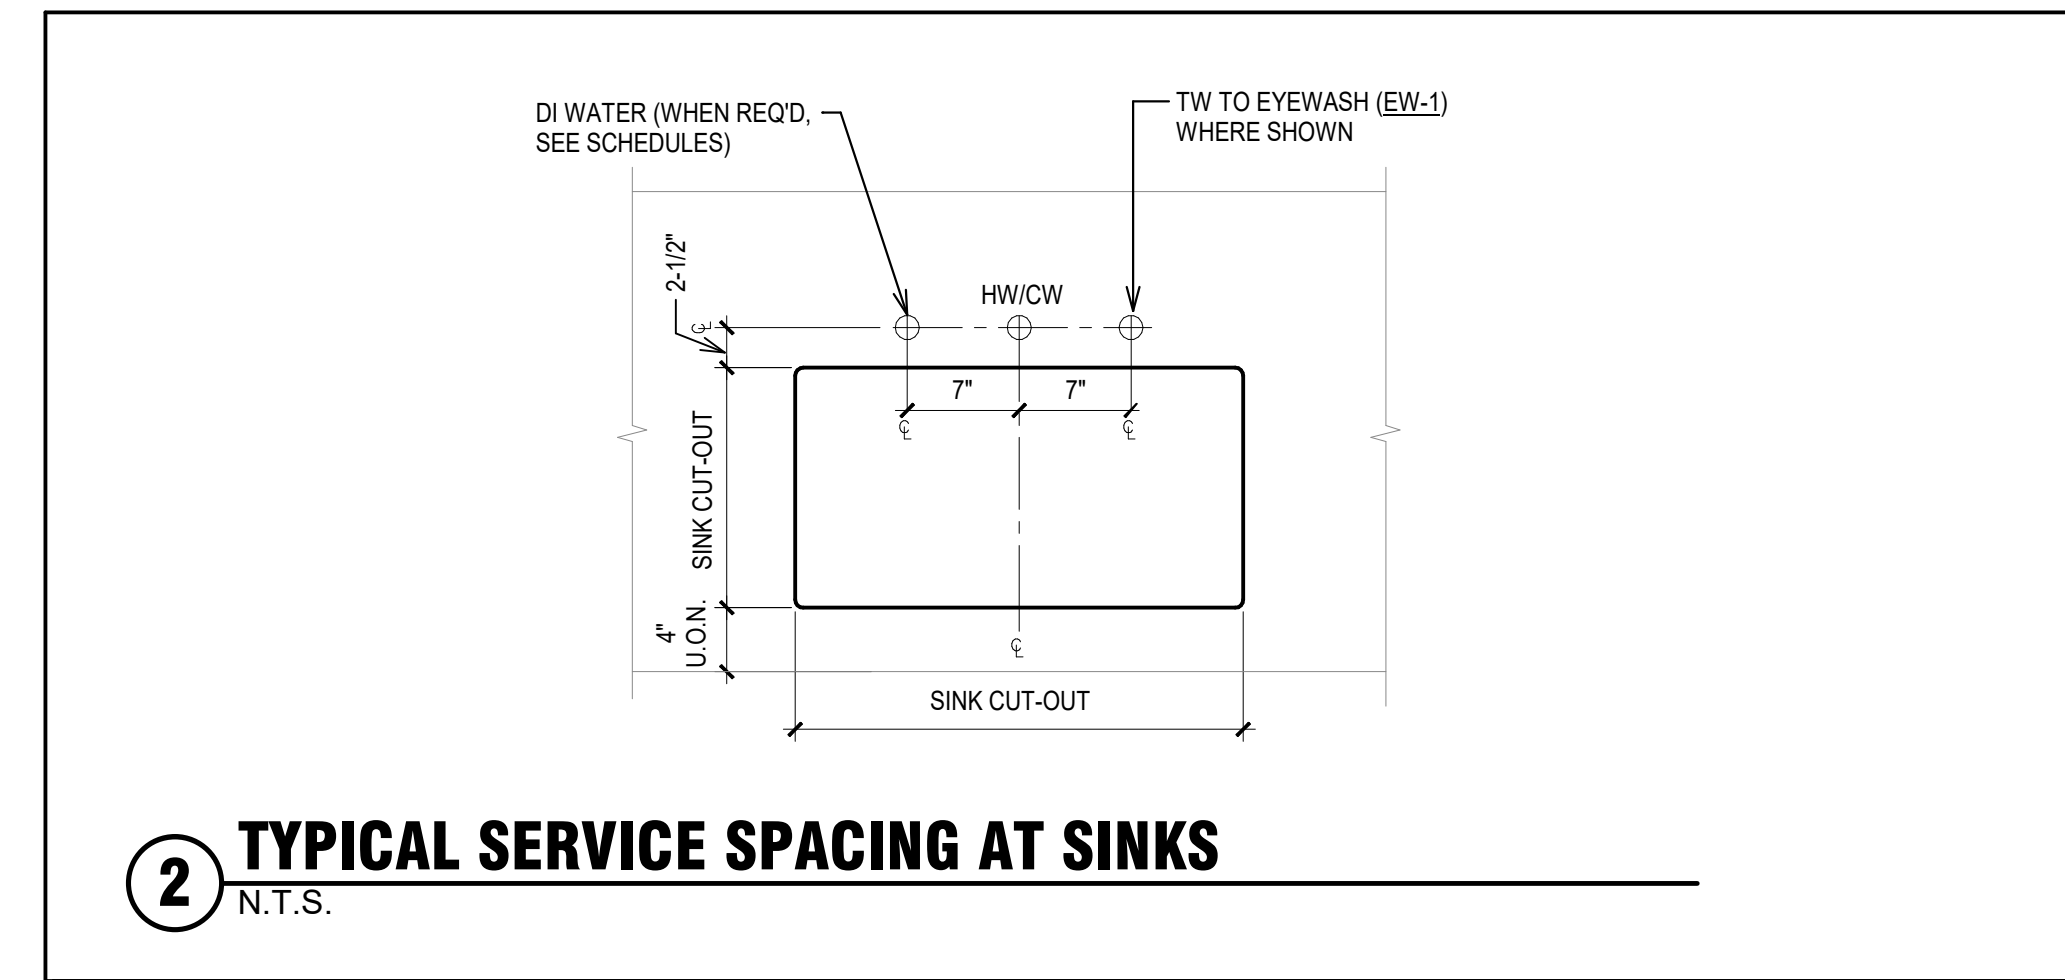

2 TYPICAL SERVICE SPACING AT SINKS
N.T.S.

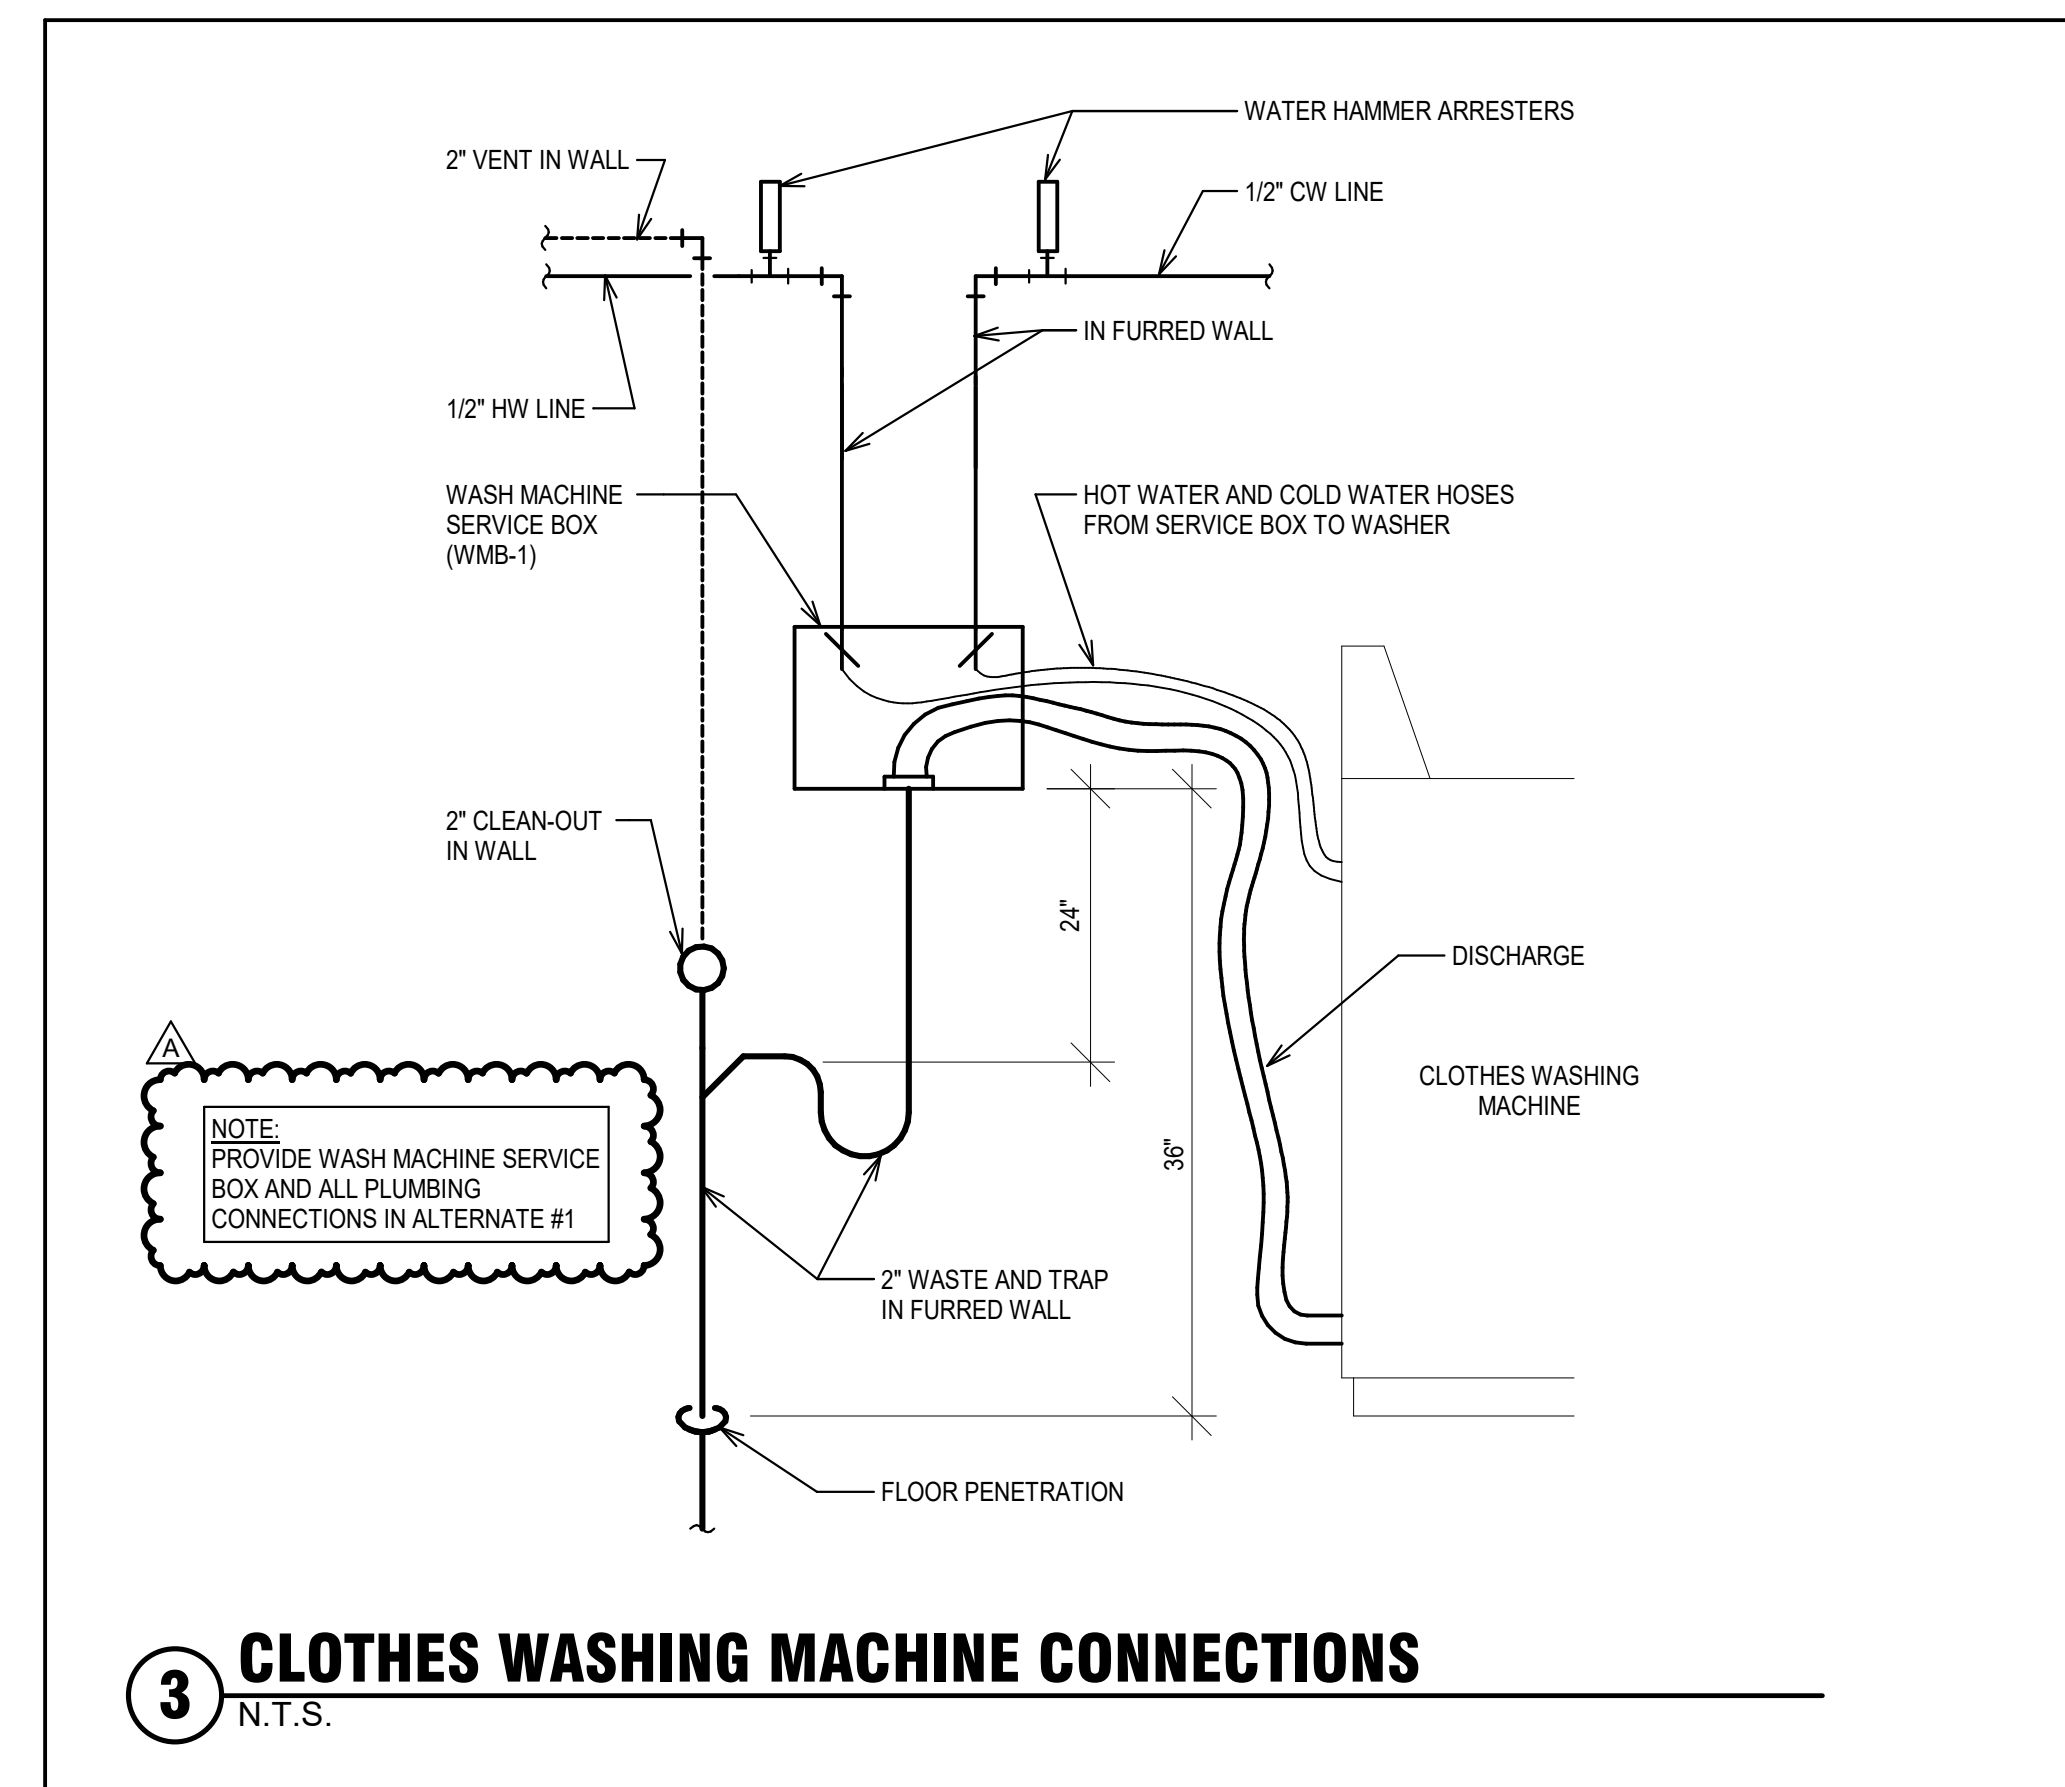

3 CLOTHES WASHING MACHINE CONNECTIONS
N.T.S.




knitstudios.com
THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSES OF CONTRACTING, DESIGNING AND MANAGING THE PROJECT AND AS THE ARCHITECT OF RECORD FOR THE PROJECT RETAINS OWNERSHIP OF THESE DOCUMENTS.



ISSUE DATE: 12.20.2024

REV	DATE	COMMENT
A	1/31/2025	Owner Revisions

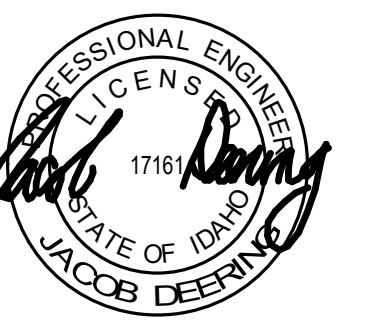

DETAILS - PLUMBING
FOOD RESEARCH CENTER TI - PHASE 1 (BUILDING #: 005)
860 IDAHO AVE., MOSCOW, ID 83844
UNIVERSITY OF IDAHO

TITLE	PROJECT	CLIENT

JOB NO: 240004
CAPITAL PROJECT NO: CP220034

P5-01

PLUMBING FIXTURE SCHEDULE

NOTES:
 1. VERIFY SIZES ON SITE AND COORDINATE INSTALLATION IN EXISTING COUNTERTOP & CASEWORK, SEE DETAIL 2 ON P5-01
 2. PROVIDE NEW BRASSCRAFT STOPS & SUPPLIES (KTSR19X-C)
 3. PROVIDE WITH CHICAGO FAUCETS 131-ABNF THERMOSTATIC MIXING VALVE & TRUEBRO LAV SHIELD #R2202
 4. DI WATER FAUCET: WATERSAVER L694-LH, "LAV GUARD 2 E-Z SERIES" ADA SCALD PROTECTION AND DISHWASHER AIRGAP KIT.

TAG	FIXTURE DESCRIPTION	MANUFACTURER	MODEL	MOUNTING	FIXTURE TYPE	MATERIAL	SIZE	MFR & MODEL # OF FAUCET & VALVE	DRAIN TYPE	TRAP	CARRIER	ACCESSORIES	WASTE	VENT	HW	CW	ARW	ARV	DI WATER	TW	ELECTRICAL REMARKS	SUPPLIES	NOTES
EW-1	EMERGENCY EYEWASH	GUARDIAN	G5022BP-FSH	DECK	DRENCH HOSE	BRASS & NYLON	10-1/8" TALL	INTEGRAL	-	-	-	8 FT. FLEXIBLE ST. STL. HOSE	-	-	-	-	-	-	-	1/2"	-	BRASSCRAFT KTSR19X-C	5 GPM, ROUTE TW FROM MIXING VALVE MV-1
EWSS-1	EMERGENCY EYEWASH & SAFETY SHOWER	ULINE	H-6697	FREE STANDING	SHOWER/EYE WASH COMBO	POWDER COATED STEEL & PLASTIC	94-3/4" TALL	INTEGRAL	-	1-1/2" x 17 GA.	-	-	-	-	-	-	-	-	-	1-1/4"	-	-	25 GPM, ROUTE TW FROM MIXING VALVE MV-1
LV-1	ADA LAVATORY	KOHLER	"GREENWICH" K-2031	WALL	SELF-DRAINING DECK	VITREOUS CHINA	20-3/4"x18-1/4"x12-7/8"	CHICAGO FAUCETS 116.858.AB.1	ELKAY LK174	1-1/2" x 17 GA.	JAY R. SMITH 0710	NOTE 3	2"	1-1/2"	1/2"	1/2"	-	-	-	1/2"	PROVIDE WITH BATTERIES	BRASSCRAFT KTSR19X-C	INSTALL PER ADA REQUIREMENTS UNDER ALTERNATE #1
SK-1	LAB SINK	DURCON	U52	IN EXISTING COUNTERTOP	UNDERMOUNT	EPOXY	23-2/3"x17-2/3"x10-3/4"	WATERSAVER L414	DURCON STRAINER	BOTTLE TRAP SPEARS CPVC DILUTION TANK	-	-	-	1/2"	1/2"	1-1/2"	1-1/2"	-	-	-	-	NOTE 2	NOTE 1
SK-2	LAB SINK	DURCON	U20	IN EXISTING COUNTERTOP	UNDERMOUNT	EPOXY	16"x16"x7-1/2"	WATERSAVER L414	DURCON STRAINER	BOTTLE TRAP SPEARS CPVC DILUTION TANK	-	-	-	1/2"	1/2"	1-1/2"	1-1/2"	-	-	-	-	NOTE 2	NOTE 1
SK-3	LAB SINK	DURCON	U52	IN EXISTING COUNTERTOP	UNDERMOUNT	EPOXY	23-2/3"x17-2/3"x10-3/4"	WATERSAVER L414	DURCON STRAINER	BOTTLE TRAP SPEARS CPVC DILUTION TANK	-	DI WATER FAUCET: WATERSAVER L691-LH	-	-	1/2"	1/2"	1-1/2"	1-1/2"	1/2"	-	-	NOTE 2	NOTE 1, CONNECT DI WATER FAUCET TO ADJACENT WATER PURIFICATION SYSTEM
SK-4	ADA LAB SINK	DURCON	U20	COUNTERTOP	UNDERMOUNT	EPOXY	16"x16"x7-1/2"	WATERSAVER L414-BH	DURCON STRAINER	BOTTLE TRAP SPEARS CPVC DILUTION TANK	-	NOTE 4	-	-	1/2"	1/2"	1-1/2"	1-1/2"	1/2"	-	-	NOTE 2	NOTE 1, INSTALL PER ADA REQUIREMENTS
WMB-1	WASH MACHINE SERVICE BOX	GUY GRAY	MWB13	WALL	RECESSED IN WALL	POWDER COATED STEEL	10-7/8"x8-3/8"	QUARTER TURN VALVES	OPEN HUB	2"x17 GA STANDPIPE	-	-	2"	2"	1/2"	1/2"	-	-	-	-	-	-	SEE DETAIL 3, SHEET P5-01 UNDER ALTERNATE #1

SOLENOID VALVE SCHEDULE

MFR BASIS OF DESIGN: ASCO

SYMBOL	MANUFACTURER	CATALOG NO.	SIZE	OPERATION	SERVICE	ELECTRICAL	NOTES
GSV-1	ASCO	SERIES 8040	1/2"	NORMALLY CLOSED	NAT-GAS (SERVES LAB GAS OUTLETS AS INDICATED ON PLANS)	120V / 60Hz / 15W / 1 AMP	① ② ③

NOTES:
 ① VALVE SHALL BE LINE SIZE
 ② VALVE IS OPEN WHEN ENERGIZED; CLOSED WHEN DE-ENERGIZED
 ③ PROVIDE W/ AMERICAN GAS SAFETY MODEL "AGSEGTW" EMERGENCY GAS SHUT OFF PUSH BUTTON WITH TWIST-RESET

WATER HAMMER ARRESTER SIZING CHART

SYMBOL	FIXTURE UNIT RATING	JAY R. SMITH FIG. NO.	CONNECTION TO SUPPLY PIPE
WHA-1	1-11	5005	3/4"
WHA-2	12-32	5010	1"
WHA-3	33-60	5020	1"

NOTE:
 WATER HAMMER ARRESTERS SHALL BE SIZED AND INSTALLED IN ACCORDANCE WITH MANUFACTURER'S REQUIREMENTS AND IN ACCORDANCE WITH THIS SCHEDULE. INSTALL WATER HAMMER ARRESTERS AT ALL QUICK CLOSING VALVES, SOLENOID VALVES, EACH PLUMBING FIXTURE AND AT EACH BATTERY OF FIXTURES IN DOMESTIC HOT AND COLD WATER SYSTEMS.

LAB EQUIPMENT CONNECTION SCHEDULE

NOTES:
EQUIPMENT NOT IN DIV. 22

TAG	DESCRIPTION	MOUNTING	TRAP	ARW	ARV	HW	CW	GAS	AIR	IW	DI WATER	REMARKS
FH	FUME HOOD	FREE STANDING	BOTTLE TRAP SPEARS CPVC DILUTION TANK	1-1/2"	1-1/2"	-	1/2"	1/2"	1/2"	-	-	SEE DETAIL 1 ON SHEET P5-01
UCFS	UNDERCOUNTER FLASK SCRUBBER	FLOOR	-	-	-	1/2"	-	-	-	3/4"	1/2"	ROUTE IW TO ADJACENT SINK W/ DISHWASHER AIRGAP. PROVIDE SUPPLY HOSE AND STOPS
WPS	WATER PURIFICATION SYSTEM	WALL	-	-	-	-	-	-	-	-	3/4"	-

EMERGENCY MIXING VALVE SCHEDULE

MV-#	MFR	MODEL	CW INLET	HW INLET	BW OUTLET	MOUNTING TYPE	MOUNTING HEIGHT	OUTLET TEMPERATURE	NOTES
EMV-1	GUARDIAN	G6042	3/4"	3/4"	1 1/4"	WALL	6' - 0"	85 °F	EMERGENCY MIXING VALVE FOR EMERGENCY SHOWERS, SEE DETAIL 7, SHEET P5-01


AIR PRESSURE REGULATORS SCHEDULE

TAG	MANUFACTURER	MODEL #	UNIT SIZE (INCHES)	INLET PRESSURE (PSIG)	OUTLET PRESSURE SETTING (PSIG)	REGULATOR CAPACITY (SCFM)	LOAD (SCFM)	NOTES
AR-1	WILKERSON	RB3	1/2"	VERIFY EXISTING	15	14 CFM	1.0	PROVIDE WITH GAUGE



ISSUE DATE: **12.20.2024**


REV DATE COMMENT
 A 1/31/2025 Owner Revisions

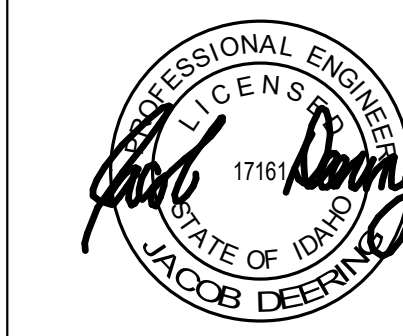

SCHEDULES - PLUMBING
FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE., MOSCOW, ID 83844
UNIVERSITY OF IDAHO


TITLE PROJECT CLIENT
 JOB NO: **240004**
 CAPITAL PROJECT NO: **CP220034**

P6-01

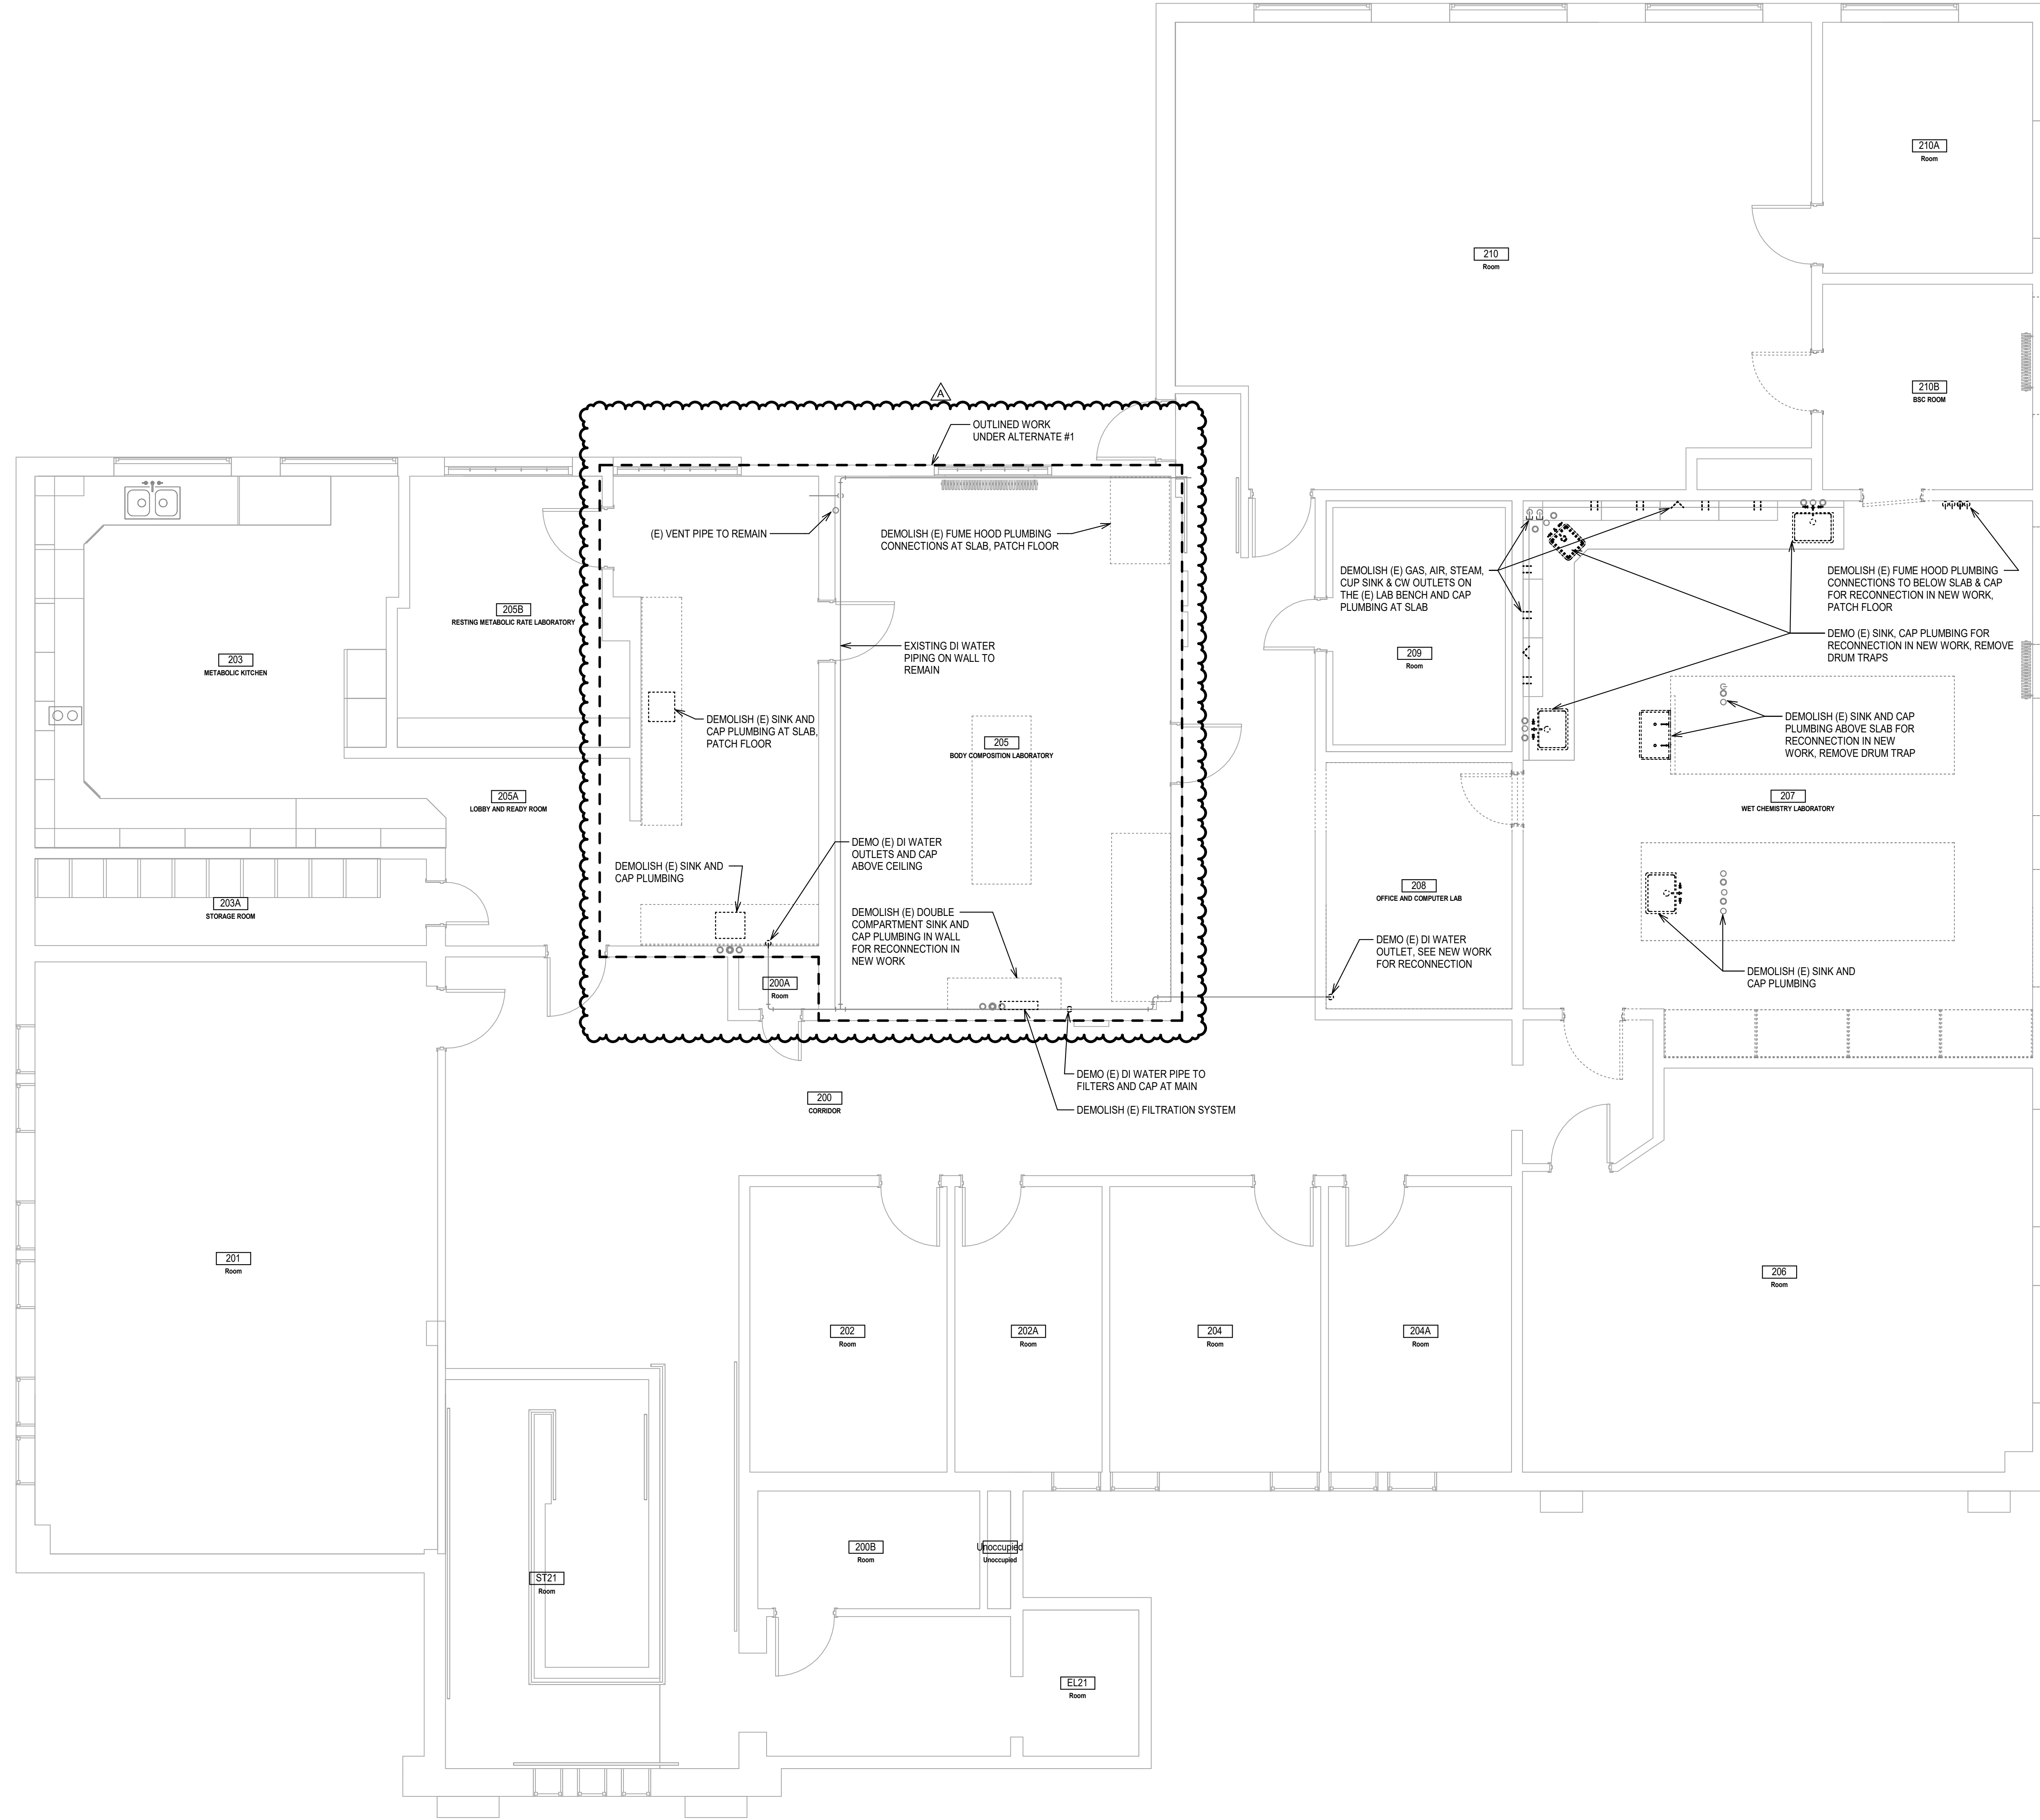


LEVEL 2 - DEMOLITION PLAN - PLUMBING

1/4" = 1'-0"

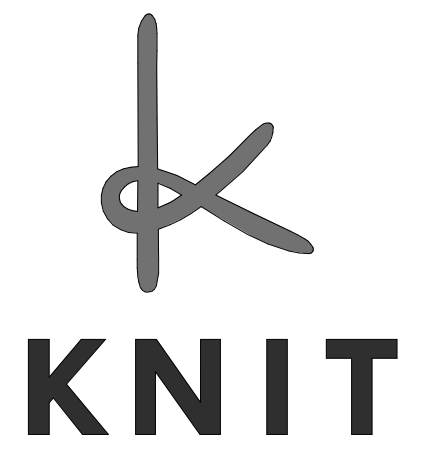


knitstudios.com
 THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSE OF CONTRACTING UNDER AND MAINTAINING THE PROJECT AND AS THE ARCHITECT OF RECORD FOR THE PROJECT RETAINS OWNERSHIP OF THESE DOCUMENTS.
 ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KMIT.
 REPRODUCTION OF THIS DOCUMENT IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KMIT.

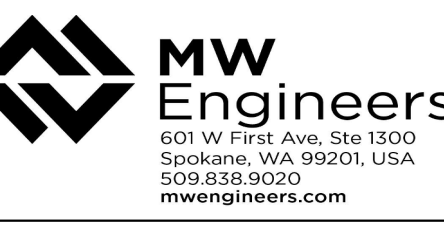

ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT
A	1/31/2025	Owner Revisions

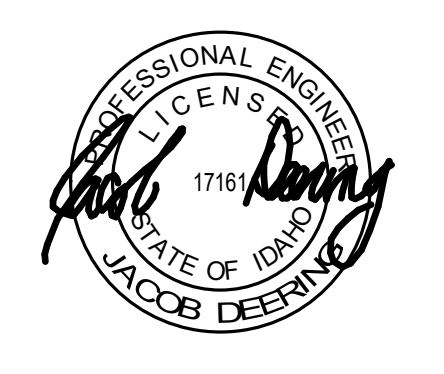

DEMO FLOOR PLAN - PLUMBING
FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE., MOSCOW, ID 83844
UNIVERSITY OF IDAHO


TITLE	PROJECT	CLIENT

JOB NO: **240004**
 CAPITAL PROJECT NO: **CP220034**

PD2-11

ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT

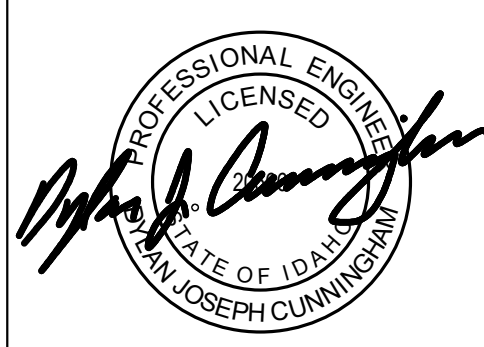

LEGENDS & ABBREVIATIONS - ELECTRICAL
FOOD RESEARCH CENTER TI - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE., MOSCOW, ID 83844
UNIVERSITY OF IDAHO


TITLE	PROJECT	CLIENT

JOB NO: **240004**
 CAPITAL PROJECT NO: **CP220034**

E0-01


SYMBOLS & ABBREVIATIONS

GENERAL SYMBOLS

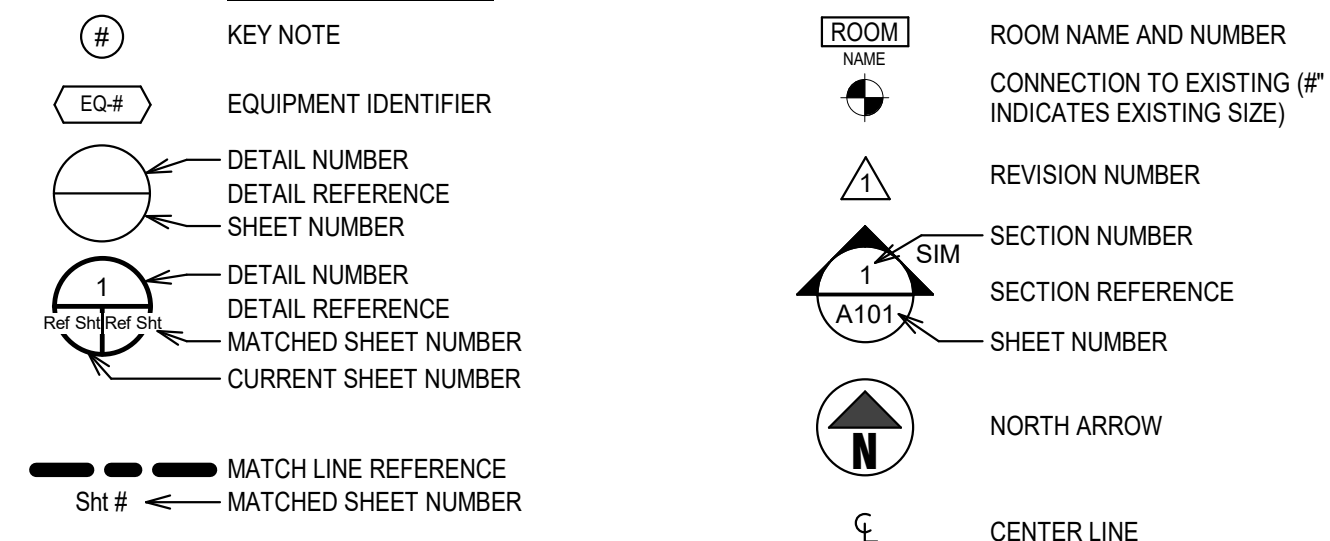

NOTE: SYMBOLS AND ABBREVIATIONS ON THE DRAWINGS SHALL BE INTERPRETED IN ACCORDANCE WITH THE LEGENDS WHEREVER APPLICABLE. NOT ALL SYMBOLS AND ABBREVIATIONS IN THE LEGENDS ARE NECESSARILY USED FOR THE PROJECT. ALL SIZES ARE IN INCHES, UNLESS OTHERWISE NOTED.

LINEWEIGHT LEGEND

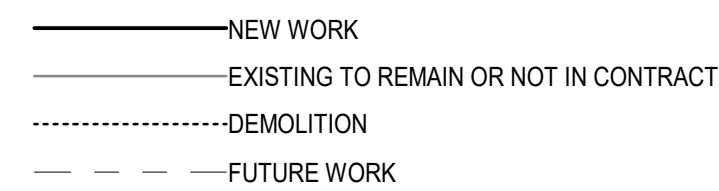


ABBREVIATIONS

Ø	DIAMETER	LSI	INDICATES A BREAKER WITH FULLY ADJUSTABLE LONG TIME, SHORT TIME AND INSTANTANEOUS TRIP CHARACTERISTICS.
ABV	ABOVE	LSIA	INDICATES A BREAKER WITH FULLY ADJUSTABLE LONG TIME, SHORT TIME, INSTANTANEOUS AND GROUND FAULT ALARM TRIP CHARACTERISTICS.
AFG	ABOVE FINISH FLOOR	LSIG	INDICATES A BREAKER WITH FULLY ADJUSTABLE LONG TIME, SHORT TIME, INSTANTANEOUS AND GROUND FAULT TRIP CHARACTERISTICS.
AL	ALUMINUM	MAX	MAXIMUM
AR	AS REQUIRED	MFR	MANUFACTURER
ATS	AUTOMATIC TRANSFER SWITCH	MIN	MINIMUM
BLDG	BUILDING	MMS	MANUAL MOTOR STARTER
C	CIRCUIT	MNT	MOUNT(ED)
CCT	CIRCUIT	(N)	NEW
CKT	CIRCUIT	N	NEUTRAL
CLS	CEILING	NL	NIGHT LIGHT
CO	CONDUIT ONLY WITH 1/4" POLYPROPYLENE PULL ROPE	N.C.	NORMALLY CLOSED
CP	CHROME PLATED	NIC	NOT IN CONTRACT
CT	CURRENT TRANSFORMER	N.O.	NORMALLY OPEN
COPPER	COPPER	NORM	NORMAL
DIA	DIAMETER	LNO	UNLESS NOTED OTHERWISE
DISC	DISCONNECT	PNL	PANEL
DIST	DISTRIBUTION	QIG	QUAD ISOLATED GROUND
DIV	DIVISION	REQ'D	REQUIRED
DWG	DRAWING	RM	ROOM
DX	DUPLEX	SIM	SIMILAR
(E)	EXISTING TO REMAIN	SMR	SURFACE METAL RACEWAY
EA	EACH	SPST	SINGLE POLE/SINGLE THROW SWITCH
EM	EMERGENCY	SS	STAINLESS STEEL
FLR	FLOOR, OR FLOOR MOUNTED	SW	SWITCH
FT	FEET	T	TAMPER PROOF RECEPTACLE
G	GROUND	W	WIDE
GA	GAUGE	W	WITH
GFI	GROUND FAULT INTERRUPT	W/IN	WITHIN
GND	GROUND	W/O	WITHOUT
H	HIGH	WP	WEATHERPROOF. RECEPTACLES TO BE GFI EXISTING DEVICE TO BE REPLACED WITH NEW DEVICE AT SAME LOCATION
HT	HEIGHT	X	EXISTING DEVICE TO BE REPLACED WITH NEW DEVICE AT SAME LOCATION
IG	ISOLATED GROUND	XFMR	TRANSFORMER
IN	INCHES		
L	LONG		
LI	INDICATES A BREAKER WITH FULLY ADJUSTABLE LONG TIME AND INSTANTANEOUS TRIP CHARACTERISTICS		


ANNOTATION

++X* MOUNTING HEIGHT (AFF OR AFG)
 (n/c) = n#b#r#H#R
 n = QUANTITY OF CONDUIT
 x = SIZE OF CONDUIT
 a = QUANTITY OF CONDUCTORS
 b = CONDUCTOR WIRE SIZE
 c = QUANTITY OF GROUND
 d = GROUND WIRE SIZE


SCHEMATIC SYMBOLS

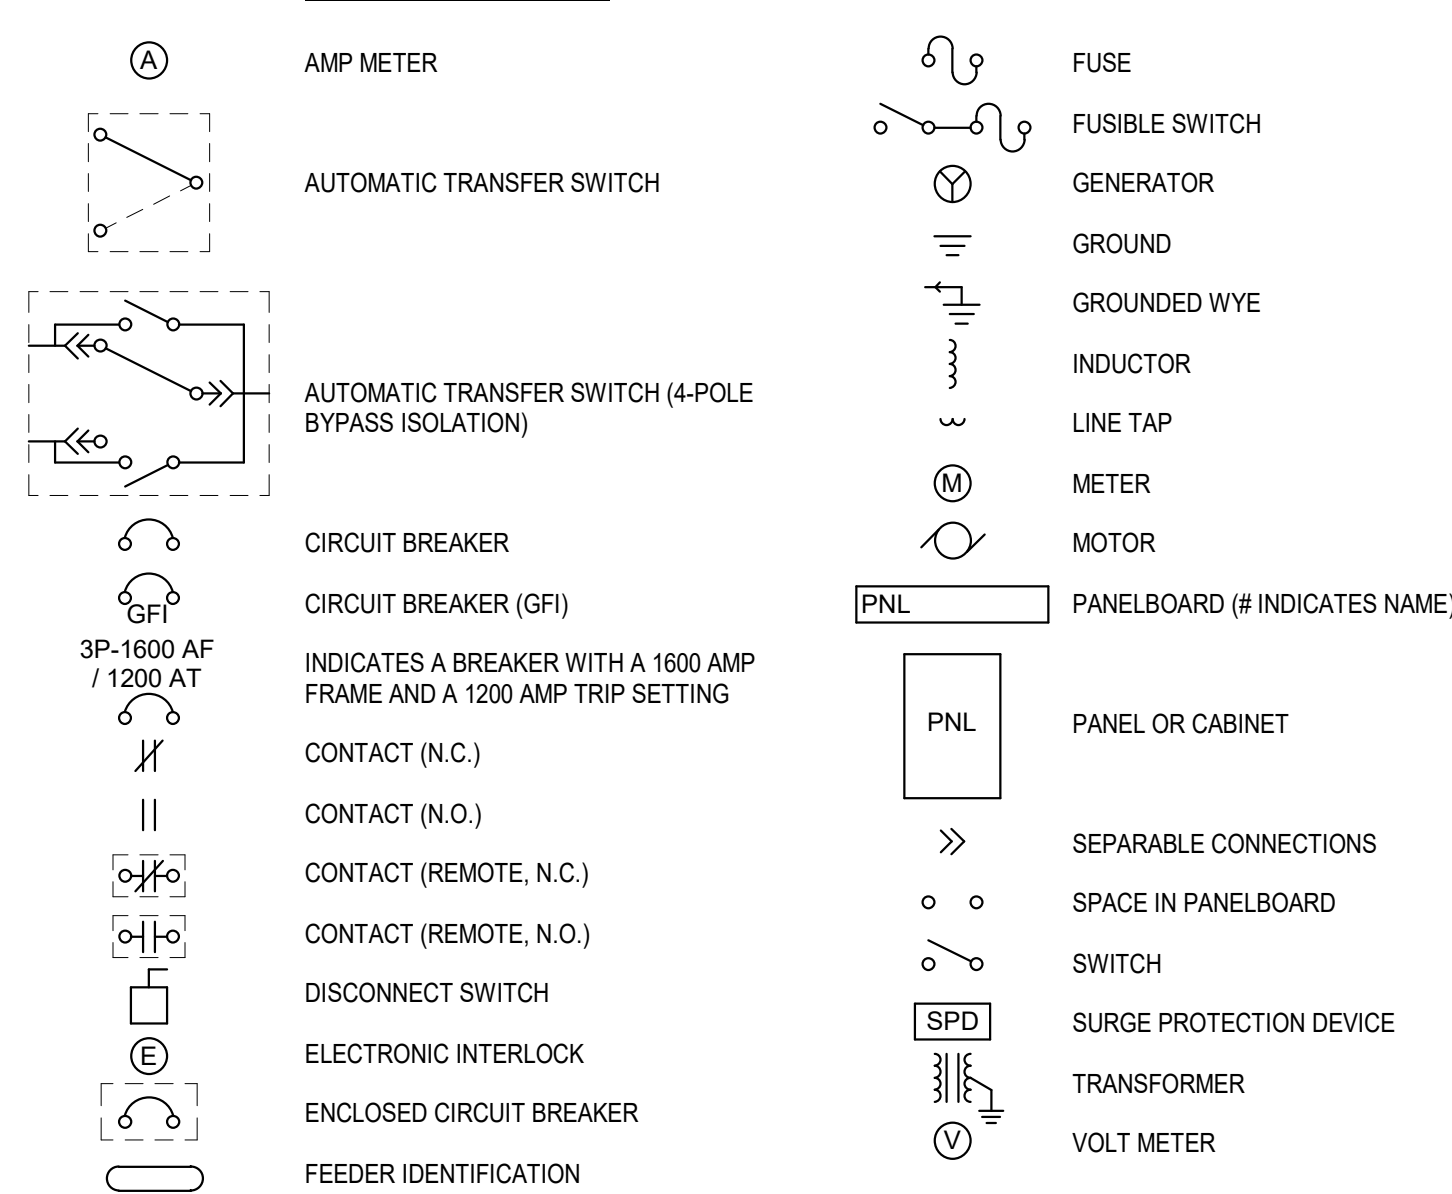


POWER SYMBOLS

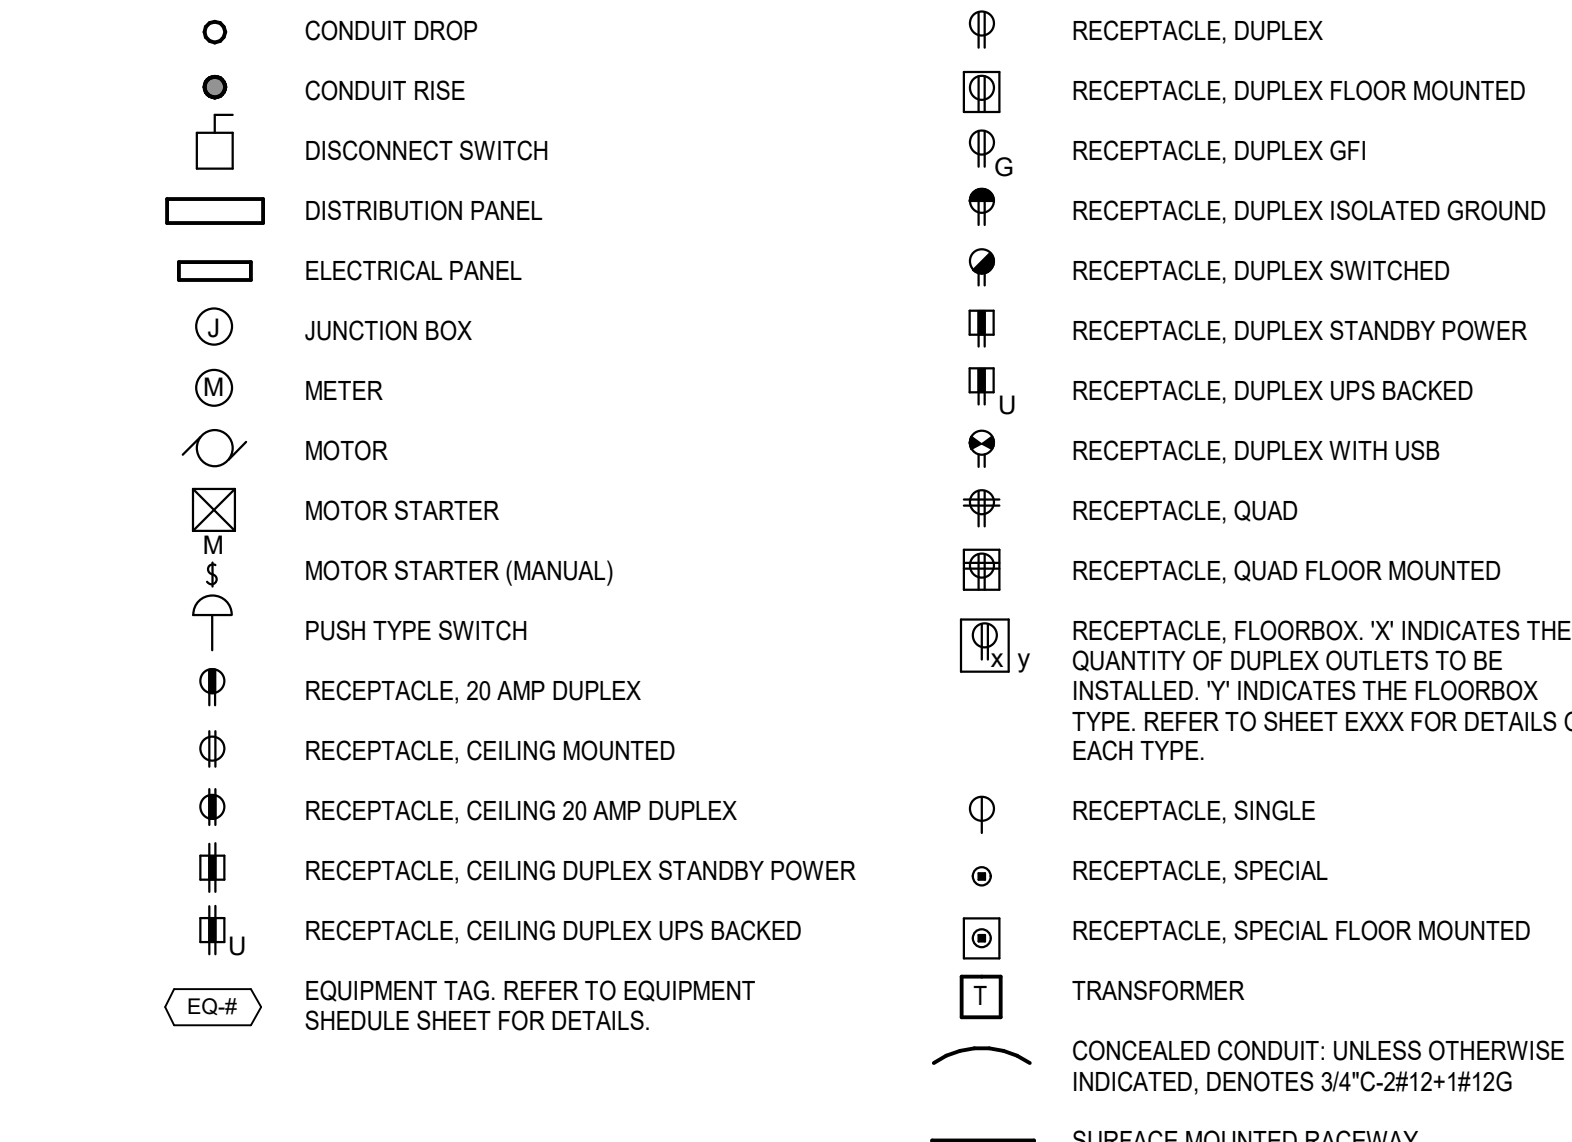


LIGHTING SYMBOLS

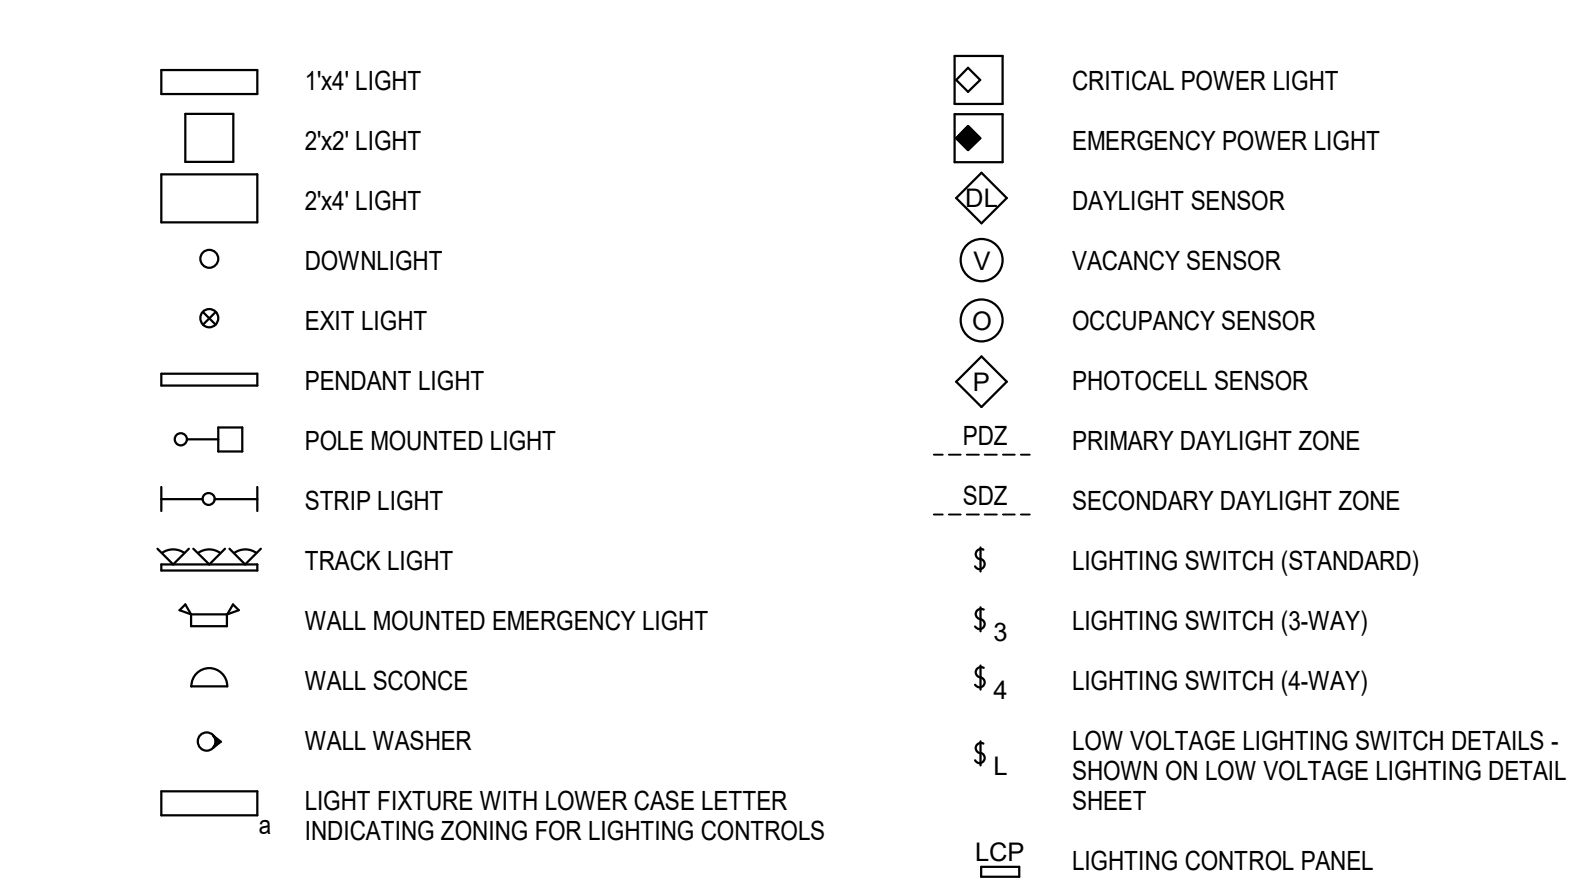

SECURITY SYMBOLS

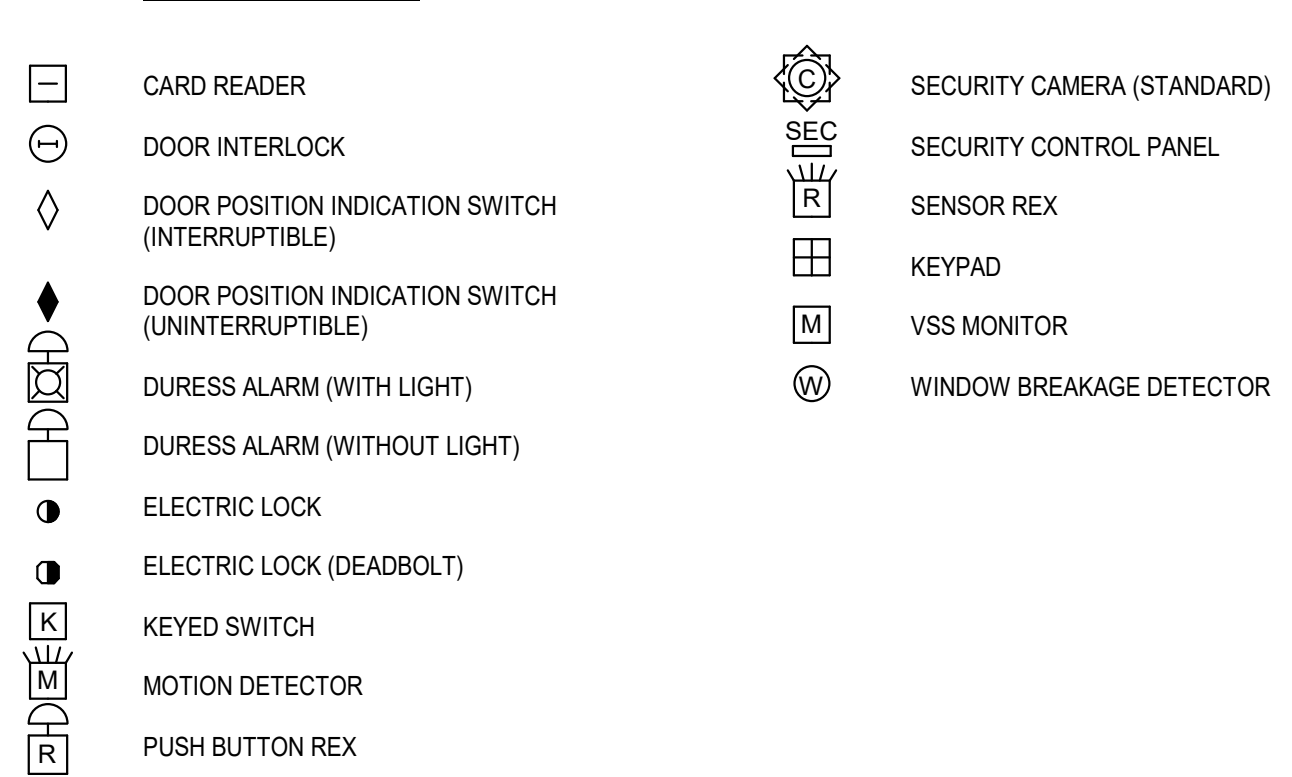

FIRE ALARM SYMBOLS

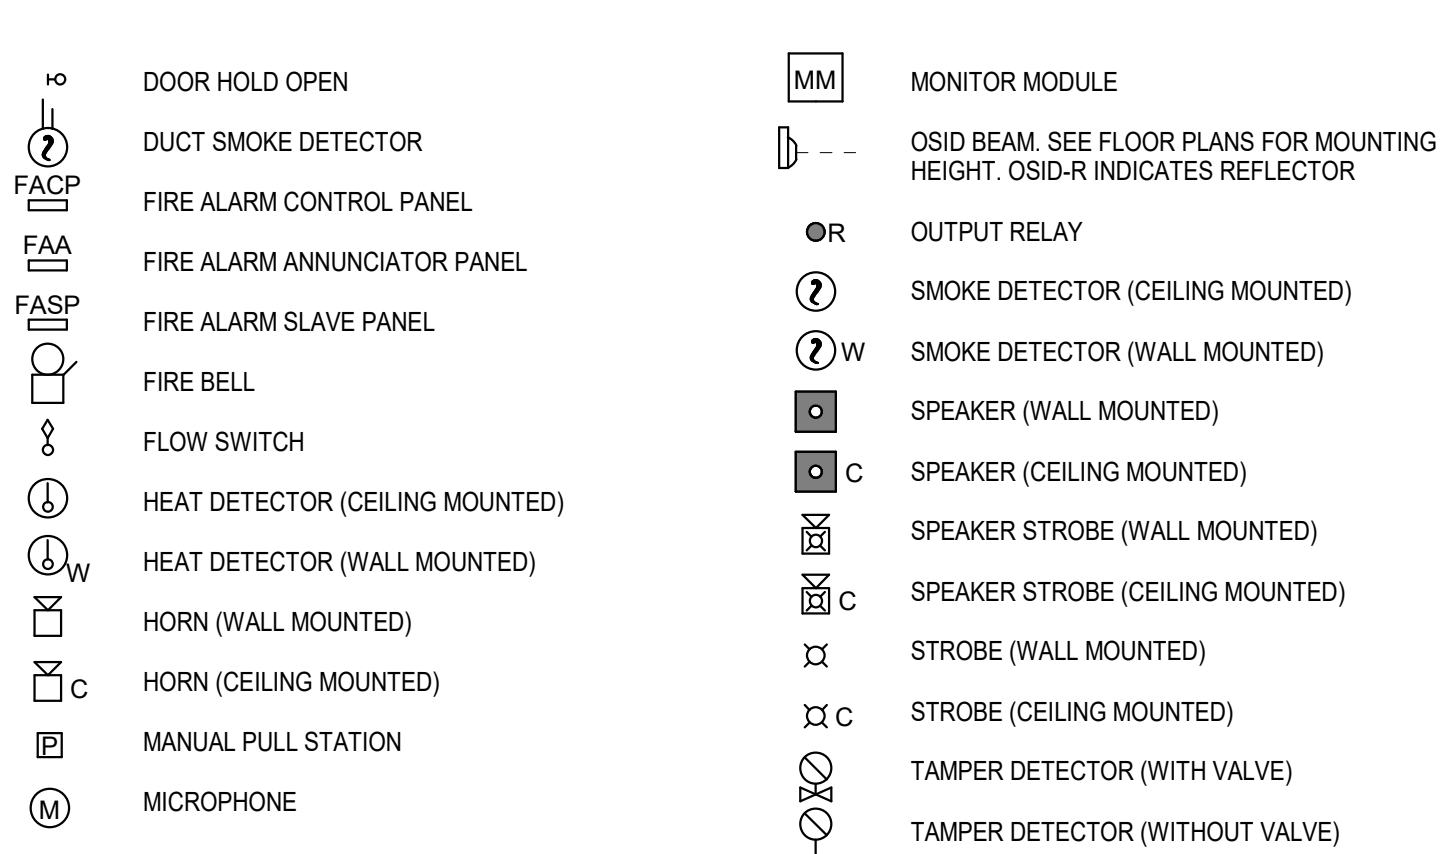

ELECTRICAL SPECIFICATIONS

GENERAL

ELECTRICAL WORK SHALL INCLUDE FURNISHING ALL LABOR, MATERIALS, EQUIPMENT, AND SERVICES TO CONSTRUCT AND INSTALL THE COMPLETE ELECTRICAL SYSTEMS AS SHOWN ON THESE DRAWINGS AND DESCRIBED IN THESE SPECIFICATIONS.

CODES, PERMITS AND FEES

THE INSTALLATION OF THIS WORK SHALL COMPLY IN EVERY WAY WITH THE REQUIREMENTS OF ALL APPLICABLE LAWS, ORDINANCES, AND RULES OF THE STATE OF IDAHO, OSHA, THE NATIONAL BOARD OF FIRE UNDERWRITERS, AND THE NATIONAL ELECTRICAL CODE. IF ANY CONFLICT OCCURS BETWEEN THESE RULES AND THIS SPECIFICATION, THE RULES SHALL GOVERN. NOTHING IN THESE DRAWINGS AND SPECIFICATIONS SHALL BE CONSTRUED TO PERMIT WORK NOT CONFORMING WITH GOVERNING CODES. THIS SHALL NOT BE CONSTRUED AS RELIEVING THE CONTRACTOR FROM COMPLYING WITH REQUIREMENTS OF THE PLANS OR SPECIFICATIONS WHICH MAY BE IN EXCESS OF REQUIREMENTS OF HEREIN BEFORE MENTIONED RULES AND NOT CONTRARY TO SAME. OBTAIN AND PAY FOR ALL REQUIRED STATE AND LOCAL INSTALLATION INSPECTIONS. DELIVER ORIGINALS OF THESE CERTIFICATES IN THE OPERATING AND MAINTENANCE INSTRUCTIONS. ALL MATERIALS SHALL BE UL LISTED AND LABELED.

RACEWAYS AND FITTINGS

RIGID METAL CONDUIT (RMC) AND INTERMEDIATE METALLIC CONDUIT (IMC) HEAVY WALL, GALVANIZED STEEL, SCHEDULE 40, THREADED. FITTINGS SHALL BE THREADED GALVANIZED OR CADMIUM PLATED STEEL. FITTINGS, ELECTRIC METALLIC TUBING (EMT) SHALL BE GALVANIZED TUBING. FITTINGS, STEEL, RAIN TIGHT COMPRESSION TYPE WITH NYLON INSULATED THROATS ON CONNECTORS OUTDOOR OR 2" AND GREATER. STEEL SET SCREW TYPE WITH NYLON INSULATED THROATS ON CONNECTORS UNDER 2" AND INDOOR. FLEXIBLE METAL CONDUIT SHALL BE FLEXIBLE, INTERLOCKED, GALVANIZED STEEL CONSTRUCTION, SPIRAL STRIP. FITTINGS AND CONDUIT BODIES ANSINEMA FB 1, ALL STEEL, GALVANIZED, COMPRESSION TYPE, SPECIFICALLY DESIGNED FOR THE PURPOSE. LIQUID TIGHT FLEXIBLE CONDUIT SHALL BE FLEXIBLE, INTERLOCKED, GALVANIZED STEEL, SPIRAL STRIP WITH AN OUTER LIQUID TIGHT, NON-METALLIC, SUNLIGHT-RESISTANT JACKET. FITTINGS, PLASTIC CONDUIT SHALL BE SCHEDULE 40 PVC MINIMUM, LISTED, SUNLIGHT RESISTANT, RATED FOR 90 DEGREES C CONDUCTORS.

ELECTRICAL BOXES

SHEET METAL OUTLET BOXES: GALVANIZED STEEL, WITH 3/8" MALE FIXTURE STUDS WHERE REQUIRED. LUMINAIRE AND EQUIPMENT SUPPORTING BOXES: RATED FOR WEIGHT FOR EQUIPMENT SUPPORTED.

PULL AND JUNCTION BOXES

OUTLET, PULL BOXES AND JUNCTION BOXES SHALL BE GALVANIZED STEEL, MINIMUM 4 INCH SQUARE BY 2 1/8" INCHES DEEP FOR USE WITH 1 INCH CONDUIT AND SMALLER, ON CONDUIT SYSTEMS USING 1 1/4" OR LARGER, PULL AND JUNCTION BOXES SHALL BE SIZED PER NEC BUT NOT LESS THAN 4 1/16" SQUARE. OUTLET BOXES OUTDOORS SHALL BE CAST METAL WITH THREADED STUDS. PROVIDE DEVICE RINGS, SIZE AS REQUIRED. FOR TELECOMMUNICATION, SECURITY, AND OTHER LOW VOLTAGE CABLE INSTALLATIONS, THE BOXES SHALL BE A 4 1/16" SQUARE BOX WITH SINGLE GANG MUDDING AND BLANK COVERPLATE.

WIRE AND CABLE

SINGLE CONDUCTOR, TYPE THHN/THWN OR XHHW INSULATION, RATED 600 VOLTS, SPLIT BOLT CONNECTORS ARE NOT ACCEPTABLE. NO CONDUCTOR LESS THAN 10 AWG SHALL BE INSTALLED IN EXTERIOR UNDERGROUND CONDUIT. ALL CONDUCTORS #1 AND SMALLER SHALL BE COPPER.

METAL-CLAD CABLE

METAL-CLAD CABLE SHALL BE TYPE MC PRE-MANUFACTURED CABLE ASSEMBLIES CONSISTING OF COLOR-CODED PHASE, NEUTRAL, AND GROUND CONDUCTORS BOUND TOGETHER WITH AN OUTER COVERING OF METAL CLADDING. METAL-CLAD CABLE INSTALLED IN PATIENT VICINITY SHALL BE HEALTHCARE GRADE WITH REDUNDANT EQUIPMENT GROUND CONDUCTOR.

DEVICES

HUBBELL, PASS AND SEYMOUR, BRYANT, LEVITON, OR APPROVED EQUAL. ALL WIRING DEVICES SHALL COMPLY WITH NEMA STANDARD WD-1, "HEAVY DUTY WIRING DEVICES" AND UL 20 STANDARDS. COLOR SHALL BE IVORY.
 A. 15A DUPLEX RECEPTACLE: HUBBELL 5202
 B. 20A DUPLEX RECEPTACLE: HUBBELL 5352
 C. GFCI RECEPTACLE: HUBBELL GF-3252
 D. SINGLE POLE SWITCH: HUBBELL 1221.

INSTALL WALL SWITCHES 48" TO CENTER ABOVE FLOOR. INSTALL CONVENIENCE RECEPTACLES 48" ABOVE FLOOR TO CENTER, 6" TO CENTER. INSTALL WITH GROUNDING PIN UP.

WALL PLATES

INDOOR DEVICES SHALL HAVE RAISED INDUSTRIAL COVERPLATES. OUTDOOR DEVICES SHALL HAVE GASKETED CAST METAL HINGED COVER.

SUPPORTING STRUCTURES

STEEL CHANNEL SUPPORTS: GALVANIZED OR PAINTED STEEL. DESIGN SUPPORTS TO CARRY WEIGHT OF EQUIPMENT AND CONDUIT, INCLUDE WIRING.

GROUNDING

PROVIDE AN INSULATED THROAT BUSHING ON THE CONDUIT PASSING THRU EACH METAL ENCLOSURE. PROVIDE A BONDING JUMPER CONNECTING THE BUSHING TO THE GROUND BUS AND METAL FRAME OF THE EQUIPMENT. PROVIDE COPPER EQUIPMENT GROUNDING TERMINAL BAR IN ALL NEW PANELBOARDS. WHERE GROUNDING CONDUCTORS TERMINATE, BOND TO THE GROUNDING BUSHING ON THE CONDUIT FEEDING THE PANELBOARD.

ELECTRICAL DISTRIBUTION EQUIPMENT

PANELBOARDS, ENCLOSED SWITCHES AND MOTOR CONTROLLERS SHALL BE MANUFACTURED IN ACCORDANCE WITH APPLICABLE UL STANDARD. MANUFACTURERS: SQUARE D

DEMOLITION

INACTIVE AND ABANDONED WIRE AND CABLE, INCLUDING DISCONNECTED CIRCUITS FROM WHICH ALL TERMINAL DEVICES HAVE BEEN ELIMINATED, SHALL BE REMOVED BACK TO THE SOURCE OF SUPPLY. ABANDONED RACEWAY SHALL BE REMOVED. COORDINATE DEMOLITION WITH THE WORK OF OTHER TRADES. MATERIALS REMOVED DURING THE DEMOLITION PHASE OF THE WORK SHALL BE STORED OR PROPERLY DISPOSED OF AS DIRECTED BY THE OWNER. PERFORM CUTTING, DRILLING AND PATCHING REQUIRED TO PERFORM THE WORK. PATCHING MATERIALS SHALL MATCH THE EXISTING MATERIALS.

LIGHTING

AS INDICATED IN THE LIGHTING FIXTURE SCHEDULE, SECURELY MOUNT ALL FIXTURES. PROVIDE ALL ADDITIONAL HANGERS AND SUPPORTING BRACKETS AS NECESSARY TO SECURELY FASTEN AND SUPPORT FIXTURES. DRIVERS SHALL BE AS RECOMMENDED BY THE FIXTURE MANUFACTURER. DRIVERS FOR LED FIXTURES SHALL BE LESS THAN 10% THD, UNLESS OTHERWISE NOTED. LED DRIVER SHALL BE DIMMABLE FROM 100% TO 1% WITH 0-10 VDC CONTROL WITHOUT FLICKER.

LIGHTING CONTROLS

LIGHTING CONTROLS SYSTEM SHALL CONSIST OF LOCAL CONTROL STATIONS, OCCUPANCY SENSOR, DAYLIGHT SENSORS, AND INTERFACING DEVICES FOR A COMPLETE AND FULLY OPERATIONAL SYSTEM CONFORMING TO THE REQUIREMENTS OF THE APPLICABLE ENERGY CODE. LIGHTING CONTROL MANUFACTURER SHALL BE: ILLIGHT, OCCUPANCY SENSOR: hCM SERIES, PHOTOCELL SENSOR: hCM SERIES

FIRE ALARM

FIRE ALARM PRODUCTS SHALL MATCH EXISTING BUILDING DEVICES AND SHALL BE AN EXTENSION OF THE EXISTING BUILDING SYSTEM. EXISTING BUILDING SYSTEM IS SILENT KNIGHT.

TELECOM

COMMUNICATION DEVICES SHALL BE INSTALLED ACCORDING TO THE LATEST VERSION OF THE U/I O/T STANDARDS. COMMUNICATION CABLING TO BE INSTALLED ACCORDING TO U/I STRUCTURED CABLING STANDARD.

ELECTRICAL SPECIFICATIONS

GENERAL

ELECTRICAL WORK SHALL INCLUDE FURNISHING ALL LABOR, MATERIALS, EQUIPMENT, AND SERVICES TO CONSTRUCT AND INSTALL THE COMPLETE ELECTRICAL SYSTEMS AS SHOWN ON THESE DRAWINGS AND DESCRIBED IN THESE SPECIFICATIONS.

CODES, PERMITS AND FEES

THE INSTALLATION OF THIS WORK SHALL COMPLY IN EVERY WAY WITH THE REQUIREMENTS OF ALL APPLICABLE LAWS, ORDINANCES, AND RULES OF THE STATE OF IDAHO, OSHA, THE NATIONAL BOARD OF FIRE UNDERWRITERS, AND THE NATIONAL ELECTRICAL CODE. IF ANY CONFLICT OCCURS BETWEEN THESE RULES AND THIS SPECIFICATION, THE RULES SHALL GOVERN. NOTHING IN THESE DRAWINGS AND SPECIFICATIONS SHALL BE CONSTRUED TO PERMIT WORK NOT CONFORMING WITH GOVERNING CODES. THIS SHALL NOT BE CONSTRUED AS RELIEVING THE CONTRACTOR FROM COMPLYING WITH REQUIREMENTS OF THE PLANS OR SPECIFICATIONS WHICH MAY BE IN EXCESS OF REQUIREMENTS OF HEREIN BEFORE MENTIONED RULES AND NOT CONTRARY TO SAME. OBTAIN AND PAY FOR ALL REQUIRED STATE AND LOCAL INSTALLATION INSPECTIONS. DELIVER ORIGINALS OF THESE CERTIFICATES IN THE OPERATING AND MAINTENANCE INSTRUCTIONS. ALL MATERIALS SHALL BE UL LISTED AND LABELED.

RACEWAYS AND FITTINGS

RIGID METAL CONDUIT (RMC) AND INTERMEDIATE METALLIC CONDUIT (IMC) HEAVY WALL, GALVANIZED STEEL, SCHEDULE 40, THREADED. FITTINGS SHALL BE THREADED GALVANIZED OR CADMIUM PLATED STEEL. FITTINGS, ELECTRIC METALLIC TUBING (EMT) SHALL BE GALVANIZED TUBING. FITTINGS, STEEL, RAIN TIGHT COMPRESSION TYPE WITH NYLON INSULATED THROATS ON CONNECTORS OUTDOOR OR 2" AND GREATER. STEEL SET SCREW TYPE WITH NYLON INSULATED THROATS ON CONNECTORS UNDER 2" AND INDOOR. FLEXIBLE METAL CONDUIT SHALL BE FLEXIBLE, INTERLOCKED, GALVANIZED STEEL CONSTRUCTION, SPIRAL STRIP. FITTINGS AND CONDUIT BODIES ANSINEMA FB 1, ALL STEEL, GALVANIZED, COMPRESSION TYPE, SPECIFICALLY DESIGNED FOR THE PURPOSE. LIQUID TIGHT FLEXIBLE CONDUIT SHALL BE FLEXIBLE, INTERLOCKED, GALVANIZED STEEL, SPIRAL STRIP WITH AN OUTER LIQUID TIGHT, NON-METALLIC, SUNLIGHT-RESISTANT JACKET. FITTINGS, PLASTIC CONDUIT SHALL BE SCHEDULE 40 PVC MINIMUM, LISTED, SUNLIGHT RESISTANT, RATED FOR 90 DEGREES C CONDUCTORS.

ELECTRICAL BOXES

SHEET METAL OUTLET BOXES: GALVANIZED STEEL, WITH 3/8" MALE FIXTURE STUDS WHERE REQUIRED. LUMINAIRE AND EQUIPMENT SUPPORTING BOXES: RATED FOR WEIGHT FOR EQUIPMENT SUPPORTED.

PULL AND JUNCTION BOXES

OUTLET, PULL BOXES AND JUNCTION BOXES SHALL BE GALVANIZED STEEL, MINIMUM 4 INCH SQUARE BY 2 1/8" INCHES DEEP FOR USE WITH 1 INCH CONDUIT AND SMALLER, ON CONDUIT SYSTEMS USING 1 1/4" OR LARGER, PULL AND JUNCTION BOXES SHALL BE SIZED PER NEC BUT NOT LESS THAN 4 1/16" SQUARE. OUTLET BOXES OUTDOORS SHALL BE CAST METAL WITH THREADED STUDS. PROVIDE DEVICE RINGS, SIZE AS REQUIRED. FOR TELECOMMUNICATION, SECURITY, AND OTHER LOW VOLTAGE CABLE INSTALLATIONS, THE BOXES SHALL BE A 4 1/16" SQUARE BOX WITH SINGLE GANG MUDDING AND BLANK COVERPLATE.

WIRE AND CABLE

SINGLE CONDUCTOR, TYPE THHN/THWN OR XHHW INSULATION, RATED 600 VOLTS, SPLIT BOLT CONNECTORS ARE NOT ACCEPTABLE. NO CONDUCTOR LESS THAN 10 AWG SHALL BE INSTALLED IN EXTERIOR UNDERGROUND CONDUIT. ALL CONDUCTORS #1 AND SMALLER SHALL BE COPPER.

METAL-CLAD CABLE

METAL-CLAD CABLE SHALL BE TYPE MC PRE-MANUFACTURED CABLE ASSEMBLIES CONSISTING OF COLOR-CODED PHASE, NEUTRAL, AND GROUND CONDUCTORS BOUND TOGETHER WITH AN OUTER COVERING OF METAL CLADDING. METAL-CLAD CABLE INSTALLED IN PATIENT VICINITY SHALL BE HEALTHCARE GRADE WITH REDUNDANT EQUIPMENT GROUND CONDUCTOR.

DEVICES

HUBBELL, PASS AND SEYMOUR, BRYANT, LEVITON, OR APPROVED EQUAL. ALL WIRING DEVICES SHALL COMPLY WITH NEMA STANDARD WD-1, "HEAVY DUTY WIRING DEVICES" AND UL 20 STANDARDS. COLOR SHALL BE IVORY.
 A. 15A DUPLEX RECEPTACLE: HUBBELL 5202
 B. 20A DUPLEX RECEPTACLE: HUBBELL 5352
 C. GFCI RECEPTACLE: HUBBELL GF-3252
 D. SINGLE POLE SWITCH: HUBBELL 1221.

INSTALL WALL SWITCHES 48" TO CENTER ABOVE FLOOR. INSTALL CONVENIENCE RECEPTACLES 48" ABOVE FLOOR TO CENTER, 6" TO CENTER. INSTALL WITH GROUNDING PIN UP.

WALL PLATES

INDOOR DEVICES SHALL HAVE RAISED INDUSTRIAL COVERPLATES. OUTDOOR DEVICES SHALL HAVE GASKETED CAST METAL HINGED COVER.

SUPPORTING STRUCTURES

STEEL CHANNEL SUPPORTS: GALVANIZED OR PAINTED STEEL. DESIGN SUPPORTS TO CARRY WEIGHT OF EQUIPMENT AND CONDUIT, INCLUDE WIRING.

GROUNDING

PROVIDE AN INSULATED THROAT BUSHING ON THE CONDUIT PASSING THRU EACH METAL ENCLOSURE. PROVIDE A BONDING JUMPER CONNECTING THE BUSHING TO THE GROUND BUS AND METAL FRAME OF THE EQUIPMENT. PROVIDE COPPER EQUIPMENT GROUNDING TERMINAL BAR IN ALL NEW PANELBOARDS. WHERE GROUNDING CONDUCTORS TERMINATE, BOND TO THE GROUNDING BUSHING ON THE CONDUIT FEEDING THE PANELBOARD.

ELECTRICAL DISTRIBUTION EQUIPMENT

PANELBOARDS, ENCLOSED SWITCHES AND MOTOR CONTROLLERS SHALL BE MANUFACTURED IN ACCORDANCE WITH APPLICABLE UL STANDARD. MANUFACTURERS: SQUARE D

DEMOLITION

INACTIVE AND ABANDONED WIRE AND CABLE, INCLUDING DISCONNECTED CIRCUITS FROM WHICH ALL TERMINAL DEVICES HAVE BEEN ELIMINATED, SHALL BE REMOVED BACK TO THE SOURCE OF SUPPLY. ABANDONED RACEWAY SHALL BE REMOVED. COORDINATE DEMOLITION WITH THE WORK OF OTHER TRADES. MATERIALS REMOVED DURING THE DEMOLITION PHASE OF THE WORK SHALL BE STORED OR PROPERLY DISPOSED OF AS DIRECTED BY THE OWNER. PERFORM CUTTING, DRILLING AND PATCHING REQUIRED TO PERFORM THE WORK. PATCHING MATERIALS SHALL MATCH THE EXISTING MATERIALS.

LIGHTING

AS INDICATED IN THE LIGHTING FIXTURE SCHEDULE, SECURELY MOUNT ALL FIXTURES. PROVIDE ALL ADDITIONAL HANGERS AND SUPPORTING BRACKETS AS NECESSARY TO SECURELY FASTEN AND SUPPORT FIXTURES. DRIVERS SHALL BE AS RECOMMENDED BY THE FIXTURE MANUFACTURER. DRIVERS FOR LED FIXTURES SHALL BE LESS THAN 10% THD, UNLESS OTHERWISE NOTED. LED DRIVER SHALL BE DIMMABLE FROM 100% TO 1% WITH 0-10 VDC CONTROL WITHOUT FLICKER.

LIGHTING CONTROLS

LIGHTING CONTROLS SYSTEM SHALL CONSIST OF LOCAL CONTROL STATIONS, OCCUPANCY SENSOR, DAYLIGHT SENSORS, AND INTERFACING DEVICES FOR A COMPLETE AND FULLY OPERATIONAL SYSTEM CONFORMING TO THE REQUIREMENTS OF THE APPLICABLE ENERGY CODE. LIGHTING CONTROL MANUFACTURER SHALL BE: ILLIGHT, OCCUPANCY SENSOR: hCM SERIES, PHOTOCELL SENSOR: hCM SERIES

FIRE ALARM

FIRE ALARM PRODUCTS SHALL MATCH EXISTING BUILDING DEVICES AND SHALL BE AN EXTENSION OF THE EXISTING BUILDING SYSTEM. EXISTING BUILDING SYSTEM IS SILENT KNIGHT.

TELECOM


COMMUNICATION DEVICES SHALL BE INSTALLED ACCORDING TO THE LATEST VERSION OF THE U/I O/T STANDARDS. COMMUNICATION CABLING TO BE INSTALLED ACCORDING TO U/I STRUCTURED CABLING STANDARD.

GENERAL NOTES:


1. FIELD VERIFY EXISTING CONDITIONS PRIOR TO COMMENCING WORK
2. LAB RECEPTACLES ARE TO BE GFCI PROTECTED. SEE PANEL SCHEDULES FOR MORE DETAILS.

KEYNOTES:

1. PROPOSED ROUTING OF FEEDER CONDUIT FOR RTU-1 TO PANEL M
2. ISLAND RECEPTACLES FEED FROM LEVEL 1 CEILING BELOW.

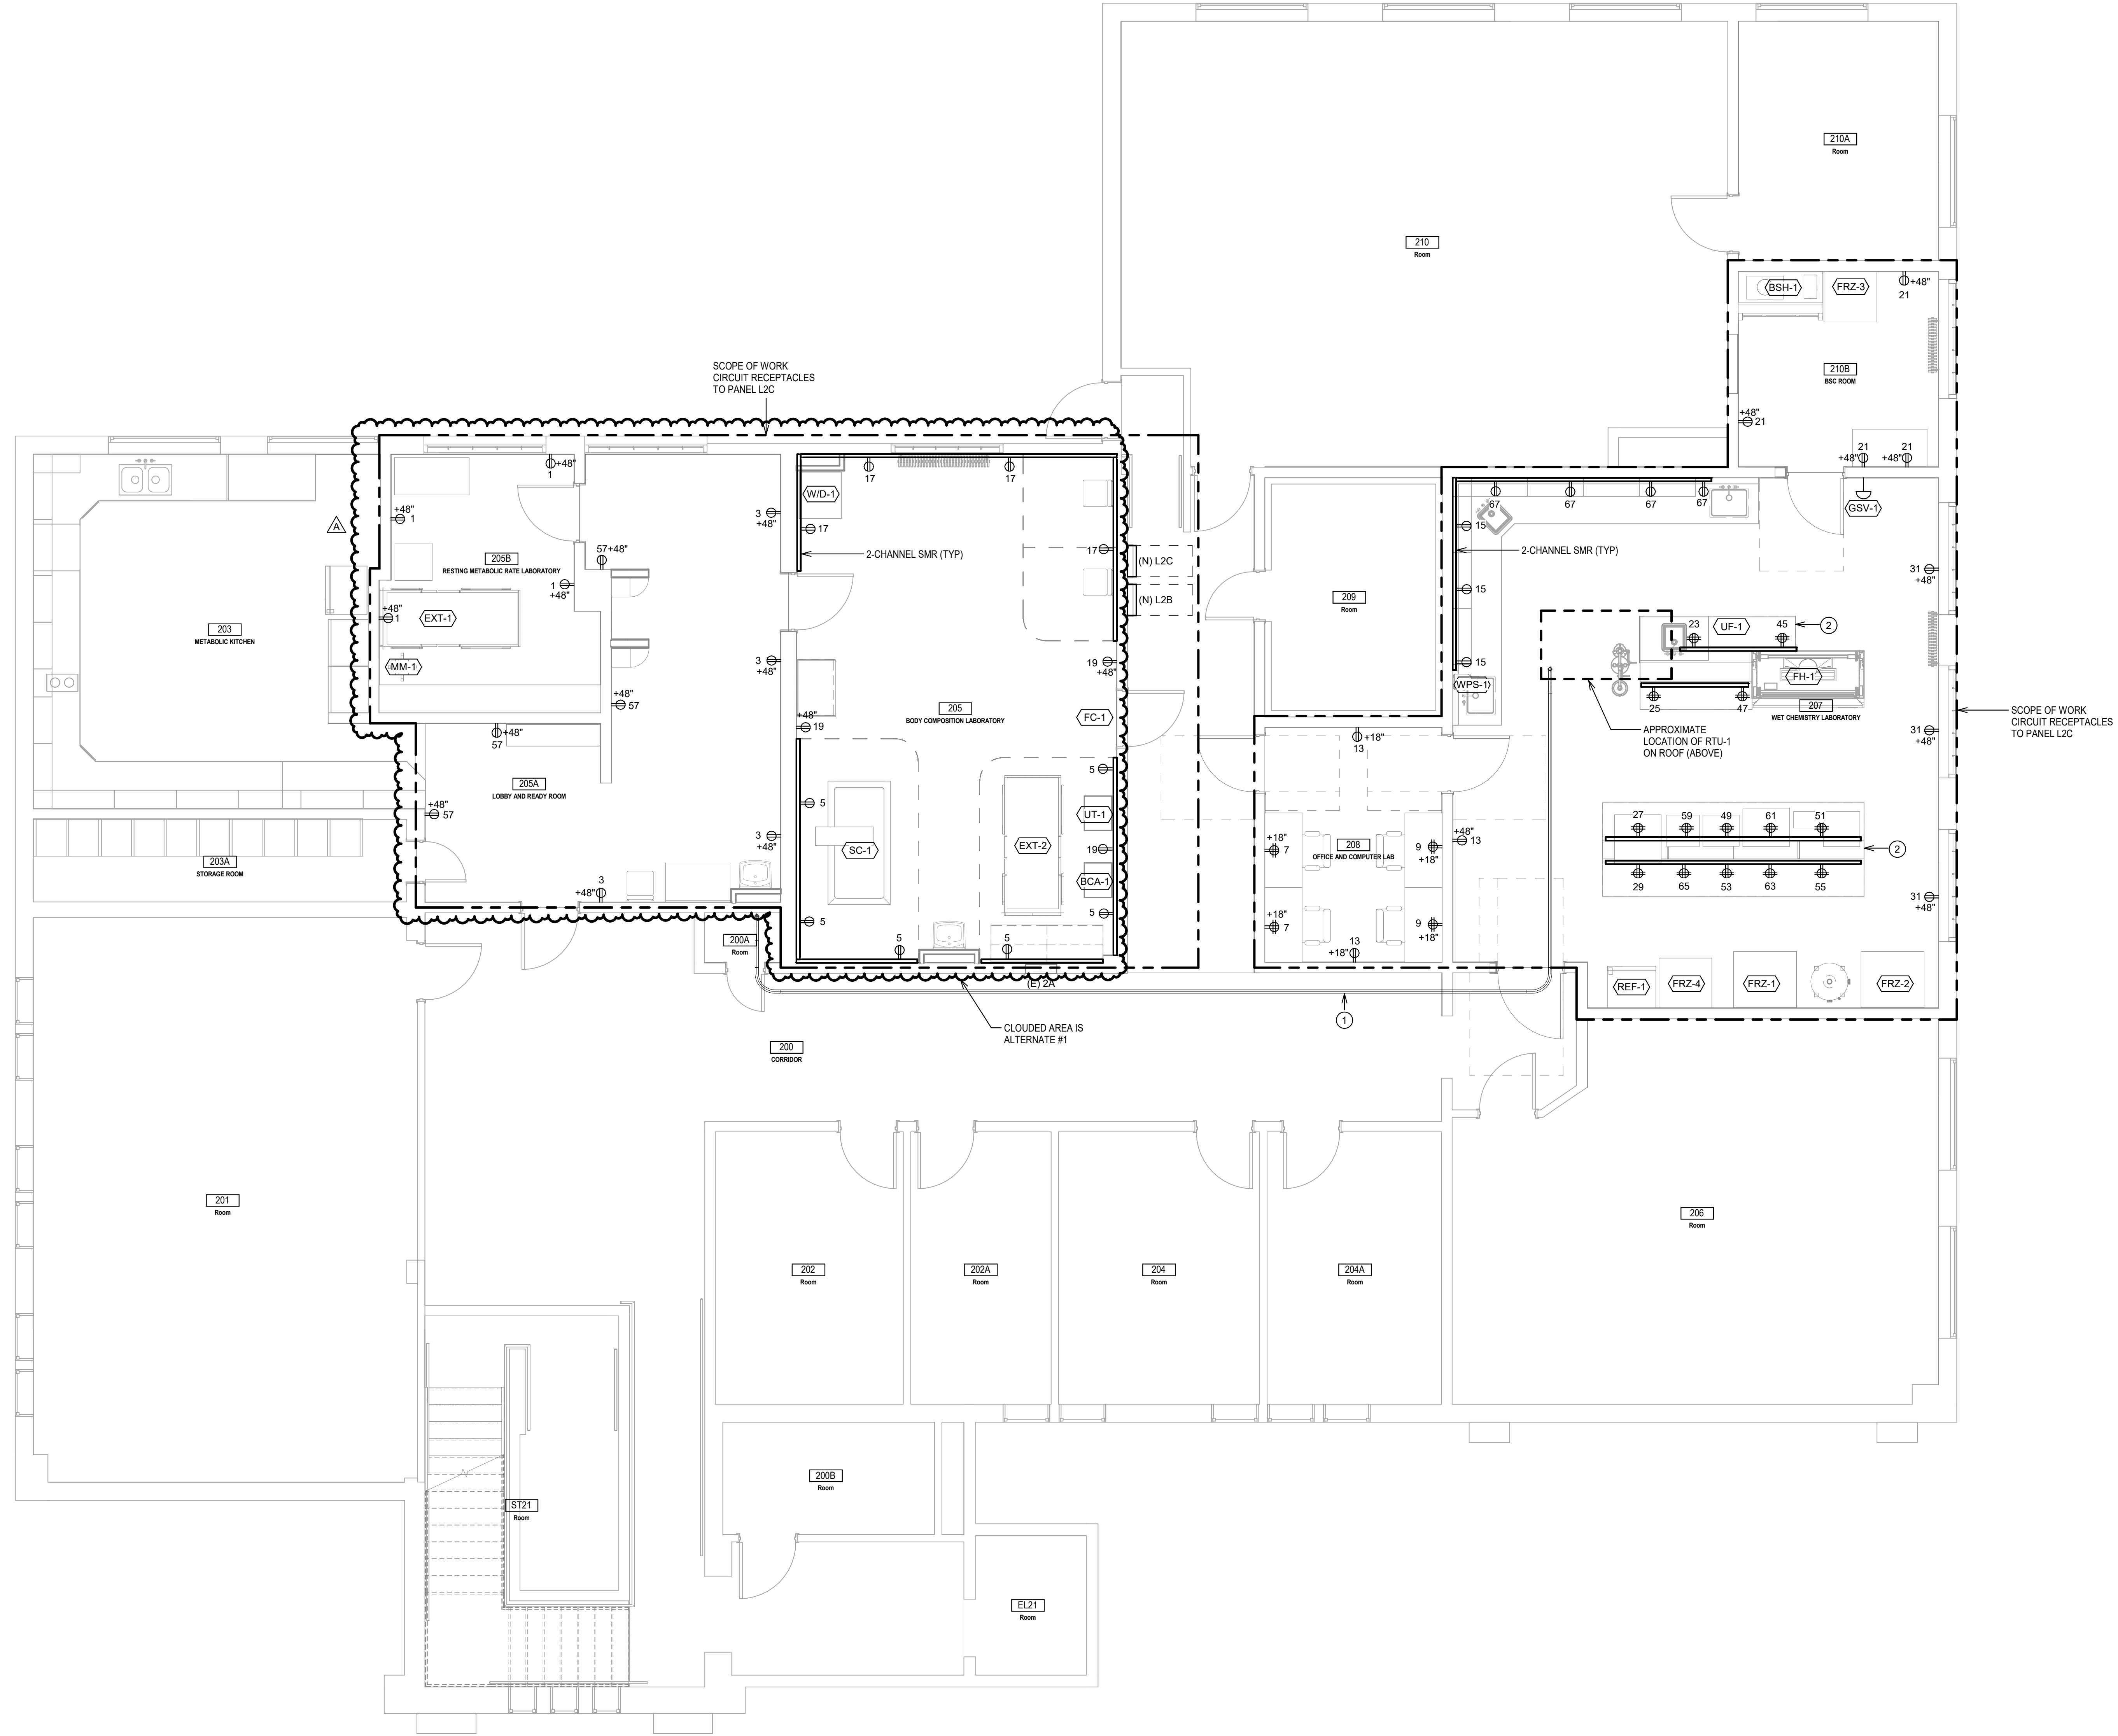


GENERAL NOTES:
 1. FIELD VERIFY EXISTING CONDITIONS PRIOR TO COMMENCING WORK

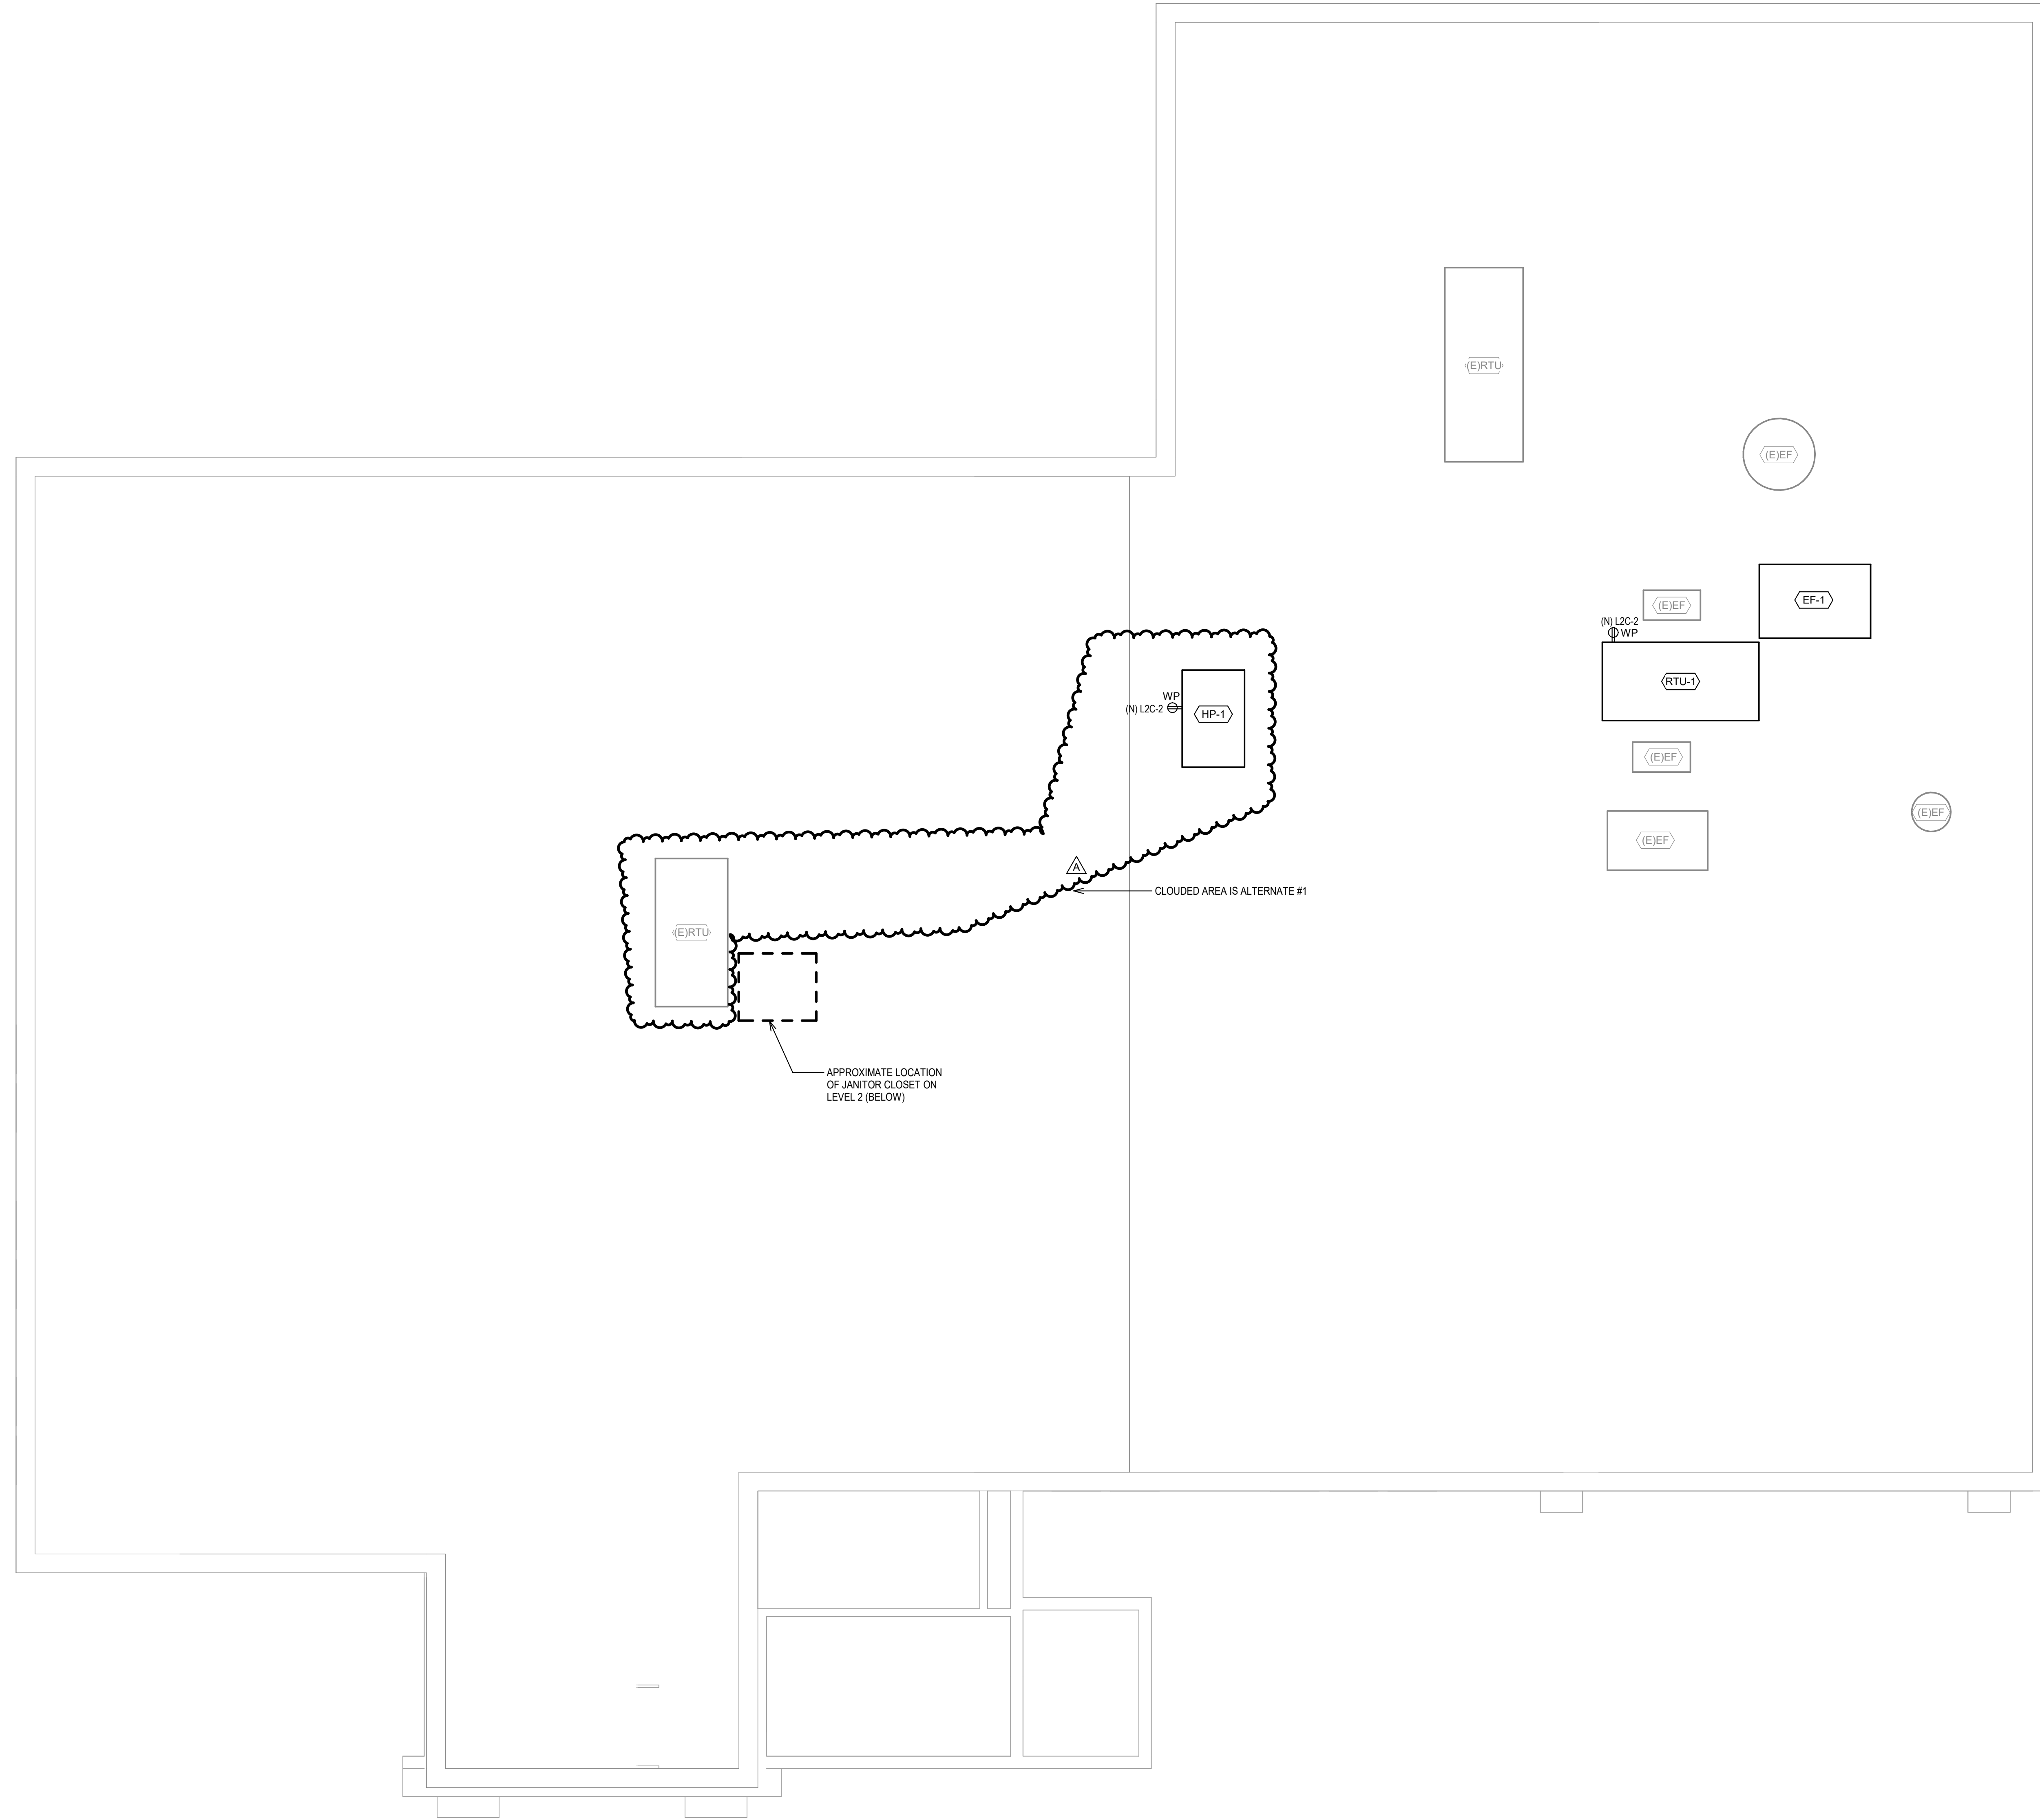

ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT
A	1/31/2025	Owner Revisions

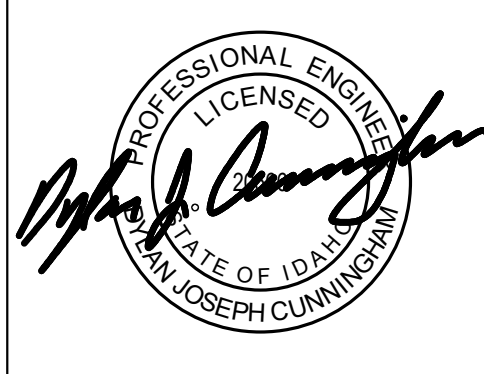

ROOF PLAN - ELECTRICAL
FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE, MOSCOW, ID 83844
UNIVERSITY OF IDAHO


TITLE	PROJECT	CLIENT
ROOF PLAN - ELECTRICAL	FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)	UNIVERSITY OF IDAHO

JOB NO: **240004**
 CAPITAL PROJECT NO: **CP220034**

E2-12

ROOF PLAN - ELECTRICAL
 1/4" = 1'-0"

GENERAL NOTES:
 1. FIELD VERIFY EXISTING CONDITIONS PRIOR TO COMMENCING WORK

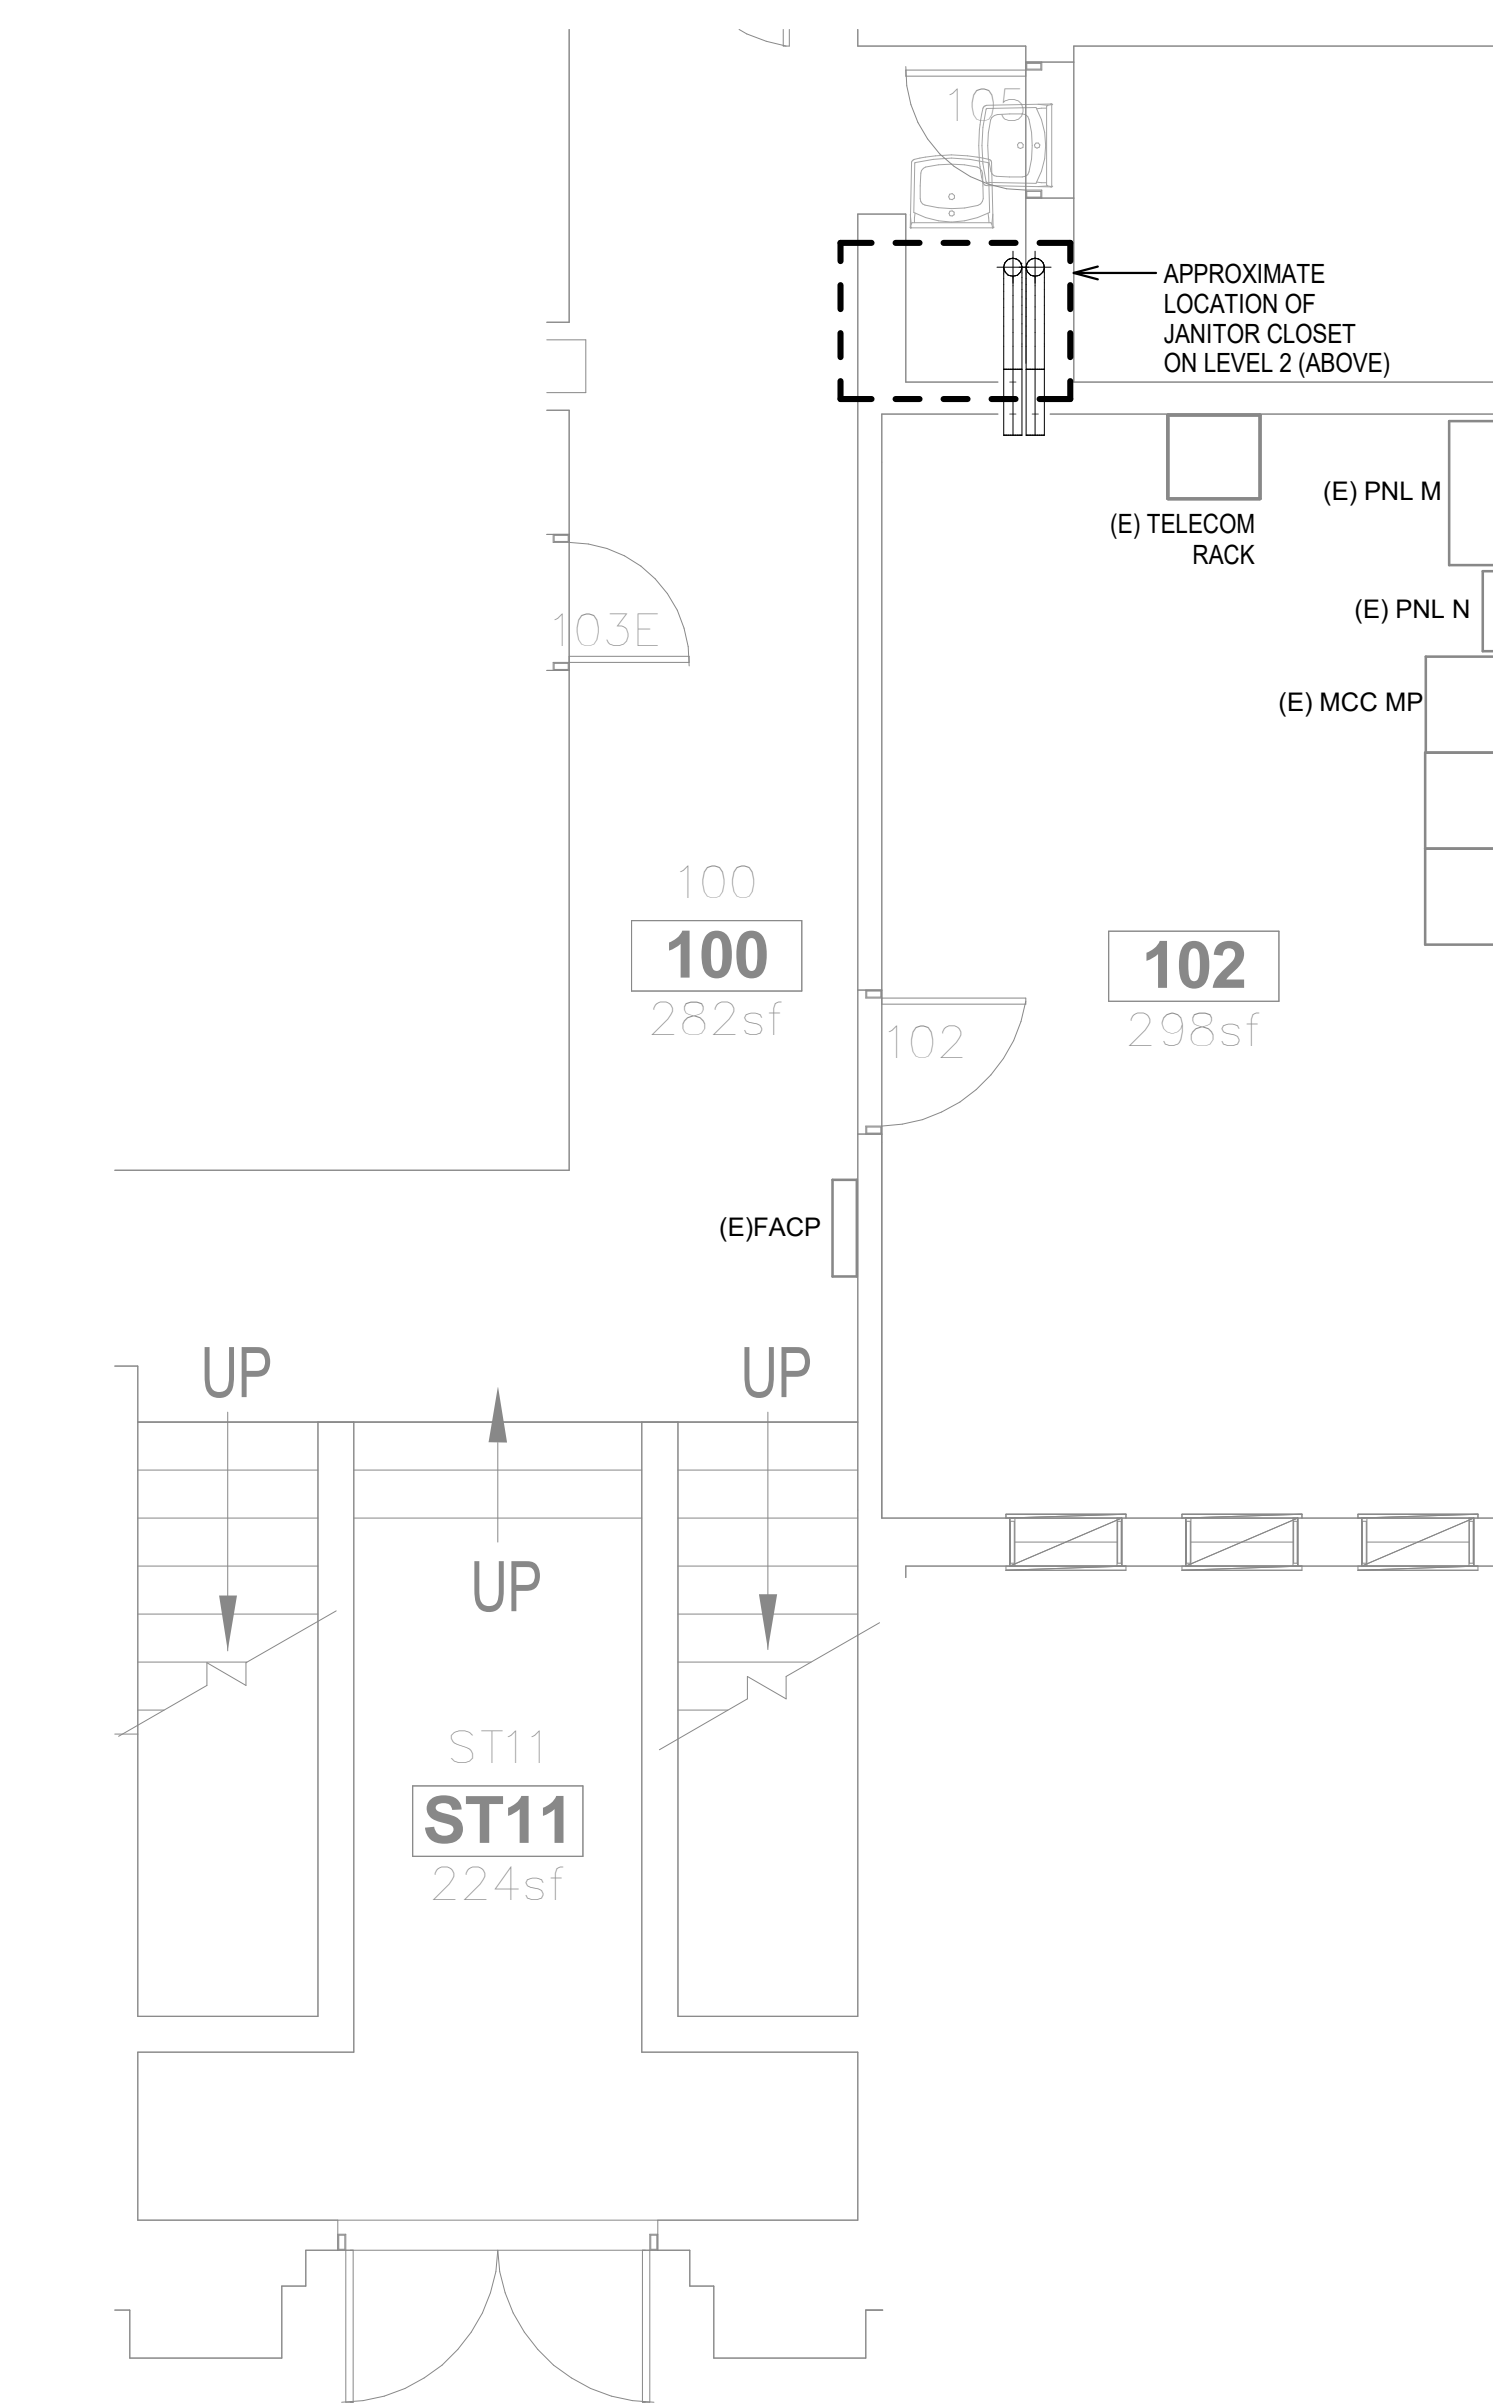

LEVEL 1 - MECH ROOM 102 - ELECTRICAL
 1/4" = 1'-0"



KNIT
 knitstudios.com


THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSE OF CONTRACTING UNDER AND MAINTAINING THE PROJECT AGREEMENT AS THE ARCHITECT OF RECORD FOR THE PROJECT. RETAINS OWNERSHIP OF THESE DOCUMENTS.
 ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KMIT.
 REPRODUCTION OF THESE DOCUMENTS IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KMIT.



MW Engineers
 601 W First Ave, Ste 1200
 Spokane, WA 99201, USA
 509.838.9223
 mwengineers.com

ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT

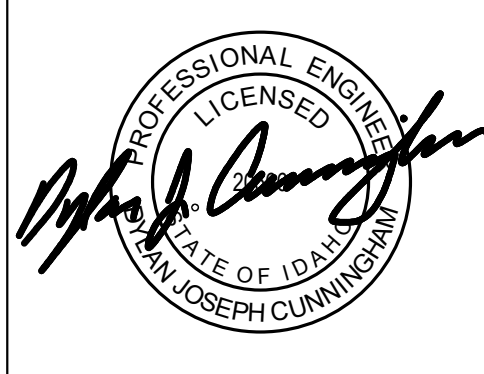

ENLARGED VIEWS - ELECTRICAL

FOOD RESEARCH CENTER TI - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE., MOSCOW, ID 83844

UNIVERSITY OF IDAHO

TITLE	PROJECT	CLIENT

JOB NO: **240004**
 CAPITAL PROJECT NO: **CP220034**

E4-01

MECHANICAL EQUIPMENT SCHEDULE - ELECTRICAL

GENERAL NOTES:
 1. COORDINATE CONNECTION DETAILS WITH EQUIPMENT VENDOR PRIOR TO ROUGH-IN.
 2. REFER TO PROJECT SPECIFICATIONS FOR ADDITIONAL DETAILS AND REQUIREMENTS.
 3. PROVIDE NEMA 3R RATED EQUIPMENT WHERE INSTALLED OUTDOORS.
 4. COORDINATE ALL FUSE SIZES WITH EQUIPMENT VENDOR, EQUIPMENT NAMEPLATES AND SHOP DRAWINGS PRIOR TO ORDERING FUSES OR DISCONNECTS.
 5. PROVIDE NEMA STARTER WHERE INDICATED ON THE SCHEDULE. PROVIDE AT MINIMUM THE SIZE INDICATED.
 6. WIRE SIZES ARE FOR COPPER CONDUCTORS UNLESS SPECIFICALLY INDICATED OTHERWISE.
 7. WHERE TOGGLE SWITCHES, MANUAL MOTOR STARTERS(MMS) AND MOTOR RATED SWITCHES(MRS) ARE INDICATED FOR EQUIPMENT INSTALLED IN FINISHED AREAS, THEY SHALL BE MOUNTED IN AN ADJACENT, CONCEALED AND ACCESSIBLE LOCATION.

EQUIPMENT SPECIFIC NOTES:
 1. OUTDOOR CONDENSING UNIT CIRCUIT POWERS OUTDOOR UNIT AND INDOOR UNIT. SEE MECHANICAL DRAWINGS FOR DETAILS. CIRCUIT SHALL BE STRANDED WIRE.
 2. EQUIPMENT BRANCH CIRCUIT IS OVSIZED TO ACCOUNT FOR VOLTAGE DROP.
 3. EQUIPMENT INDICATED WITH 'Y' AMPS LOAD IS REDUNDANT AND WILL NOT OPERATE SIMULTANEOUSLY WITH ITS COUNTERPART. SEE MECHANICAL SCHEDULES FOR DETAILS.
 4. EQUIPMENT IS FURNISHED WITH INTEGRAL THERMAL OVERLOAD PROTECTION FOR THE MOTOR.
 5. VFD IS EQUIPPED WITH BYPASS. CIRCUIT BREAKER SIZED ACCORDINGLY.
 6. CIRCUIT BREAKER IN PANEL SHALL HAVE NECESSARY HARDWARE TO FACILITATE LOCK-OUT, TAG-OUT OF BREAKER...

DENOTED ITEMS ALTERATE #1

Equipment Name	Description	Room #	Voltage	Phase	HP	Amps	kVA	Starter	Disconnect	Fuse Size	# of Sets	Conduit Size	Wire Size/Cty (AWG)	Panel	Circuit Number	Notes
BSH-1	BIOSAFETY HOOD		120 V	1	--	8 A	0.960 kVA	--	HARDWIRED	--	1	3/4"	2#12+1#12G	(N) L2C	11	
EF-1	EXHAUST FAN		208 V	1	33	4 A	0.832 kVA	--	TOGGLE SWITCH	--	1	3/4"	2#12+1#12G	(N) L2C	44,46	
ALT #1 FC-1	FAN COIL	205	208 V	1	--	0 A	0.000 kVA	--	TOGGLE SWITCH	--	1	3/4"	2#12+1#12G	(N) L2C	14,16	1
ALT #1 FH-1	FUME HOOD	207	120 V	1	--	10 A	1.200 kVA	--	HARDWIRED	--	1	3/4"	2#12+1#12G	(N) L2C	33	
ALT #1 GSV-1	GAS SHUT OFF	207	120 V	1	--	1 A	0.120 kVA	--	HARDWIRED	--	1	3/4"	2#12+1#12G	(N) L2C	38	
ALT #1 HP-1	HEAT PUMP		208 V	1	--	18.3 A	3.806 kVA	--	2P-30A	20A	1	3/4"	2#10+1#10G	(N) L2C	4,6	1
ALT #1 RTU-1	ROOF TOP UNIT		208 V	3	2.3	69.3 A	24.966 kVA	--	3P-100A	70A	1	1 1/4"	3#4+1#8G	(E) PANEL M	8,10,12	7

GENERAL EQUIPMENT SCHEDULE - ELECTRICAL

EQUIPMENT SPECIFIC NOTES:
 1. INDICATED HEIGHTS ARE FOR REFERENCE ONLY. REFER TO AV AND ARCHITECTURAL DRAWINGS FOR FINAL EQUIPMENT HEIGHTS AND LOCATIONS.
 2. DIVISION 26 SHALL PROVIDE AND INSTALL ELECTRICAL PROVISIONS AS SCHEDULED.

DENOTED ITEMS ALTERATE #1

Equipment Name	Description	Room #	Voltage	Phase	HP	Amps	kVA	Starter	Disconnect	Fuse Size	# of Sets	Conduit Size	Wire Size/Cty (AWG)	Panel	Circuit Number	Notes
ALT #1 BCA-1	BODY COMPOSITION ANALYZER	205	120 V	1	--	5 A	0.600 kVA	--	NEMA 5-20R	--	1	3/4"	2#12+1#12G	(N) L2C	18	
ALT #1 EXT-1	EXAM TABLE	205B	120 V	1	--	5 A	0.600 kVA	--	NEMA 5-20R	--	1	3/4"	2#12+1#12G	(N) L2C	20	
ALT #1 EXT-2	EXAM TABLE	205	120 V	1	--	5 A	0.600 kVA	--	NEMA 5-20R	--	1	3/4"	2#12+1#12G	(N) L2C	28	
ALT #1 FRZ-1	FREEZER (-80)	207	208 V	1	--	10 A	2.080 kVA	--	NEMA 6-20R	--	1	3/4"	2#12+1#12G	(N) L2C	41,43	
ALT #1 FRZ-2	FREEZER (-80)	207	208 V	1	--	10 A	2.080 kVA	--	NEMA 6-20R	--	1	3/4"	2#12+1#12G	(N) L2C	40,42	
ALT #1 FRZ-3	FREEZER (-20)		120 V	1	--	5 A	0.600 kVA	--	NEMA 5-20R	--	1	3/4"	2#12+1#12G	(N) L2C	39	
ALT #1 FRZ-4	FREEZER (-20)	207	120 V	1	--	5 A	0.600 kVA	--	NEMA 5-20R	--	1	3/4"	2#12+1#12G	(N) L2C	37	
ALT #1 MM-1	METABOLIC MONITOR	205B	120 V	1	--	5 A	0.600 kVA	--	NEMA 5-20R	--	1	3/4"	2#12+1#12G	(N) L2C	22	
ALT #1 REF-1	REFRIGERATOR	207	120 V	1	--	2.2 A	0.264 kVA	--	NEMA 5-15R	--	1	3/4"	2#12+1#12G	(N) L2C	35	
ALT #1 SC-1	SCANNER	205	120 V	1	--	5 A	0.600 kVA	--	NEMA 5-20R	--	1	3/4"	2#12+1#12G	(N) L2C	24	
ALT #1 UF-1	UNDERCOUNTER FLASKSCRUBBER	207	208 V	3	--	20 A	7.200 kVA	--	NEMA 11-30R	--	1	3/4"	3#10+1#10G	(N) L2C	32,34,36	
ALT #1 UT-1	ULTRASOUND	205	120 V	1	--	5 A	0.600 kVA	--	NEMA 5-20R	--	1	3/4"	2#12+1#12G	(N) L2C	26	
ALT #1 WID-1	WASHERDRYER	205	208 V	1	--	10 A	2.080 kVA	--	NEMA 6-20R	--	1	3/4"	2#12+1#12G	(N) L2C	6,10	
ALT #1 WPS-1	WATER PURIFICATION SYSTEM	207	120 V	1	--	5 A	0.600 kVA	--	NEMA 5-20R	--	1	3/4"	2#12+1#12G	(N) L2C	30	

LIGHTING FIXTURE SCHEDULE

Type	Description	Lamp	VA	Voltage	Manufacturer	Model #	Keynote
B	2X4 RECESSED TROFFER	LED	39 VA	120 V	CORONET	SRP24-35-LW-G-ED1-U	
B2	2x2 RECESSED TROFFER	LED	23 VA	120 V	COLUMBIA	SRP22-358-LW-G-ED1	
BE	2X4 RECESSED TROFFER - EMERGENCY	LED	39 VA	120 V	CORONET	SRP24-35-LW-G-ED1-U-ELL14	
E1	LED EXIT FIXTURE	LED	4 VA	120 V	BARRON	700U-LB-WH	
Indirect Light Source							
P4	LINEAR DIRECT/INDIRECT PENDANT	LED	40 VA	120 V	CORONET	RAY4-UPDN-4-35-LOW-LOW-UNV-DB-W-AC-SD-NA-NA-STD	
P4A	LINEAR DIRECT/INDIRECT PENDANT	LED	40 VA	120 V	CORONET	RAY4-UPDN-4-35-MED-MED-UNV-DB-W-AC-SD-NA-NA-STD	
P4AE	LINEAR DIRECT/INDIRECT PENDANT	LED	40 VA	120 V	CORONET	RAY4-UPDN-4-35-MED-MED-UNV-DB-W-AC-SD-NA-EMPCK-STD	
P8	LINEAR DIRECT/INDIRECT PENDANT	LED	80 VA	120 V	CORONET	RAY4-UPDN-8-35-LOW-LOW-UNV-DB-W-AC-SD-NA-NA-STD	
P8E	LINEAR DIRECT/INDIRECT PENDANT - EMERGENCY	LED	80 VA	120 V	CORONET	RAY4-UPDN-8-35-LOW-LOW-UNV-DB-W-AC-SD-NA-EMPCK-STD	
Suspended							




knitstudios.com
 THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSES OF CONTRACTING LINES AND MAINTAINING THE PROJECT HEREIN AS THE ARCHITECT OF RECORD FOR THE PROJECT RETAINS OWNERSHIP OF THESE DOCUMENTS.
 ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.
 REPRODUCTION OF THIS DOCUMENT IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.



ISSUE DATE: 12.20.2024

REV DATE COMMENT
 A 1/31/2025 Owner Revisions

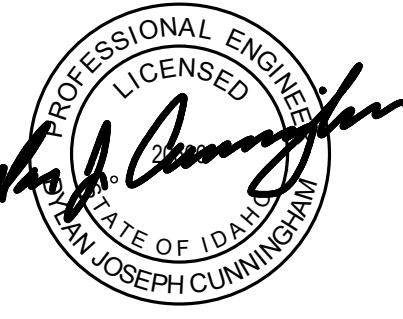

SCHEDULES - ELECTRICAL
 FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE., MOSCOW, ID 83844
 UNIVERSITY OF IDAHO

TITLE PROJECT CLIENT
 JOB NO: 240004
 CAPITAL PROJECT NO: CP220034

E6-01

Existing Main Switchboard Load Summary (loads shown in kVA)										
Description	Receptacles	Lights	Welders	X-Ray Machines	Appliances	Motors	Largest Motor	Miscellaneous	Connected Line Total	
Panel M	45.2	9.9				68.7	n/a	64.5	71.2	
Connected Total	45.2	9.9				68.7	n/a	64.5	71.2	
Demand Total	27.6	9.9				68.7	n/a	64.5	170.7	
Total Load (w/heating factors)	27.6	12.3				68.7	7.7	64.5	180.8	
									Existing Maximum Demand 109.0	
									Demand Total 279.7	
									Total Load (w/heating factor for existing) 317.1	
Minimum Amperage Required 880 Amps										
Formula: $(180.8 \text{ kVA} + 109.0 \text{ kVA}) \times 1.25 / (1.732 \times 208 \text{ kV})$										
Notes: 1. Existing 1-year peak demand of 98kW/109kVA recorded in June 2016.										

Circuit Breaker Panelboard																					
Name: (E) Panel M			Main: Lugs			Volts: 120/208			Phase: 3		Wiring: 4		Mounting: Surface			Bus: 600A			Bracing: 10,000		
Ckt#	Amp	P	Qty	Cat	Notes	Location/Description	Load (VA)	Phase	A	B	C	Ckt#	Amp	P	Qty	Cat	Notes	Location/Description	Load (VA)		
1	225	3			1	Existing		*	2	100	3	1	Existing				1	Existing			
3								*	4												
5								*	6												
7	225	3			1	Existing		*	8	100	3	1	M	1			1	Elevator	6240		
9								*	10												
11								*	12												
13	225	3			1	Existing		*	14	20	1							Spare	6240		
15								*	16	20	1										
17								*	18	20	1										
19	20	1			2	Spare		*	20	20	1										
21	20	1			2	Spare		*	22	20	1										
23	20	1			2	Spare		*	24	20	1										
25	225	3			1	Existing		*	26	20	1										
27								*	28	20	1										
29								*	30	20	1										
31	20	1				Spare		*	32	20	1										
33	20	1				Spare		*	34	20	1										
35	20	1				Spare		*	36	20	1										
37	20	1				Spare		*	38	225	3								1	Existing	
39	20	1				Spare		*	40												
41	20	1				Spare		*	42												
Totals											Load on Phase A: 14,369 VA			Category Qty Load							
											Load on Phase B: 14,299 VA			Receptacles (R): 186 33,480 VA							
											Load on Phase C: 11,870 VA			Lights (L): 94 8,150 VA							
											Connected Load: 40,538 VA										
											Demand Load: 133,398 VA										
											Total Load (w/heating factors): 140,116 VA										
											Minimum Feeder Size: 388.9 Amps			Motors (M): 16 36,108 VA							
														Miscellaneous (Z): 33 67,400 VA							
														Formula: $140.1 \text{ kVA} / (1.732 \times 208 \text{ kV})$							
Notes:											1. EXISTING TO REMAIN										
Notes:											2. DEMOLISH EXISTING SPARE BREAKERS. REPLACE WITH NEW 3P-70A BREAKER AS SHOWN.										

Circuit Breaker Panelboard																					
Name: (R) Panel M			Main: Lugs			Volts: 120/208			Phase: 3		Wiring: 4		Mounting: Surface			Bus: 600A			Bracing: 10,000		
Ckt#	Amp	P	Qty	Cat	Notes	Location/Description	Load (VA)	Phase	A	B	C	Ckt#	Amp	P	Qty	Cat	Notes	Location/Description	Load (VA)		
1	225	3			1	Existing		*	2	100	3	1	Existing				1	Existing			
3								*	4												
5								*	6												
7	225	3			1	Existing		*	8	100	3	1	M	1			1	Elevator	6240		
9								*	10												
11								*	12												
13	225	3			1	Existing		*	14	20	1							Spare	6240		
15								*	16	20	1										
17								*	18	20	1										
19	70	3			1	M 2 (N) RTU-1	10208	*	20	20	1										
21							10208	*	22	20	1										
23							10208	*	24	20	1										
25	225	3			1	Existing		*	26	20	1										
27								*	28	20	1										
29								*	30	20	1										
31	20	1				Spare		*	32	20	1										
33	20	1				Spare		*	34	20	1										
35	20	1				Spare		*	36	20	1										
37	20	1				Spare		*	38	225	3								1	Existing	
39	20	1				Spare		*	40												
41	20	1				Spare		*	42												
Totals											Load on Phase A: 24,577 VA			Category Qty Load							
											Load on Phase B: 24,507 VA			Receptacles (R): 242 43,560 VA							
											Load on Phase C: 22,078 VA			Lights (L): 126 9,857 VA							
											Connected Load: 71,162 VA										
											Demand Load: 166,149 VA										
											Total Load (w/heating factors): 176,269 VA										
											Minimum Feeder Size: 489.3 Amps			Motors (M): 18 68,342 VA							
														Miscellaneous (Z): 48 61,170 VA							
														Formula: $176.3 \text{ kVA} / (1.732 \times 208 \text{ kV})$							
Notes:											1. EXISTING TO REMAIN										
Notes:											2. REMOVE EXISTING 1P-20A BREAKERS AND REPLACE WITH NEW 3P-70A 35KAIC CIRCUIT BREAKER.										

Circuit Breaker Panelboard																					
Name: (E) 2A			Main: Lugs			Volts: 120/208			Phase: 3		Wiring: 4		Mounting: RECESSED			Bus: 125A			Bracing: 10,000		
Ckt#	Amp	P	Qty	Cat	Notes	Location/Description	Load (VA)	Phase	A	B	C	Ckt#	Amp	P	Qty	Cat	Notes	Location/Description	Load (VA)		
1	20	1				(E) 203 LTG N. Bank	600	*	2	20	1	6	L					(E) 203 LTG S. Bank	600		
3	20	1				(E) 204 Recept	720	*	4	20	1	10	L					(E) Main Hallway LTG	1000		
5	20	1				(E) 202 LTG	400	*	6	20	1	5	L					(E) 204 LTG	500		
7	20	1				(E) 201 LTG W. Bank	700	*	8	30	1	4	L					(E) 206 Hallway LTG	400		
9	30	1				(E) 201 Recepts & 203 W. Recept	1080	*	10	30	1	4	L					(E) 206D LTG	400		
11	20	1				(E) 201 LTG E. Bank	700	*	12	20	1	5	L					(E) 205 Ceiling LTG	500		
13	20	1				(E) AIR 208	1200	*	14	30	1	4	L					(E) 208 LTG & Cooler LTG	400		
15	20	1				(E) AC Rm 208	1200	*	16	20	1	4	L					(E) 210A LTG	400		
17	20	1				(E) 203 Recept E. Wall	720	*	18	20	1	5	R					(E) 205 Recepts W. Wall	900		
19	20	1				(E) 205 Recept E. Wall	720	*	20	20	1							(E) Spare			
21	20	1				(E) 208 Lab Table Recepts	900	*	22	20	1							(E) Spare			
23	20	1				(E) 210 Lab Table Recepts	900	*	24	20	1	7	R					(E) 210, 206A, 206B Recepts	1260		
25	20	1				(E) AC Rm 206C	1200	*	26	20	1	6	R					(E) 206C, 206D Recepts	1080		
27	20	1				(E) Spare		*	28	30	1	8	L					(E) 206B LTG S. Bank	800		
29	30	1				(E) 206B LTG Center Bank	500	*	30	20	1	8	L					(E) 206B LTG N. Bank	800		
31	30	1				(E) 206C LTG	1000	*	32	20	1	1	Z					(E) Hood 205	1200		
33	20	1				(E) Spare		*	34	30	1							(E) Spare	600		
35	20	1				(E) Spare		*	36	30	1	3	R					(E) 205 Recepts E. Wall	540		
37	20	1				(E) 306 Corridor Recepts	720	*	38	20	1							(E) Spare			
39	20	1				(E) Spare		*	40	20	1	7	R					(E) 208, 204 Recepts	1260		
Totals											Load on Phase A: 9,820 VA			Category Qty Load							
											Load on Phase B: 7,760 VA			Receptacles (R): 60 10,800 VA							
											Load on Phase C: 7,720 VA			Lights (L): 97 9,700 VA							
											Connected Load: 25,300 VA										
											Demand Load: 24,900 VA										
											Total Load (w/heating factors): 27,625 VA										
											Minimum Feeder Size: 76.7 Amps			Motors (M): 3 3,600 VA							
														Miscellaneous (Z): 1 1,200 VA							
														Formula: $27.6 \text{ kVA} / (1.732 \times 208 \text{ kV})$							
Notes:											1. PANEL SHOWN FOR LOAD CALCULATIONS ONLY										

AMPACITY (AMPS)	FEEDER WITH NEUTRAL					FEEDER WITH 200% NEUTRAL AND ISOLATED GROUND					FEEDER WITHOUT NEUTRAL				
	FEEDER NUMBER	NUMBER OF SETS	CONDUIT (INCHES)	CONDUCTOR	GROUND	FEEDER NUMBER	NUMBER OF SETS	CONDUIT (INCHES)	CONDUCTOR	GROUND	FEEDER NUMBER	NUMBER OF SETS	CONDUIT (INCHES)	CONDUCTOR	GROUND
20	20N	1	3/4	#12	#12	20K	1	3/4	3#12+#8	2#12	20	1	3/4	3#12	#12
30	30N	1	3/4	#10	#10	30K	1	1	3#8+#4	2#10	30	1	3/4	3#10	#10
40	40N	1	1	#8	#10	40K	1	1	3#8+#3	2#10	40	1	1	3#8	#10
50	50N	1	1	#8	#8	50K	1	1 1/4	3#6+#1	2#8	50	1	1	3#6	#8
60	60N	1	1 1/4	#8	#8	60K	1	1 1/4	3#4+#1	2#8	60	1	1 1/4	3#4	#8
70	70N	1	1 1/4	#8	#8	70K	1	1 1/2	3#3+#1 1/2	2#8	70	1	1 1/4	3#4	#8
80	80N	1	1 1/2	#8	#8	80K	1	1 1/2	3#3+#2 1/2	2#8	80	1	1 1/4	3#3	#8
90	90N	1	1 1/2	#8	#8	90K	1	1 1/2	3#2+#3 1/2	2#8	90	1	1 1/4	3#2	#8
100	100N	1	2	#6	#6	100K	1	2	3#1+#3 1/2	2#6	100	1	1 1/2	3#1	#6
125	125N	1	2	#4	#6	125K	1	2 1/2	5#2 1/2	2#4	125	1	1 1/2	3#1	#6
150	150N	1	2	#4	#6	150K	1	2 1/2	5#3 1/2	2#4	150	1	2	3#1 1/2	#6
175	175N	1	2	#4	#4	175K	1	2 1/2	5#4 1/2	2#2	175	1	2	3#2 1/2	#4
200	200N	1	2 1/2	#4	#4	200K	1	3	5#2 1/2	2#2	200	1	2	3#3 1/2	#4
225	225N	1	2 1/2	#2	#2	225K	1	3	5#3 1/2	2#2	225	1	2 1/2	3#4 1/2	#2
250	250N	1	3	#2	#2	250K	1	4	5#4 1/2	2#1 1/2	250	1	3	3#2 1/2	#2
300	300N	1	4	#2	#2	300K	1	4	5#5 1/2	2#1 1/2	300	1	3	3#3 1/2	#2
350	350N	1	4	#1 1/2	#1 1/2	350K	2	2 1/2	5#4 1/2	2#2 1/2	350	1	4	3#5 1/2	#1 1/2
400	400N	1	4	#1 1/2	#1 1/2	400K	2	3	5#2 1/2	2#2 1/2	400	1	4	3#6 1/2	#1 1/2
450	450N	2	2 1/2	#2	#2	450K	2	3	5#3 1/2	2#2 1/2	450	2	2 1/2	3#4 1/2	#2 1/2
500	500N	2	3	#2	#2	500K	2	4	5#4 1/2	2#2 1/2	500	2	3	3#2 1/2	#2 1/2
600	600N	2	4	#2	#2	600K	2	4	5#5 1/2	2#3 1/2	600	2	3	3#3 1/2	#2 1/2
700	700N	2	4	#2	#2	700K	4	2 1/2	5#4 1/2	2#3 1/2	700	2	4	3#5 1/2	#3 1/2
800	800N	2	4	#2	#2	800K	4	3	5#2 1/2	2#3 1/2	800	2	4	3#6 1/2	#3 1/2
1000	1000N	3	4	#2	#2	1000K	4	4	5#4 1/2	2#3 1/2	1000	3	3	3#4 1/2	#3 1/2
1200	1200N	4	4	#2	#2	1200K	4	4	5#5 1/2	2#3 1/2	1200	4	3	3#3 1/2	#3 1/2
1600	1600N	4	4	#2	#2	1600K	8	3	5#2 1/2	2#4 1/2	1600	4	4	3#5 1/2	#4 1/2
2000	2000N	5	4	#2	#2	2000K	8	4	5#4 1/2	2#2 1/2	2000	5	4	3#6 1/2	#2 1/2
2500	2500N	6	4	#2	#2	2500K	10	4	5#4 1/2	2#3 1/2	2500	6	4	3#6 1/2	#3 1/2
3000	3000N	8	4	#2	#2	3000K	10	4	5#5 1/2	2#4 1/2	3000	8	4	3#5 1/2	#4 1/2
4000	4000N	10	4	#2	#2	4000K	16	4	5#4 1/2	2#5 1/2	4000	10	4	3#6 1/2	#5 1/2

NOTES:
1. CONDUIT SIZES ARE BASED ON THWN INSULATION FOR ALL CONDUCTORS AND RGS CONDUIT.

- GENERAL NOTES:**
- EXISTING CONDITIONS ARE BASED UPON BEST AVAILABLE RECORD DRAWINGS.
 - FIELD VERIFY EXISTING CONDITIONS PRIOR TO COMMENCING WORK.
 - ALL EQUIPMENT SHOWN IN THIS DRAWING IS EXISTING TO REMAIN UNLESS NOTED OTHERWISE.


knitstudios.com

THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSE OF CONTRACTING WORK AND MAINTAINING THE PROJECT AS THE ARCHITECT OF RECORD FOR THE PROJECT. RETAINERSHIP OF THESE DOCUMENTS AND ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY PARTY WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT. REPRODUCTION OF THESE DOCUMENTS IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.


601 W. First Ave. Ste 1200
Snohomish, WA 98290, USA
mweengineers.com

Short Circuit Current Calculations

3 PHASE Fault		Total Fault Currents
Name	Bus kV	Sym Amps
L2A	0.208	14356
L2B	0.208	14356
MAIN	0.208	24021
PNL M	0.208	19386.6

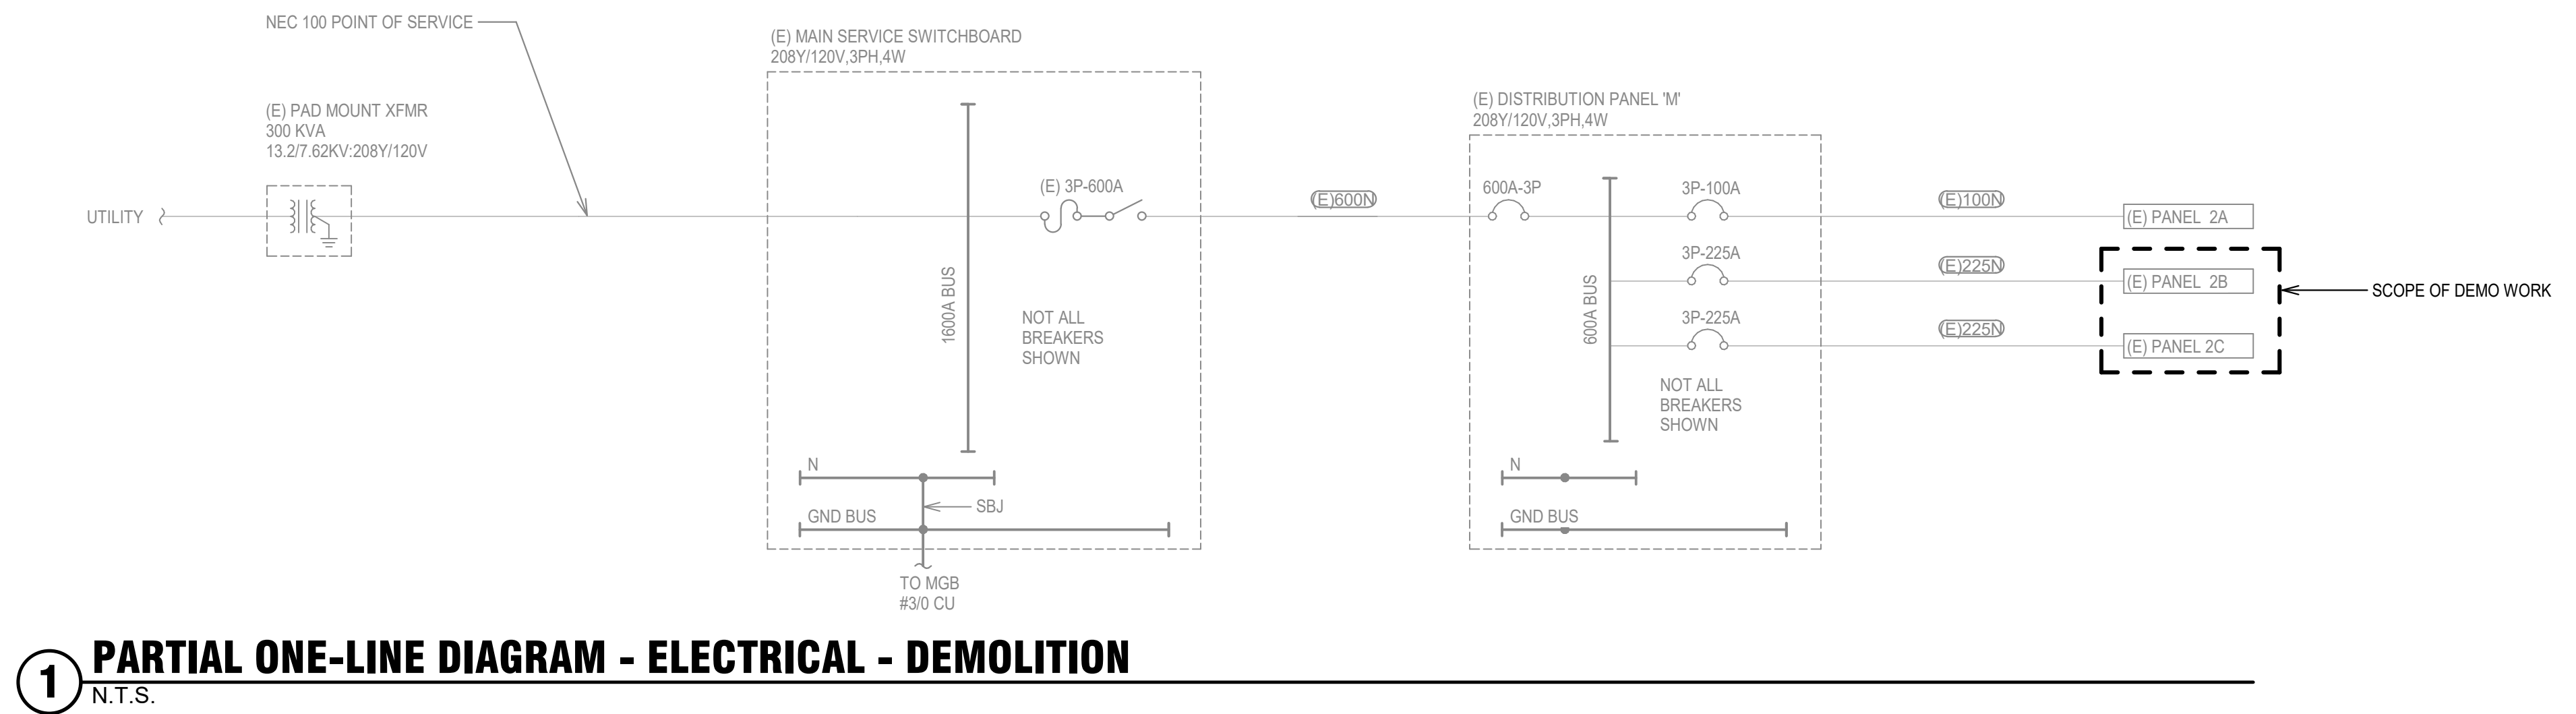


1 PARTIAL ONE-LINE DIAGRAM - ELECTRICAL - DEMOLITION
N.T.S.

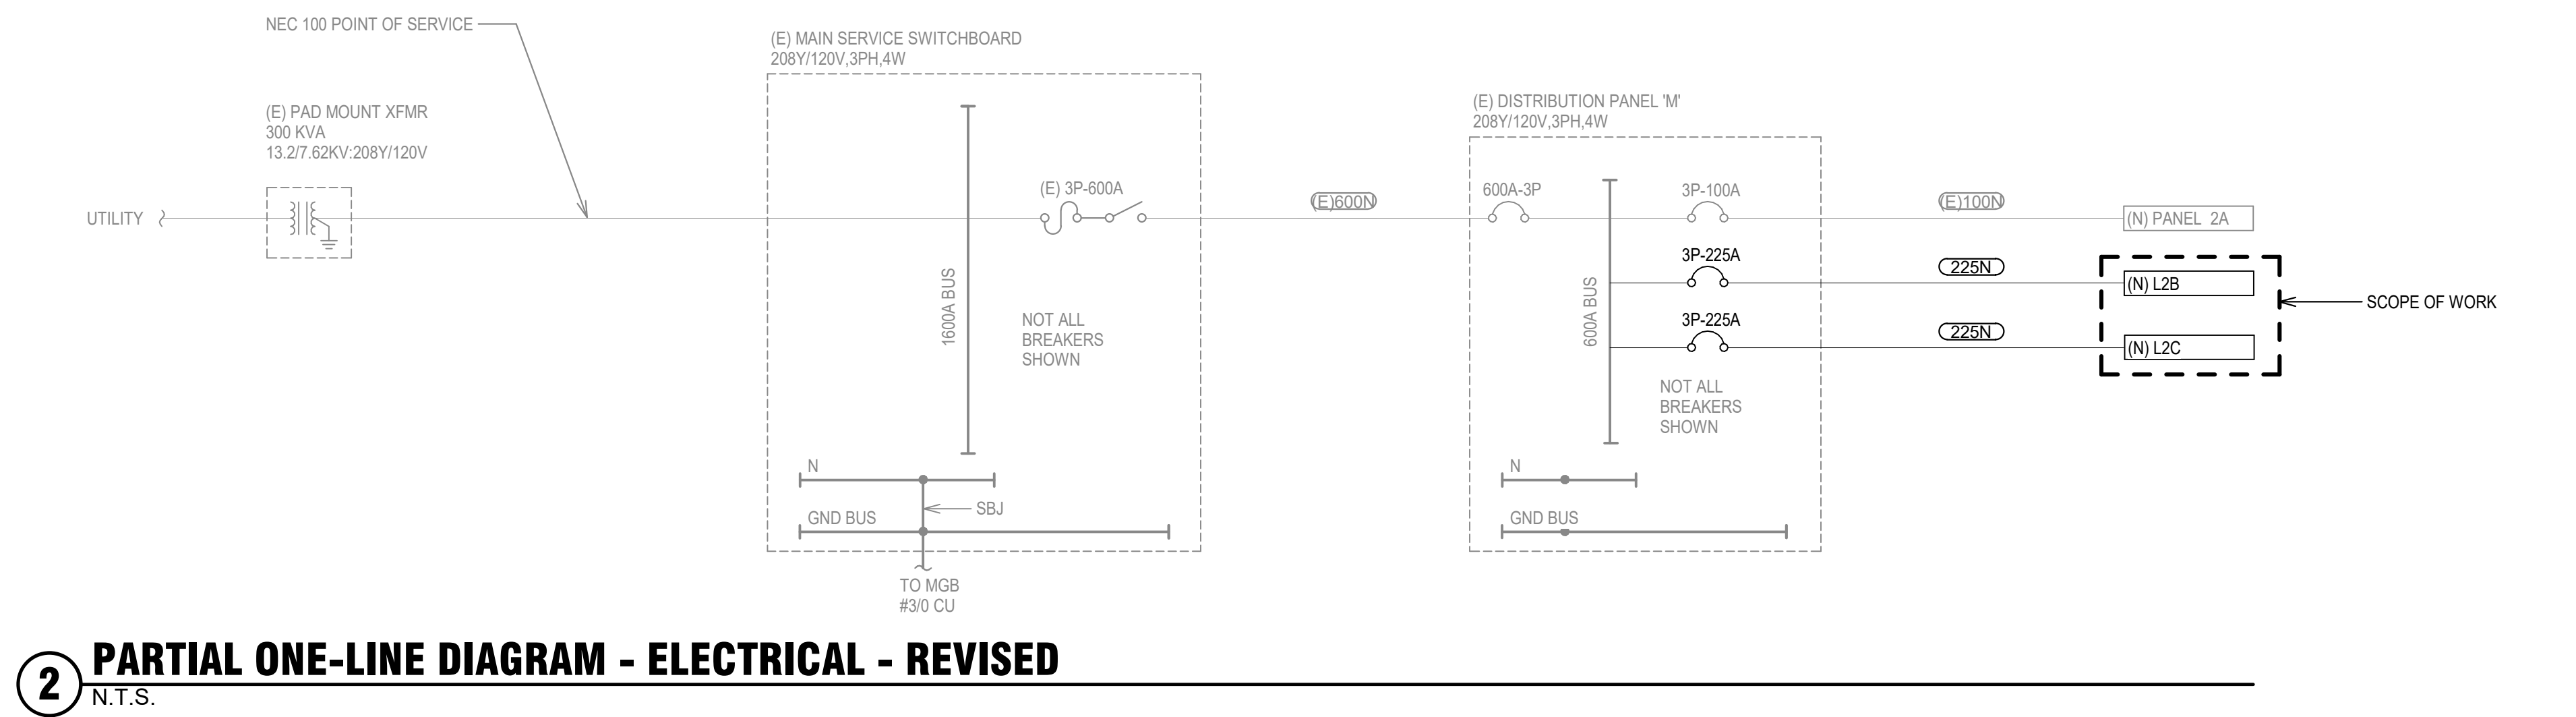

2 PARTIAL ONE-LINE DIAGRAM - ELECTRICAL - REVISED
N.T.S.

ISSUE DATE: 12.20.2024

REV DATE COMMENT

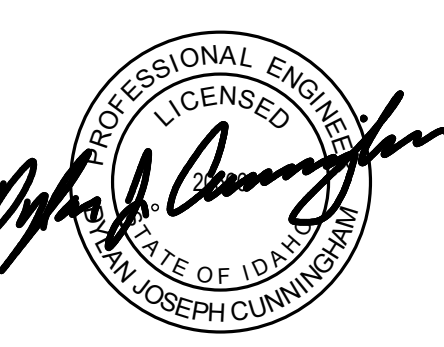

ONE-LINE DIAGRAM - ELECTRICAL

FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)

860 IDAHO AVE., MOSCOW, ID 83844


UNIVERSITY OF IDAHO

TITLE PROJECT CLIENT


JOB NO: 240004
CAPITAL PROJECT NO: CP220034

E8-01


GENERAL NOTES:
 1. FIELD VERIFY EXISTING CONDITIONS PRIOR TO COMMENCING WORK

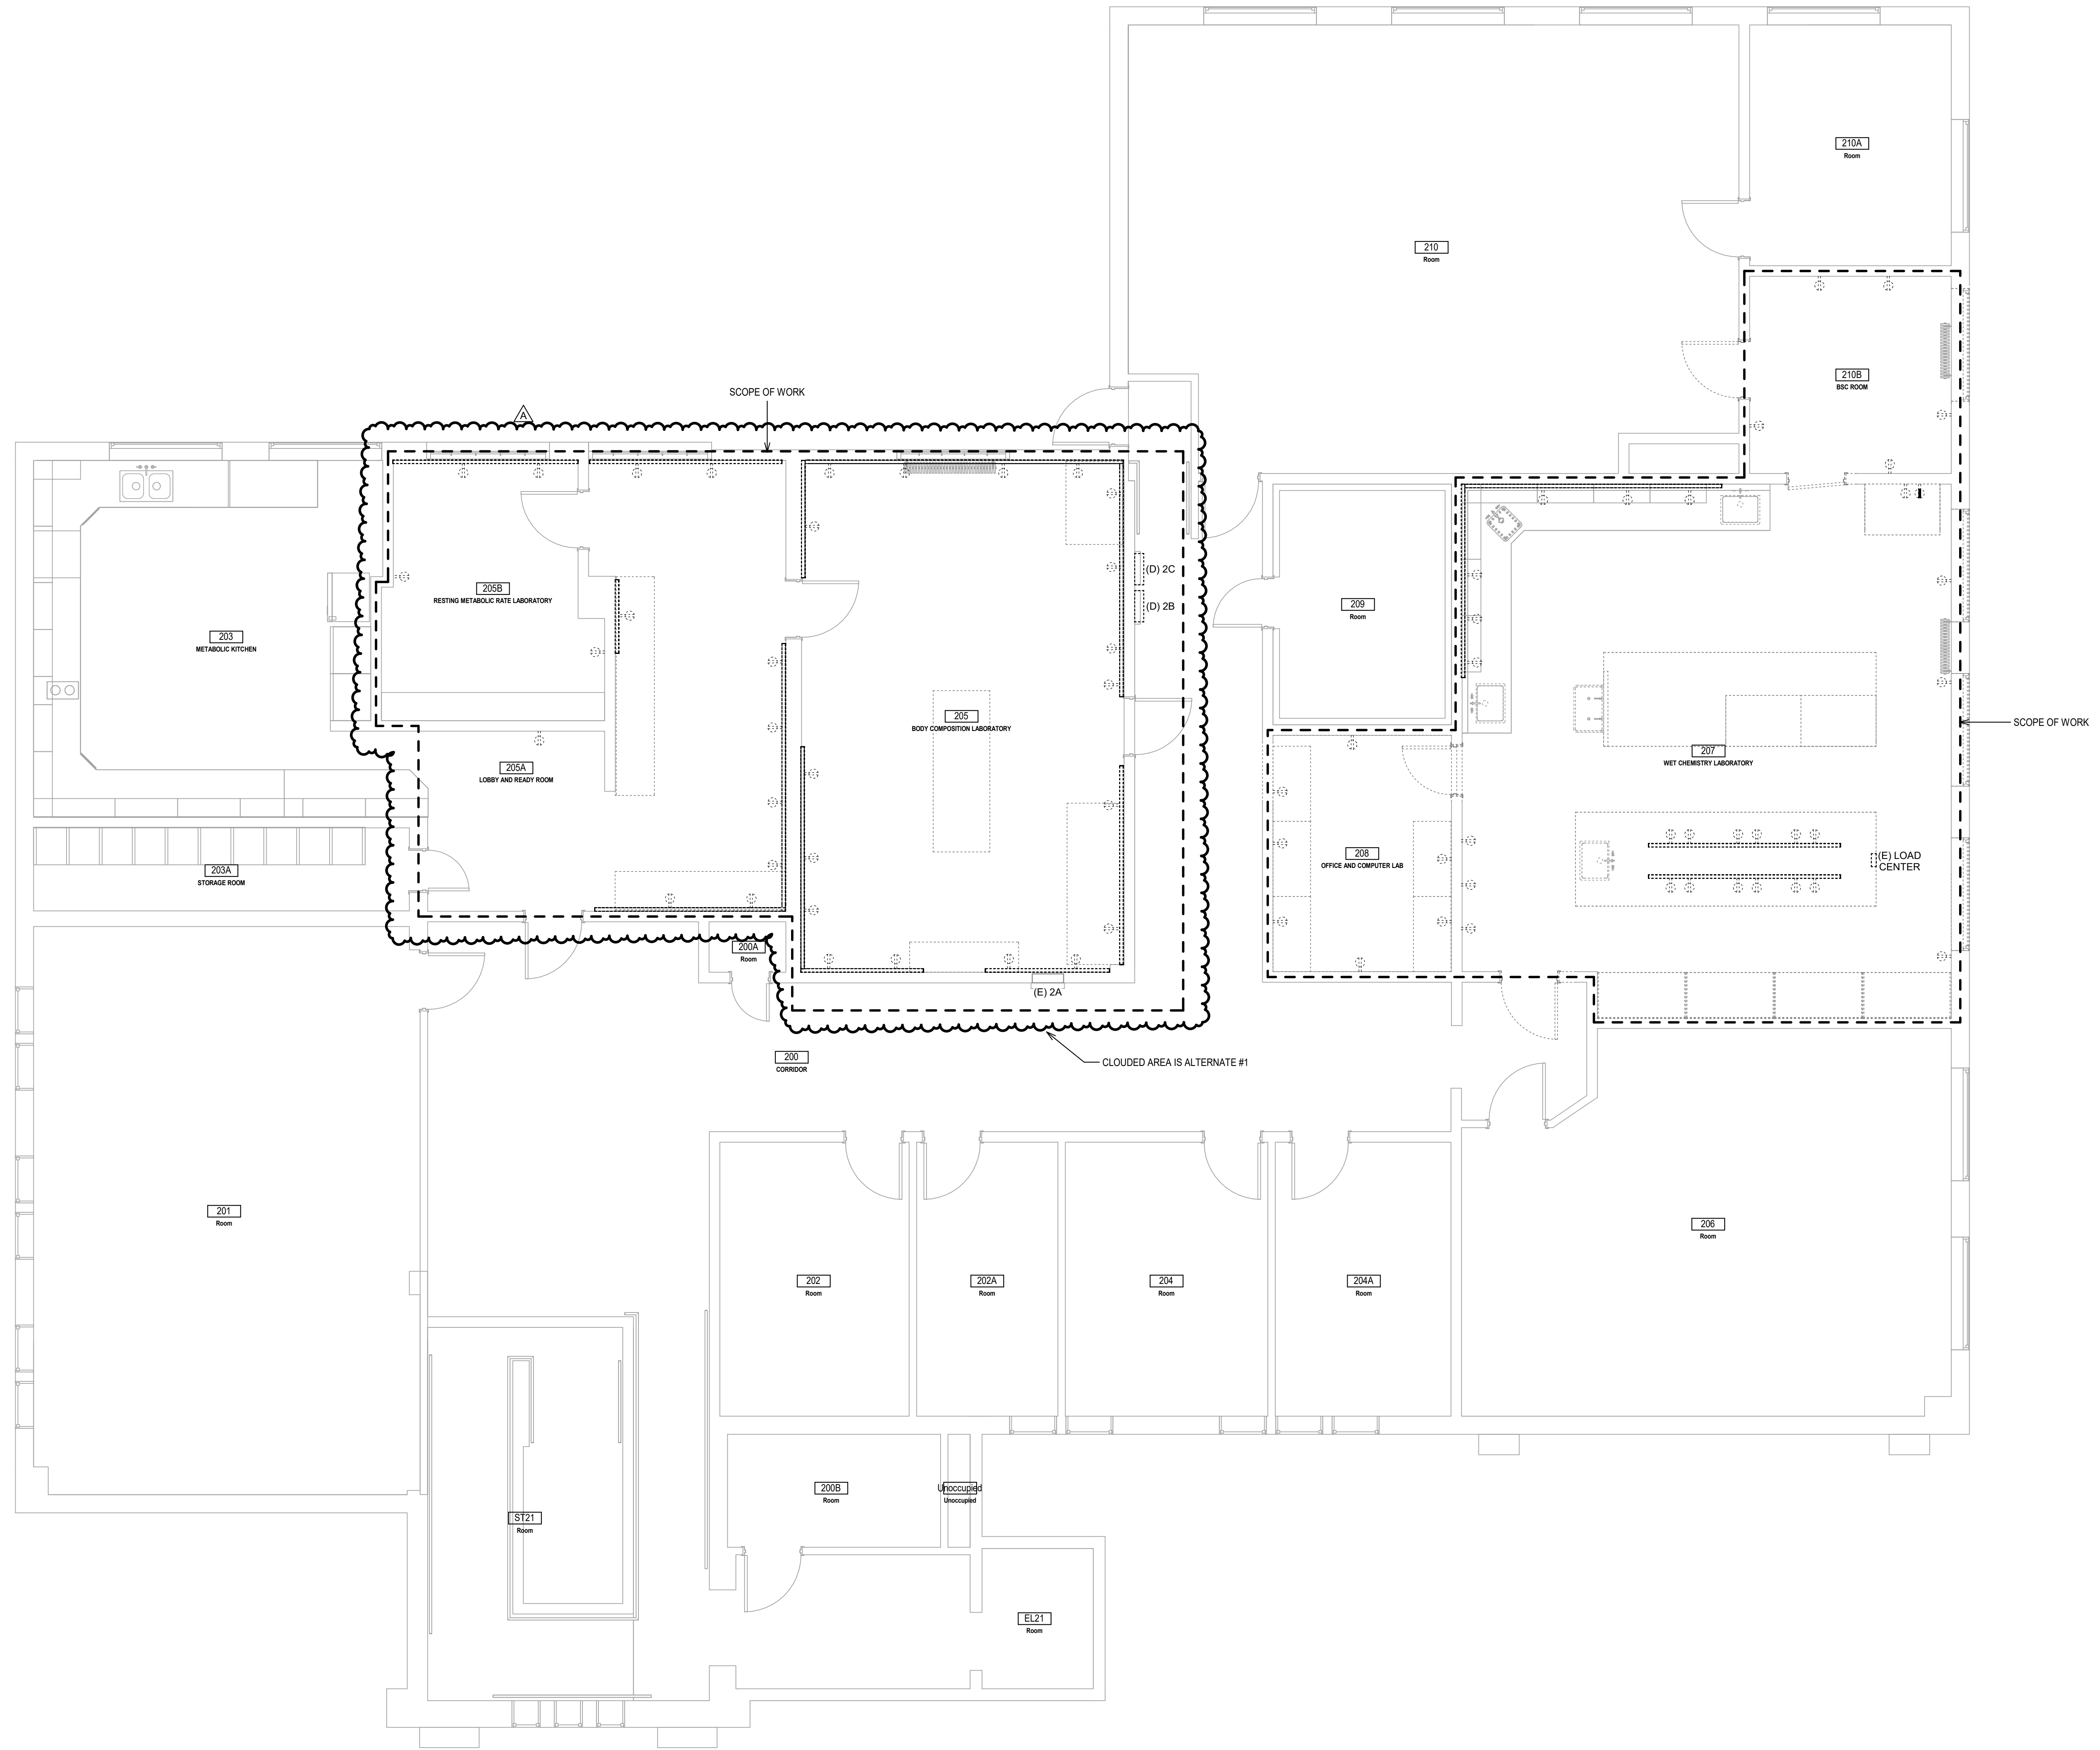

LEVEL 2 - DEMOLITION PLAN - ELECTRICAL
 1/4" = 1'-0"

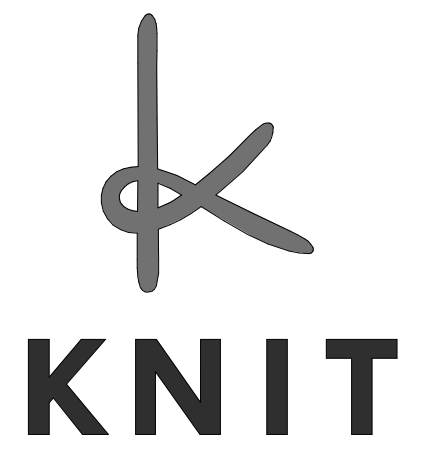

knitstudios.com
 THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSES OF CONTRACTING, LENDING AND MANAGING THE PROJECT. ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KMIT.
 REPRODUCTION OF THIS DOCUMENT IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KMIT.

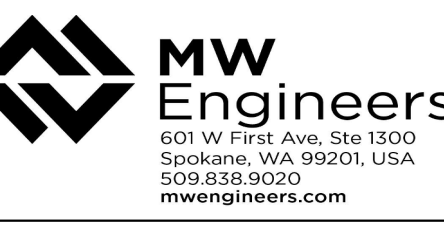

ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT
A	1/31/2025	Owner Revisions




DEMO FLOOR PLAN - ELECTRICAL
 FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE., MOSCOW, ID 83844
 UNIVERSITY OF IDAHO

TITLE	PROJECT	CLIENT

JOB NO: **240004**
 CAPITAL PROJECT NO: **CP220034**

ED2-11

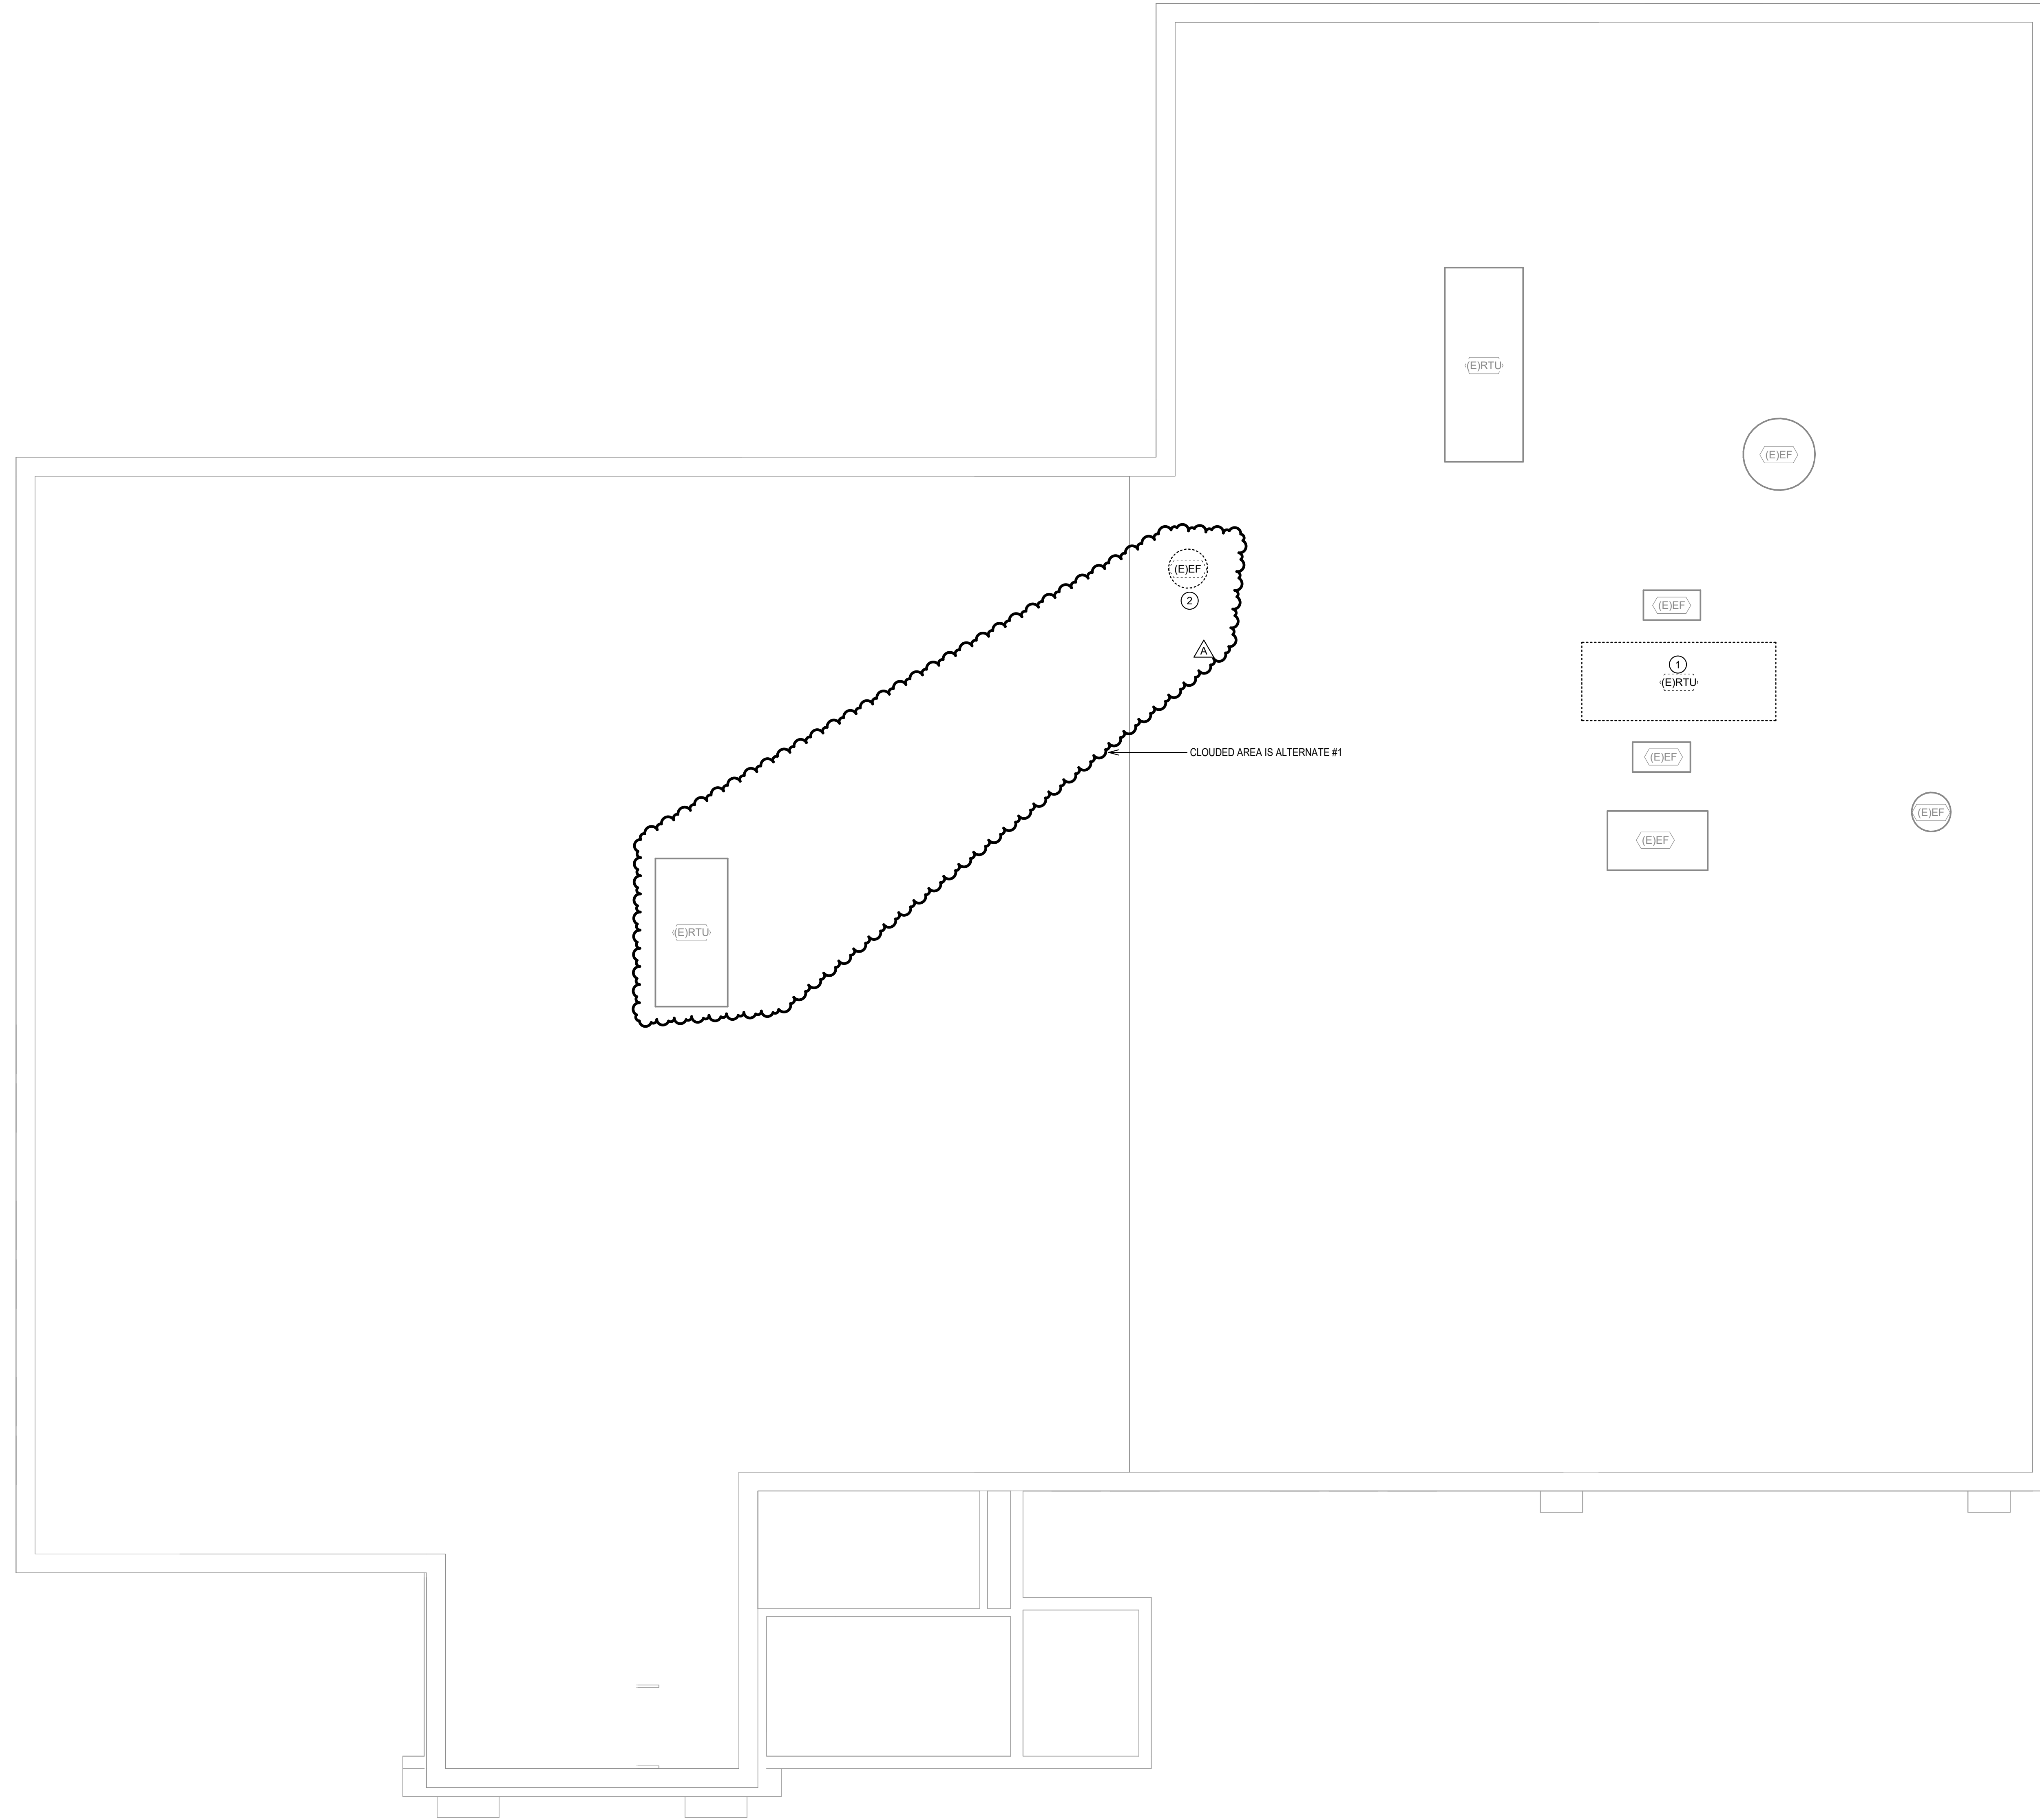


GENERAL NOTES:


1. MAKE SAFE ELECTRICAL CONNECTIONS TO EXISTING MECHANICAL EQUIPMENT BEING DEMOLISHED. REMOVE EXISTING BRANCH CIRCUIT CONDUCTORS TO NEAREST JUNCTION BOX OR RETAINED STRUCTURE AND PROTECT FOR REUSE. INTERCEPT AND MODIFY EXISTING RACEWAY SYSTEM AS REQUIRED TO ACCOMMODATE DEMOLITION OF EXISTING MECHANICAL EQUIPMENT AND CONNECTION OF NEW MECHANICAL EQUIPMENT. EXTEND BRANCH CIRCUIT CONDUCTORS AND MAKE FINAL CONNECTIONS. COORDINATE WITH DIV. 23 PRIOR TO COMMENCING WORK. SEE MECHANICAL DRAWINGS FOR ADDITIONAL DETAILS.
2. FIELD VERIFY EXISTING CONDITIONS PRIOR TO COMMENCING WORK.

KEYNOTES:

1. DEMOLISH EXISTING EQUIPMENT AND REPLACE WITH NEW AS INDICATED.
2. DEMOLISH EXISTING EQUIPMENT.

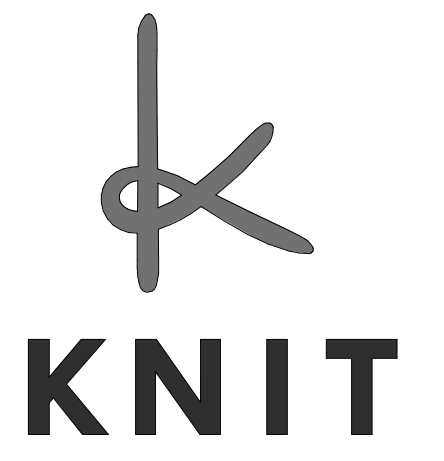

knitstudios.com
 THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSES OF CONTRACTING LINES AND MARKING THE PROJECT. KNIT AS THE ARCHITECT OF RECORD FOR THE PROJECT RETAINS OWNERSHIP OF THESE DOCUMENTS.
 ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.
 REPRODUCTION OF THESE DOCUMENTS IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.

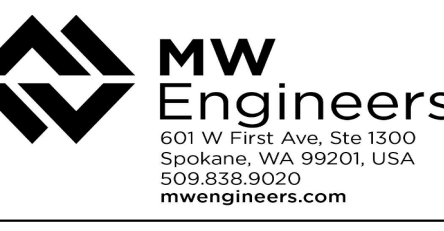

ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT
A	1/31/2025	Owner Revisions





DEMO ROOF PLAN - ELECTRICAL
FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE., MOSCOW, ID 83844
UNIVERSITY OF IDAHO

TITLE	PROJECT	CLIENT
DEMO ROOF PLAN - ELECTRICAL	FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)	UNIVERSITY OF IDAHO

JOB NO: **240004**
 CAPITAL PROJECT NO: **CP220034**
ED2-12

GENERAL NOTES:
 1. FIELD VERIFY EXISTING CONDITIONS PRIOR TO COMMENCING WORK

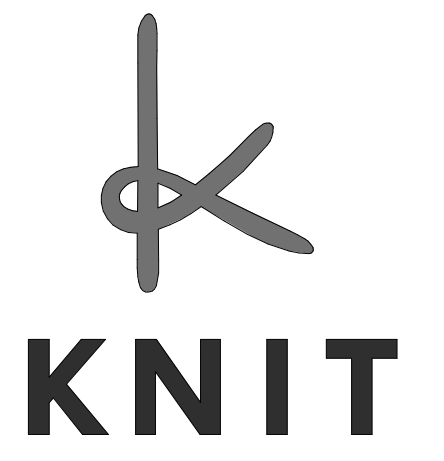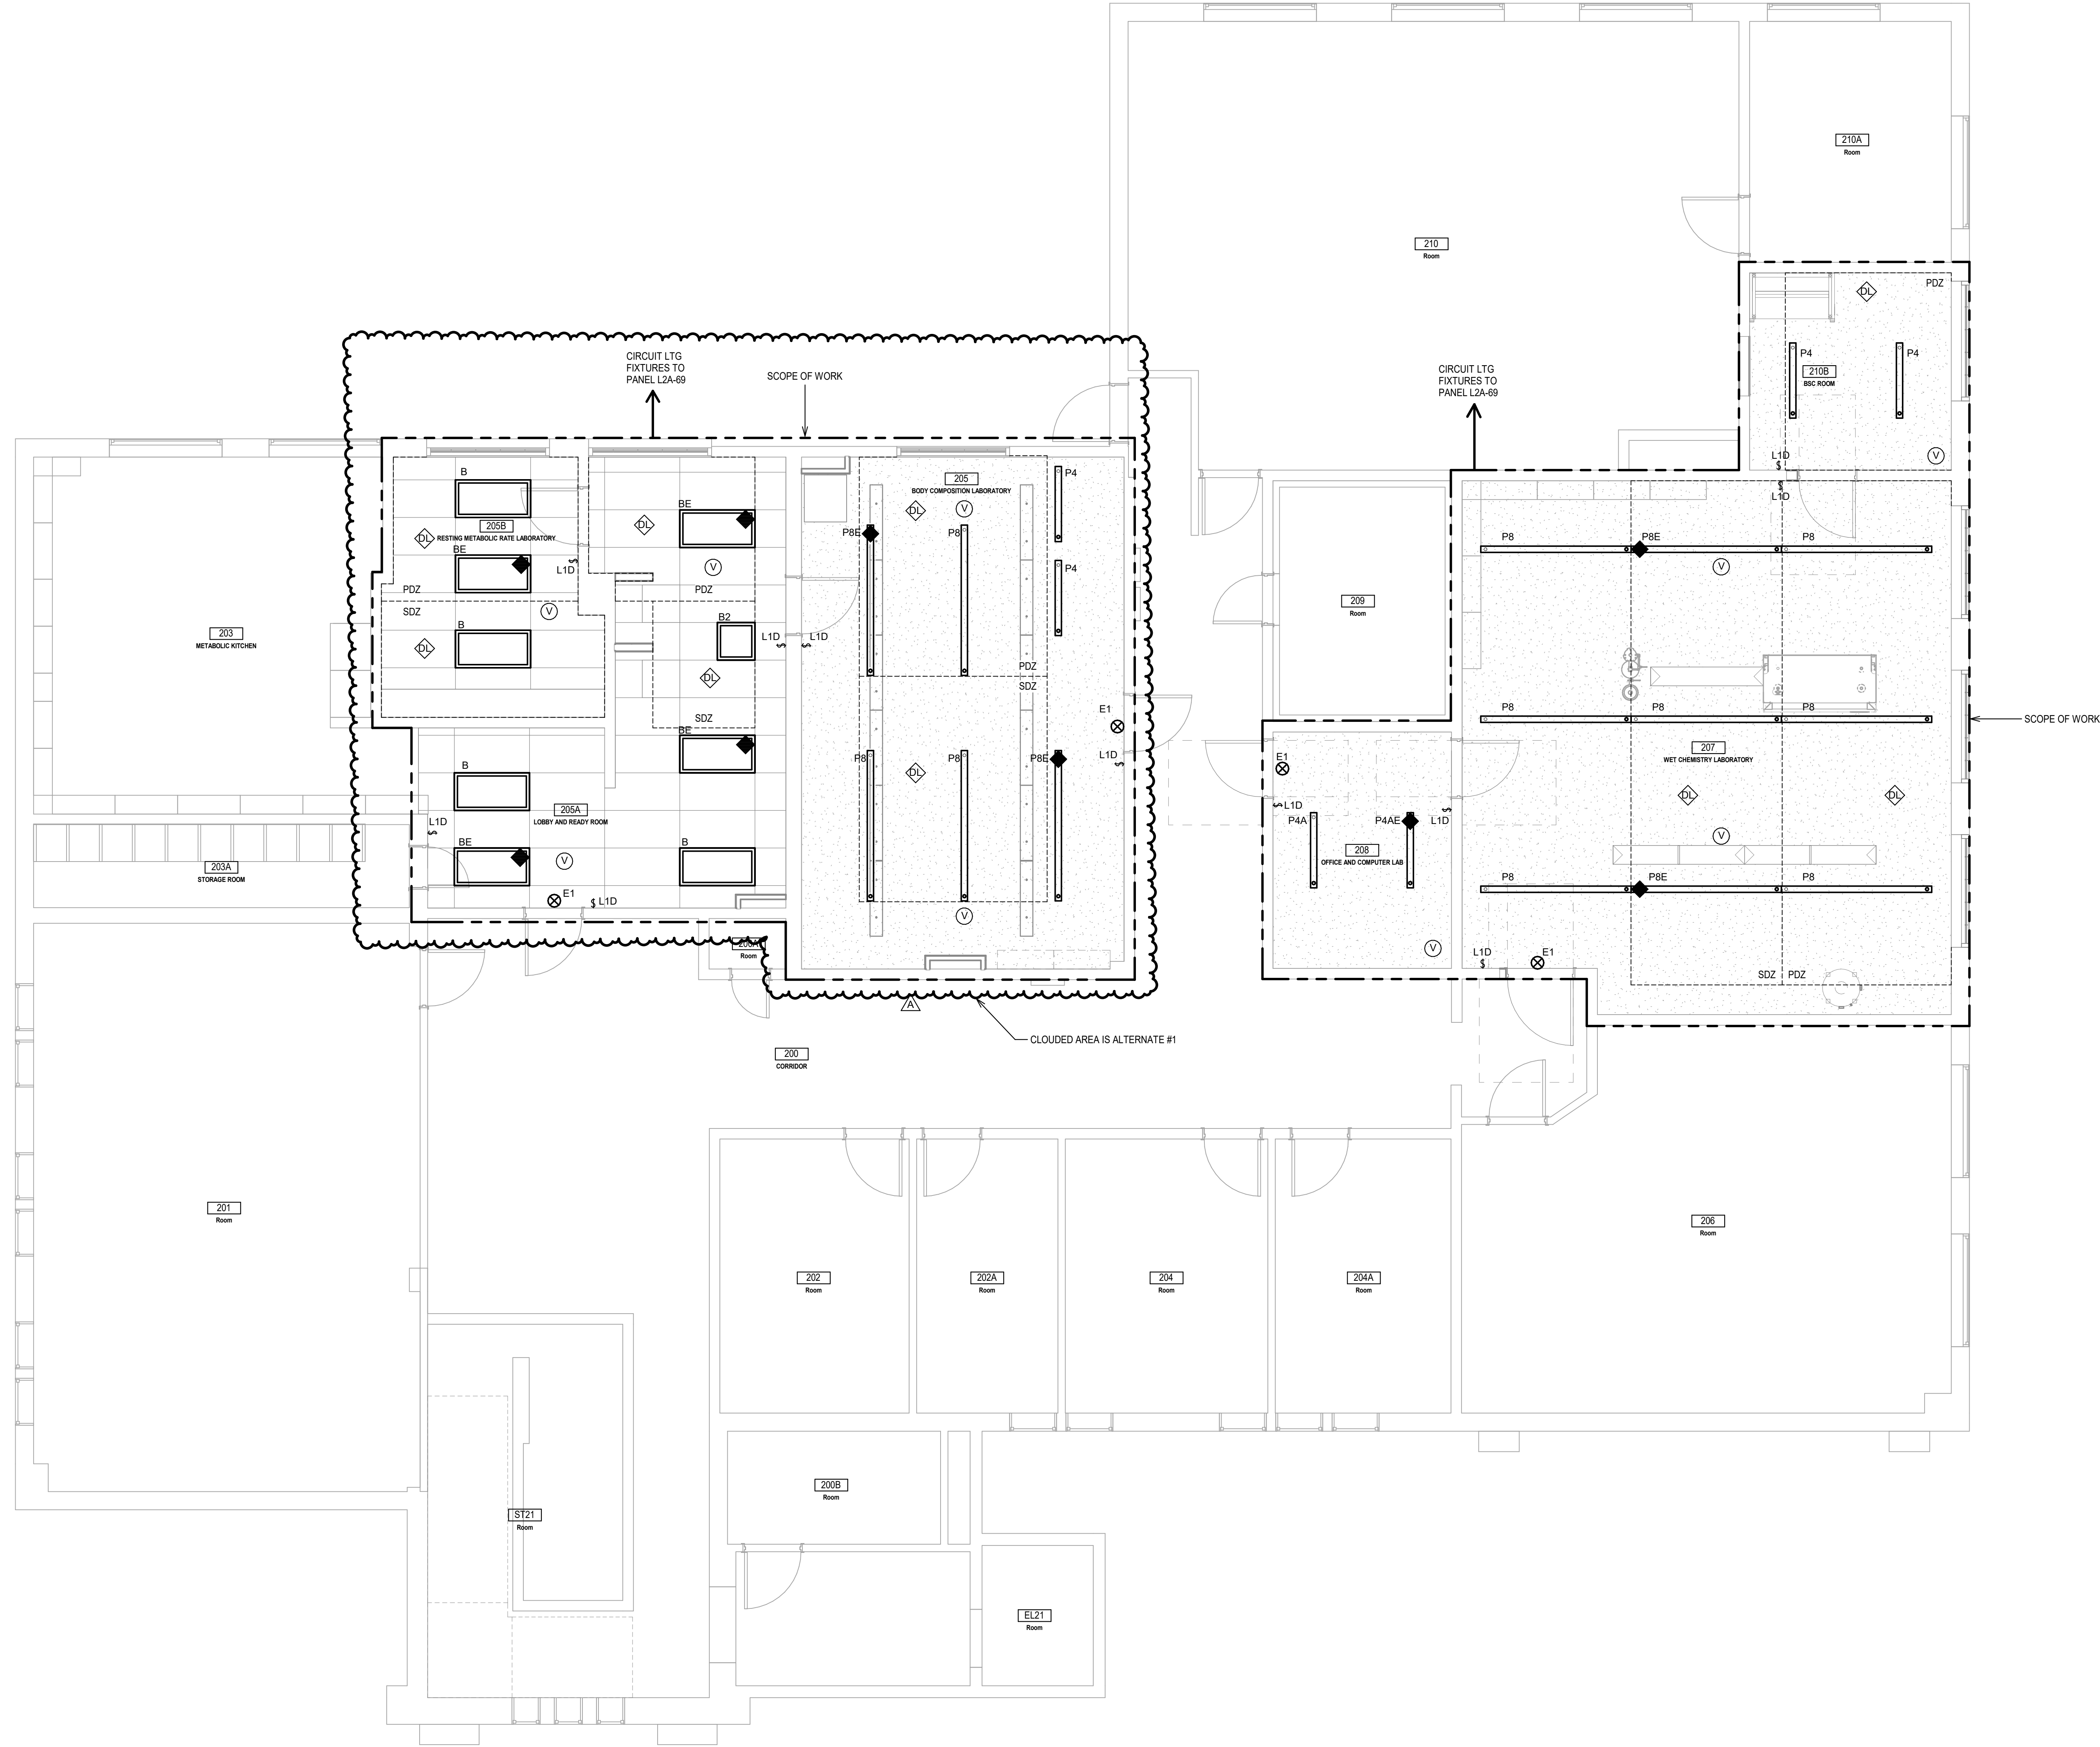

knitstudios.com
 THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSES OF CONTRACTING LINES AND MAINTAINING THE PROJECT. ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF K&N.
 REPRODUCTION OF THESE DOCUMENTS IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF K&N.



ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT
A	1/31/2025	Owner Revisions




FLOOR PLAN - LIGHTING
FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE., MOSCOW, ID 83844
UNIVERSITY OF IDAHO


TITLE	PROJECT	CLIENT

JOB NO: **240004**
 CAPITAL PROJECT NO: **CP220034**
EL2-11

LEVEL 2 - LIGHTING
 1/4" = 1'-0"

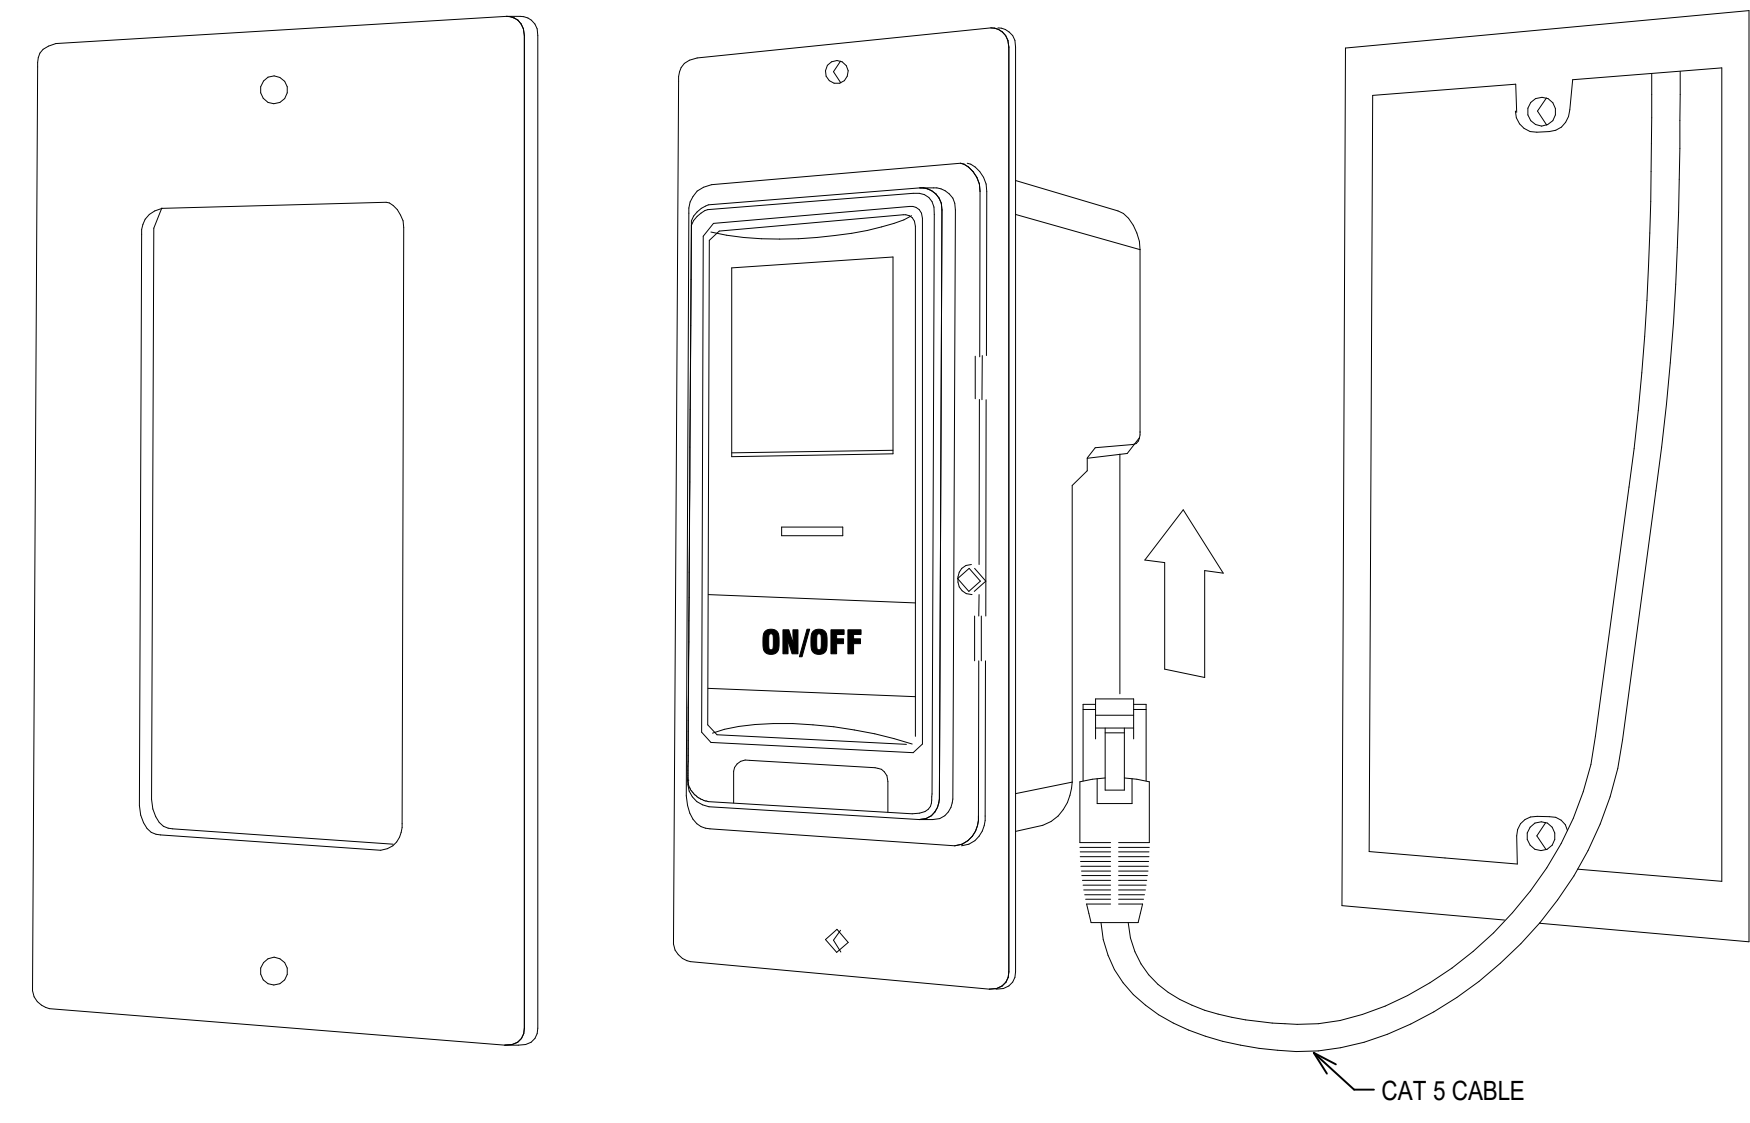

\$LVS **1 ZONE SWITCH WITH VACANCY (\$LVS) / OCCUPANCY (\$LOS) SENSOR**
\$LOS

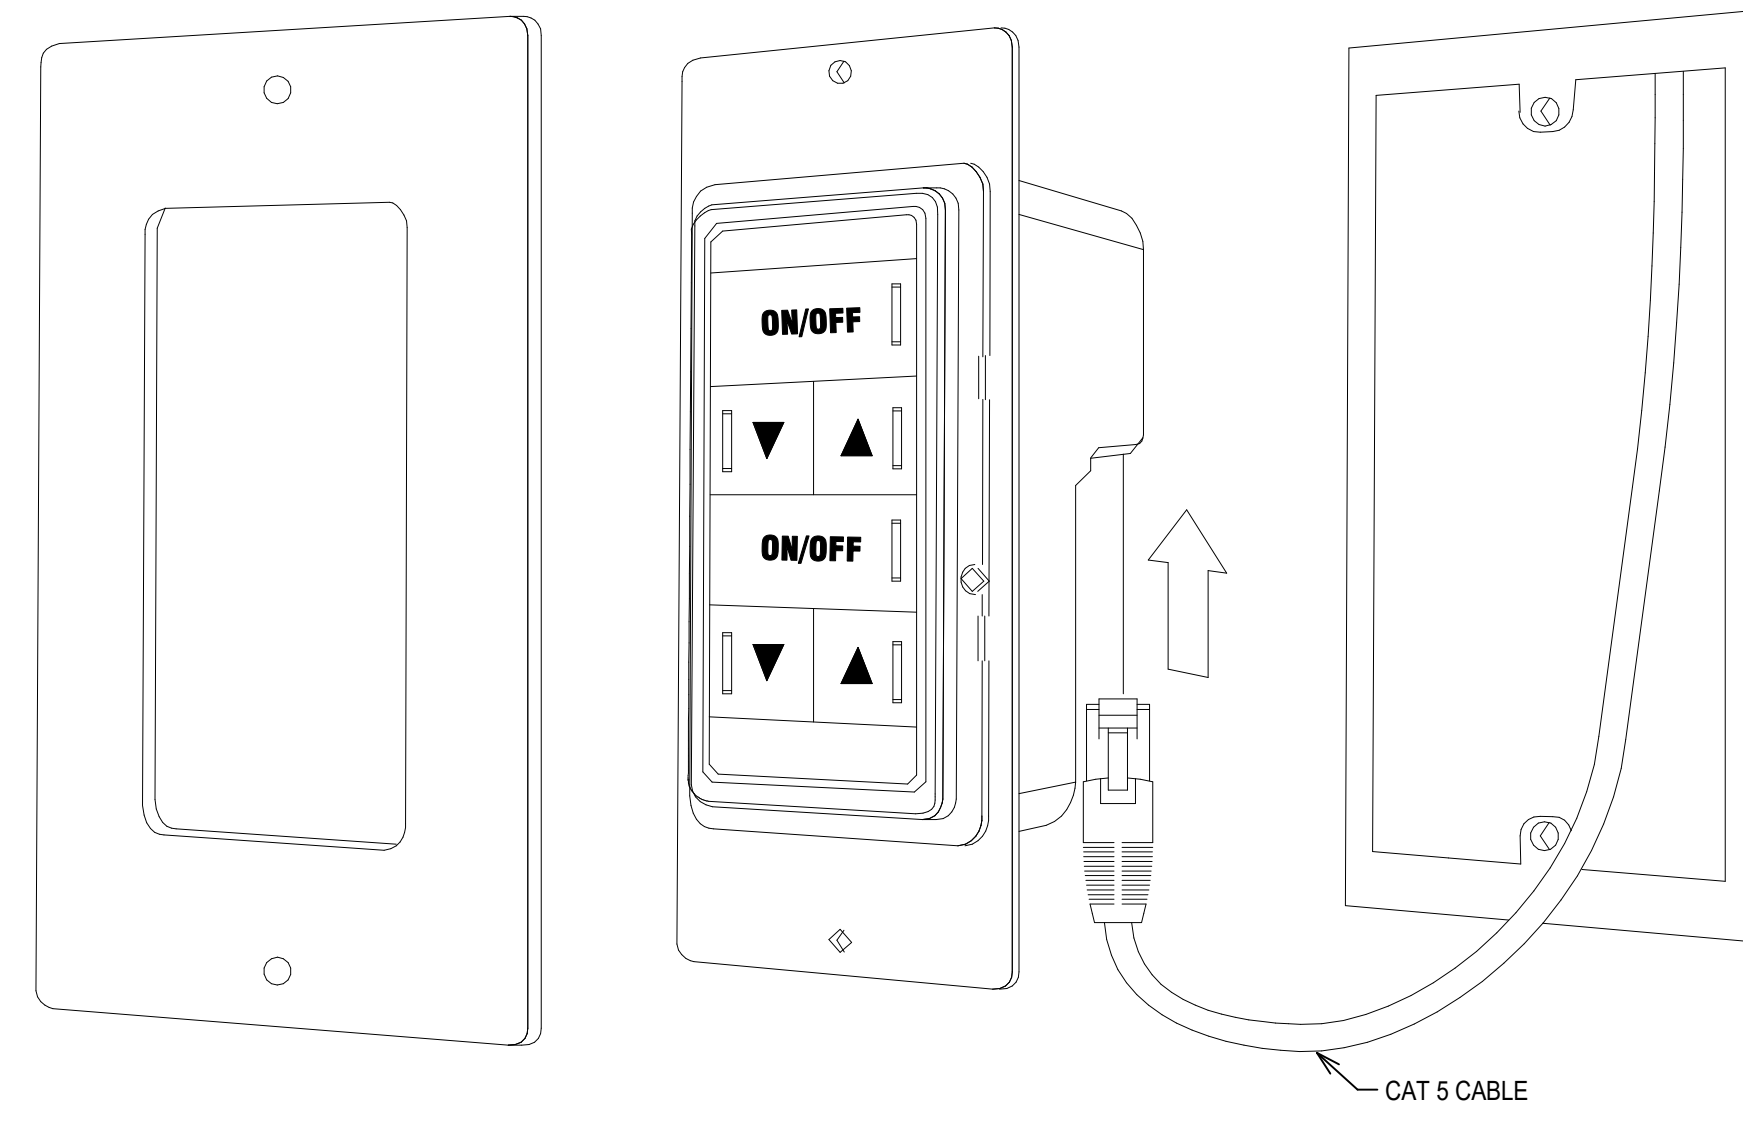


\$L2D **2 ZONE ON/OFF TOGGLE WITH DIMMING**


LIGHTING CONTROL NOTES:

- CORRIDORS, LOBBIES AND OTHER COMMON AREAS NOT SHOWN WITH OCCUPANCY SENSORS SHALL BE CONTROLLED VIA TIMESWEEP.
- EXTERIOR LIGHTING (NOT FACADE OR LANDSCAPE) SHALL REDUCE POWER DENSITY BY MINIMUM 30% BETWEEN 12AM AND 6AM PER ENERGY CODE.
- EXTERIOR FACADE AND LANDSCAPE LIGHTING SHALL BE CONTROLLED TO AUTOMATICALLY SHUT OFF DAWN TO DUSK VIA TIME CLOCK PER ENERGY CODE.


NOTE: NOT ALL DETAILS MAY BE INCLUDED IN PROJECT

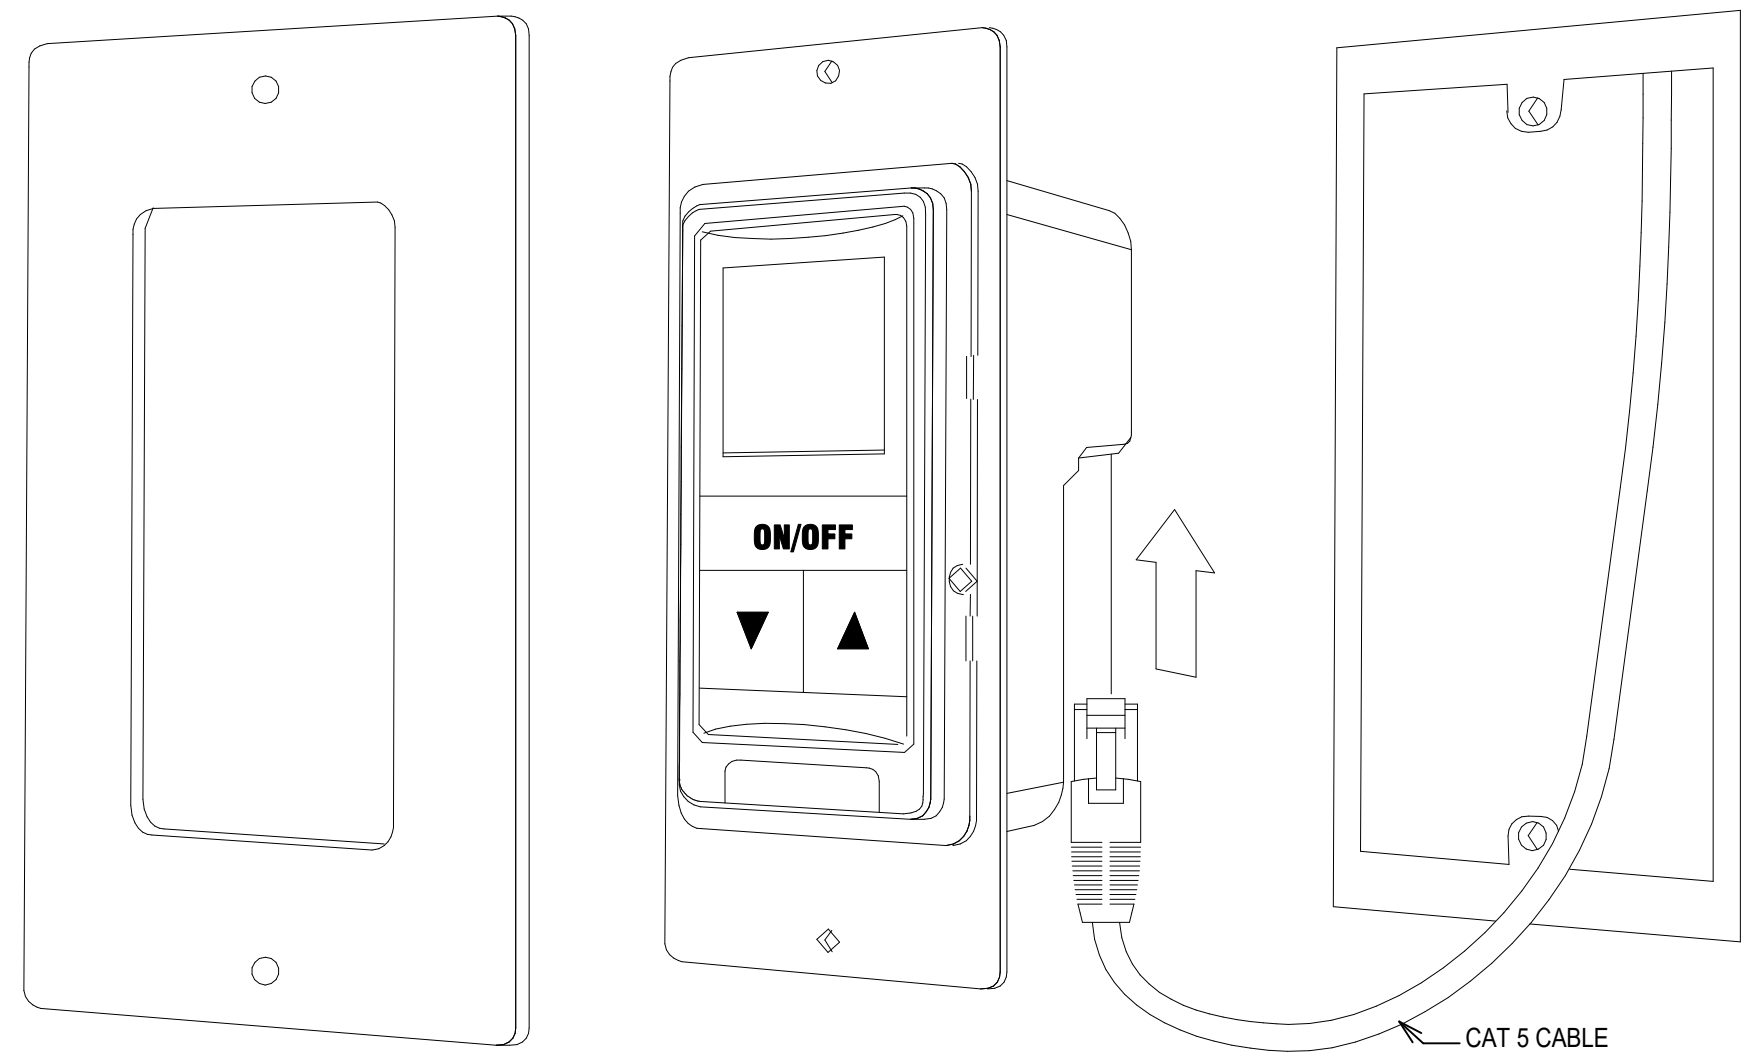


\$LVD **1 ZONE SWITCH WITH VACANCY (\$LVD) / OCCUPANCY (\$LOD) AND**
\$LOD **DIMMING CONTROL**

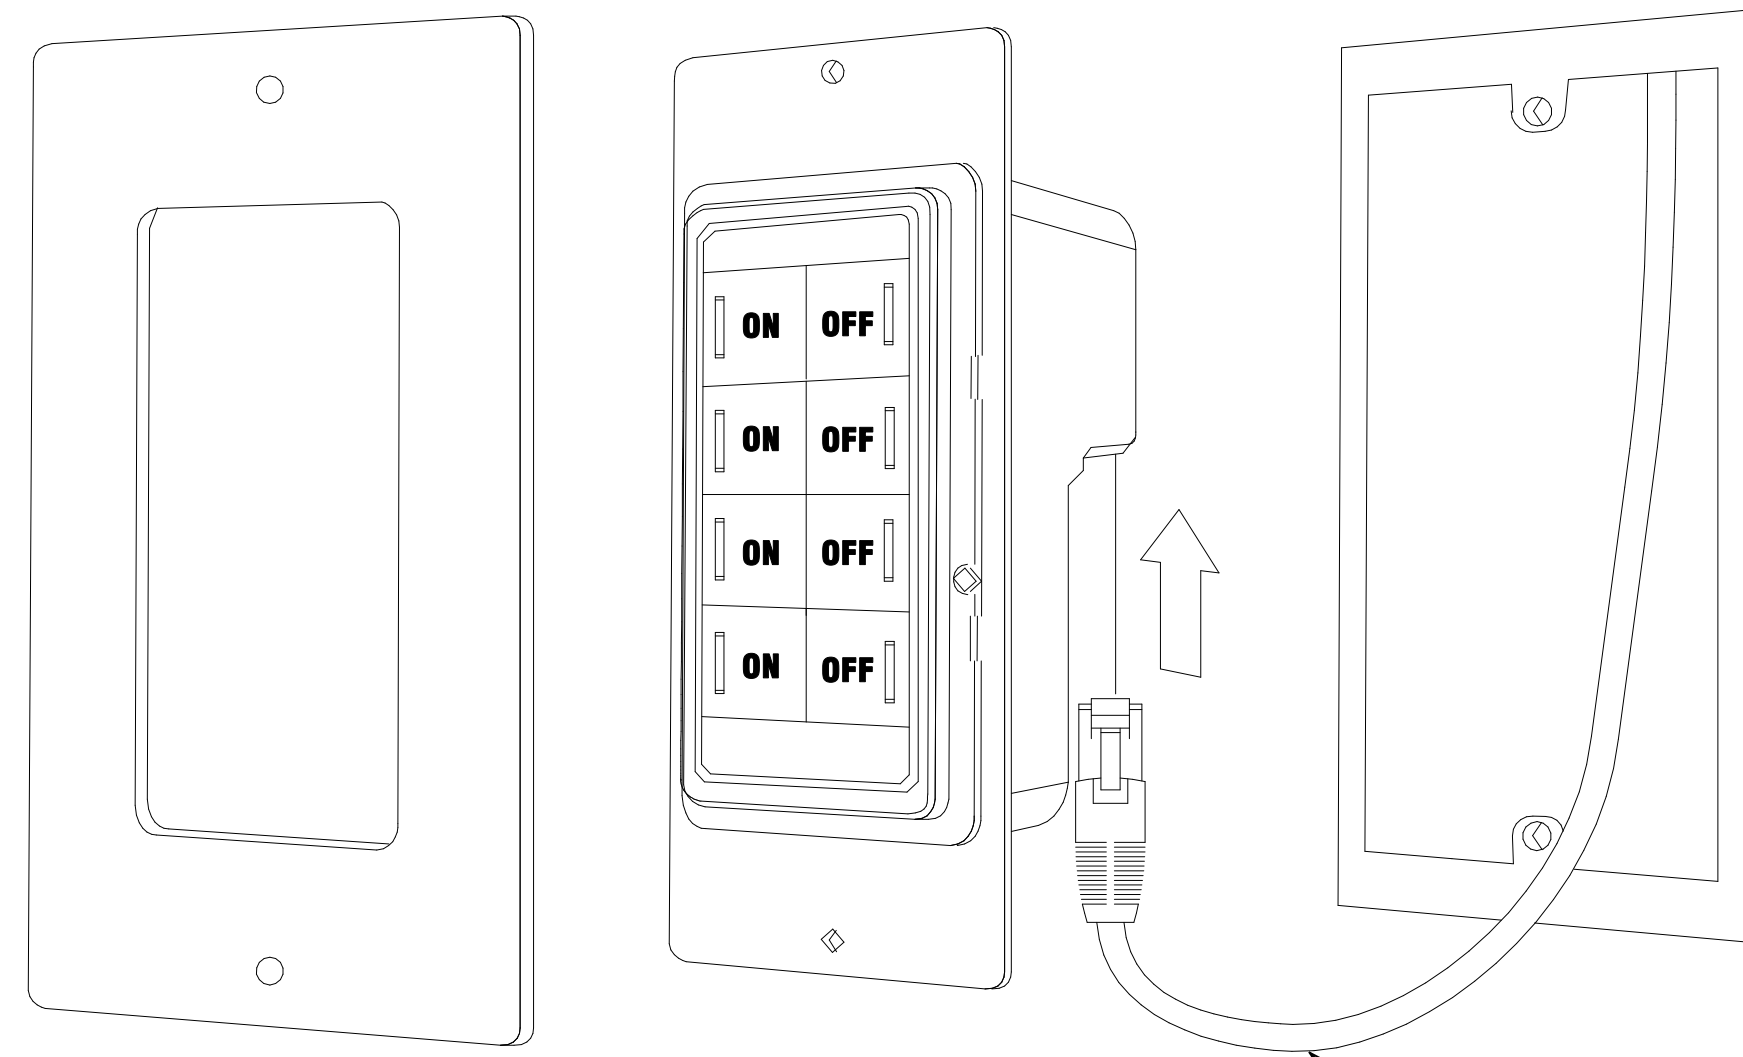


\$L4 **4 ZONE ON/OFF TOGGLE**

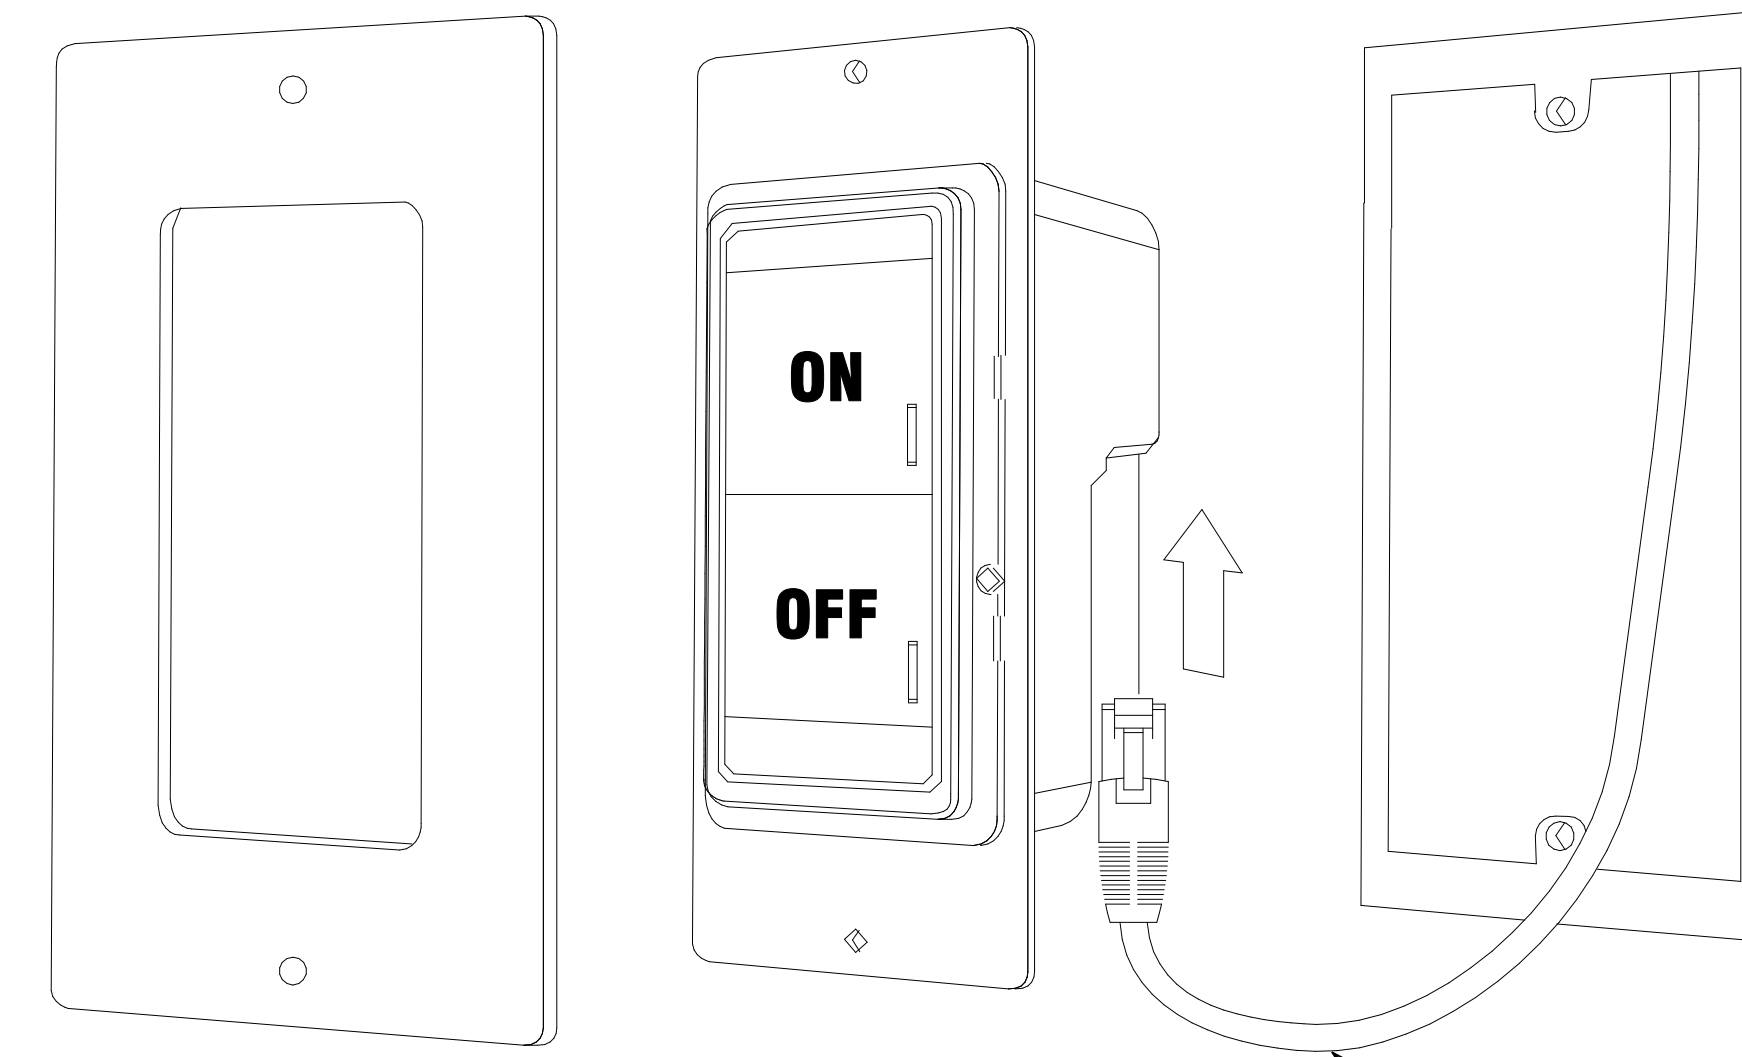


\$L1 **1 ZONE ON/OFF TOGGLE**

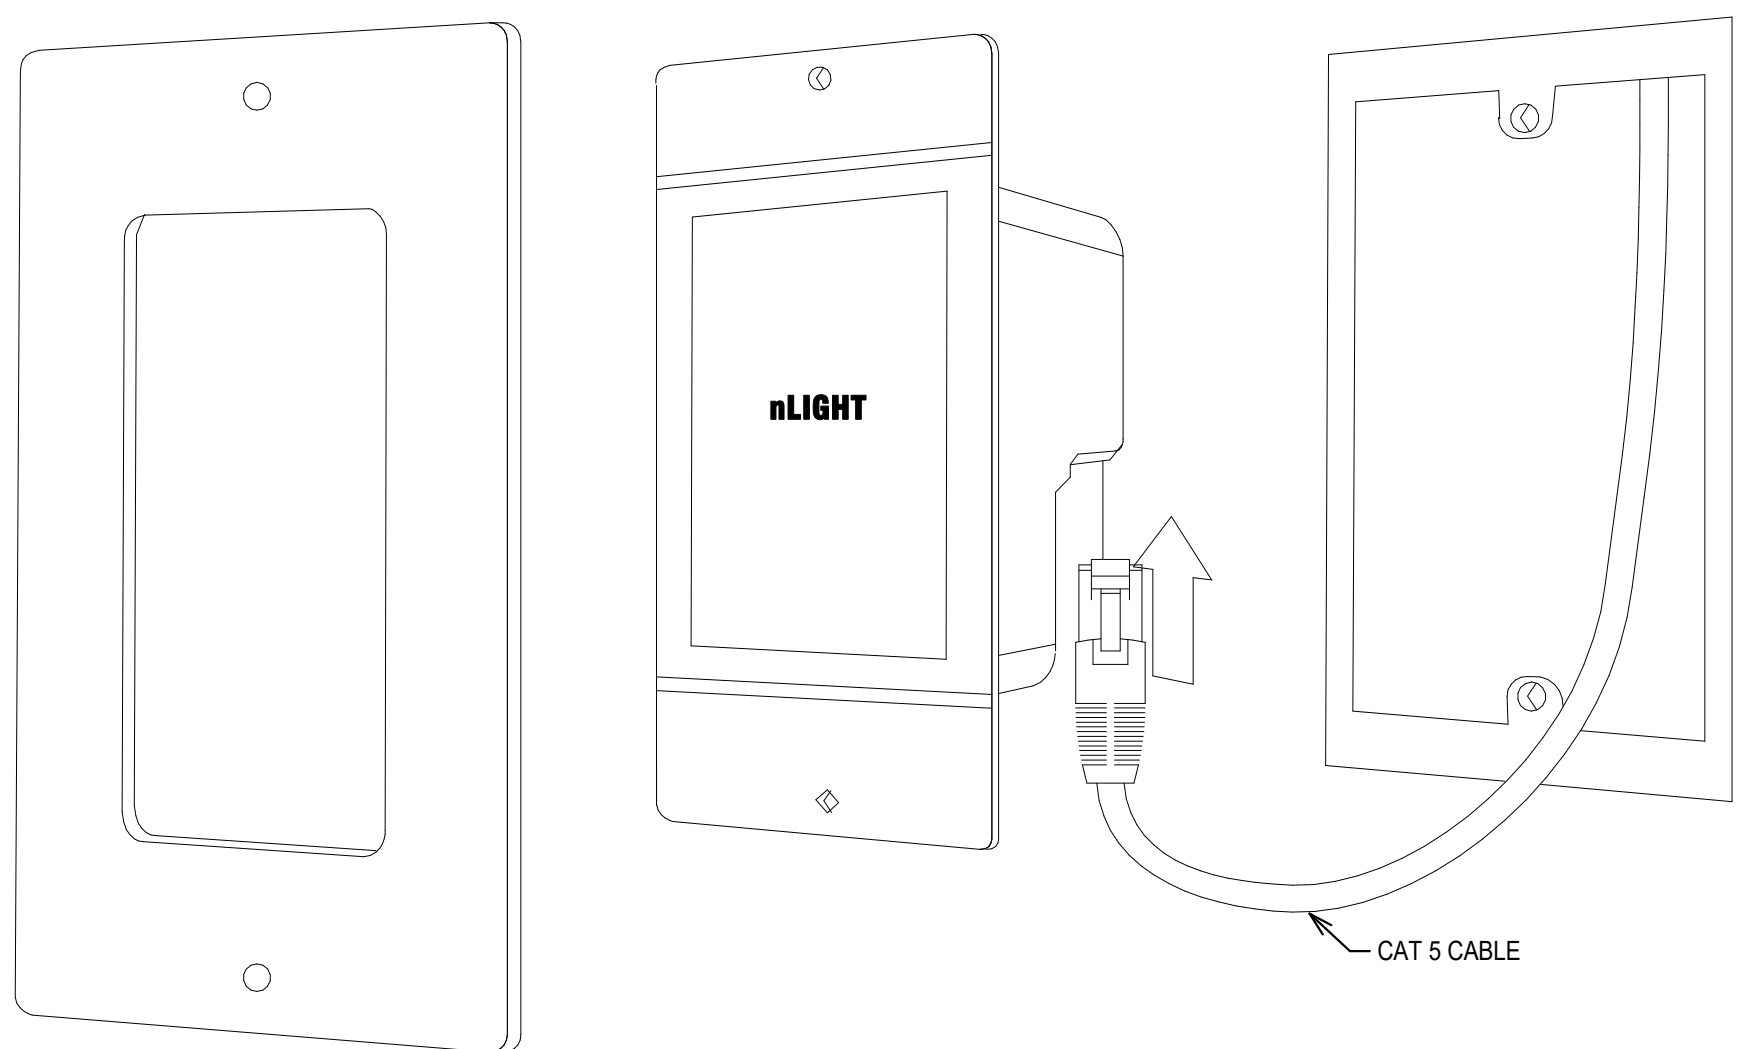


\$LTS **SWITCH - TOUCH SCREEN**

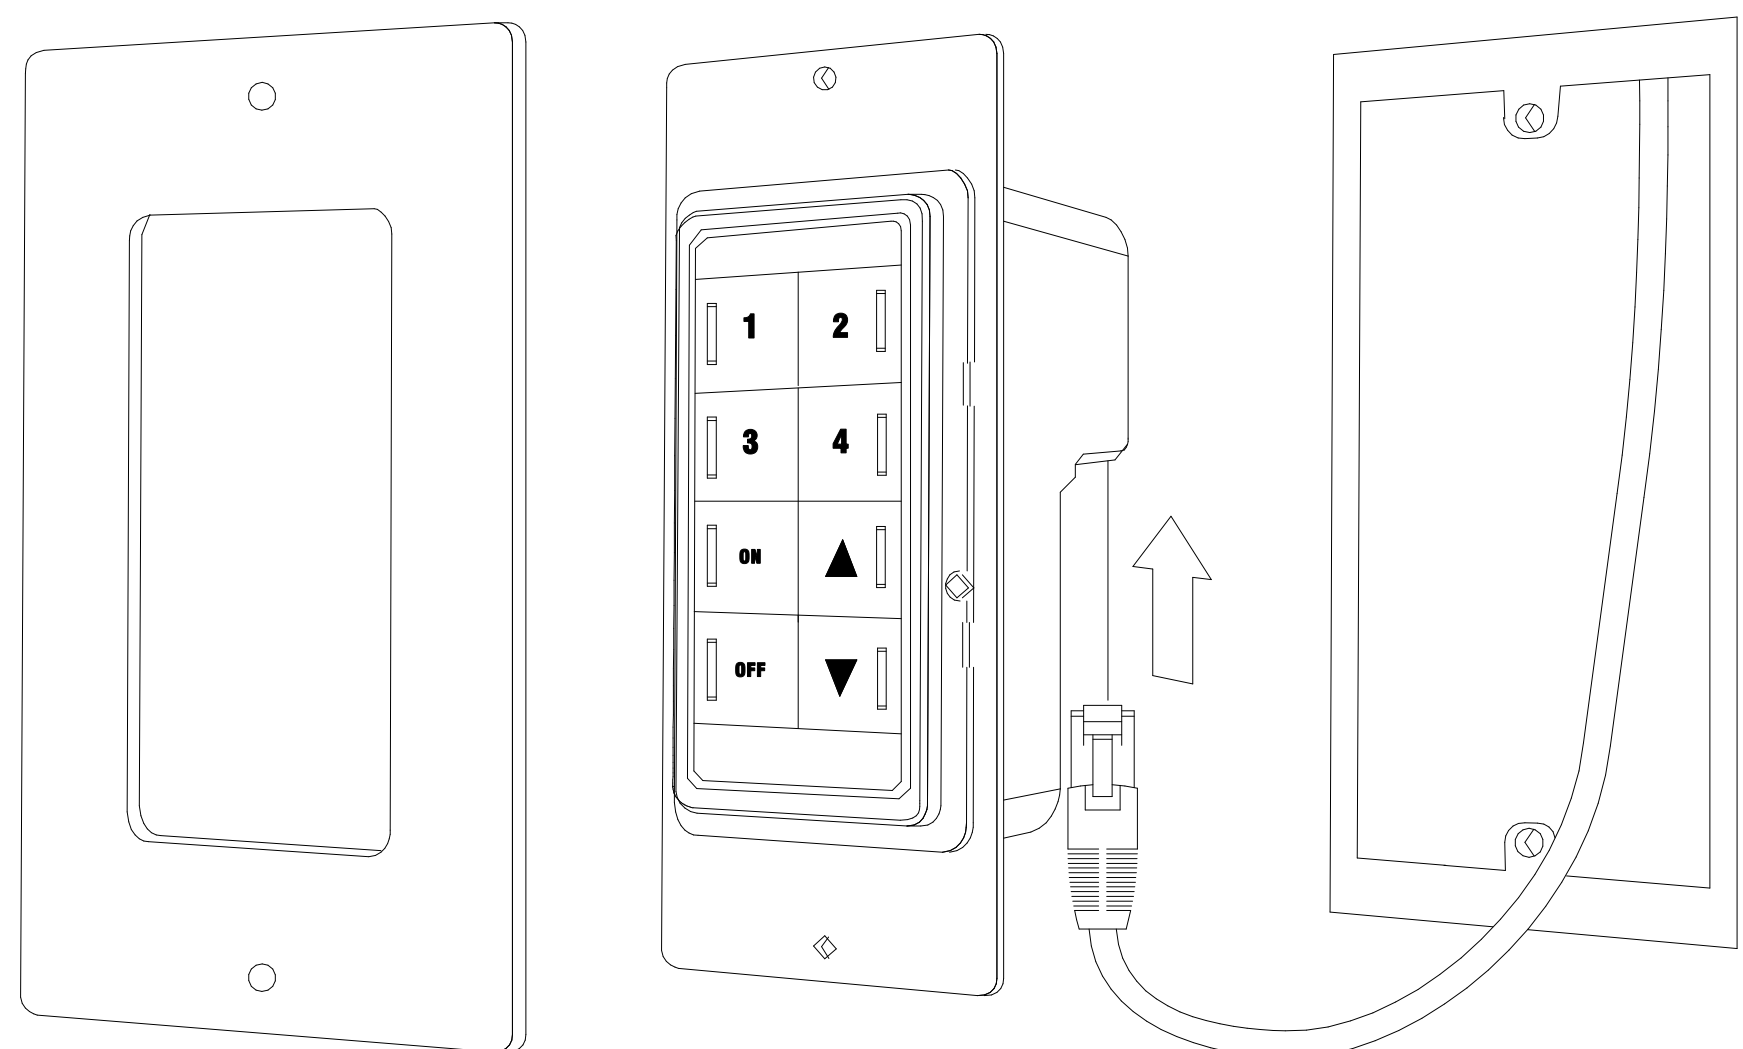


\$L4D **4 ZONE ON/OFF TOGGLE WITH DIMMING**

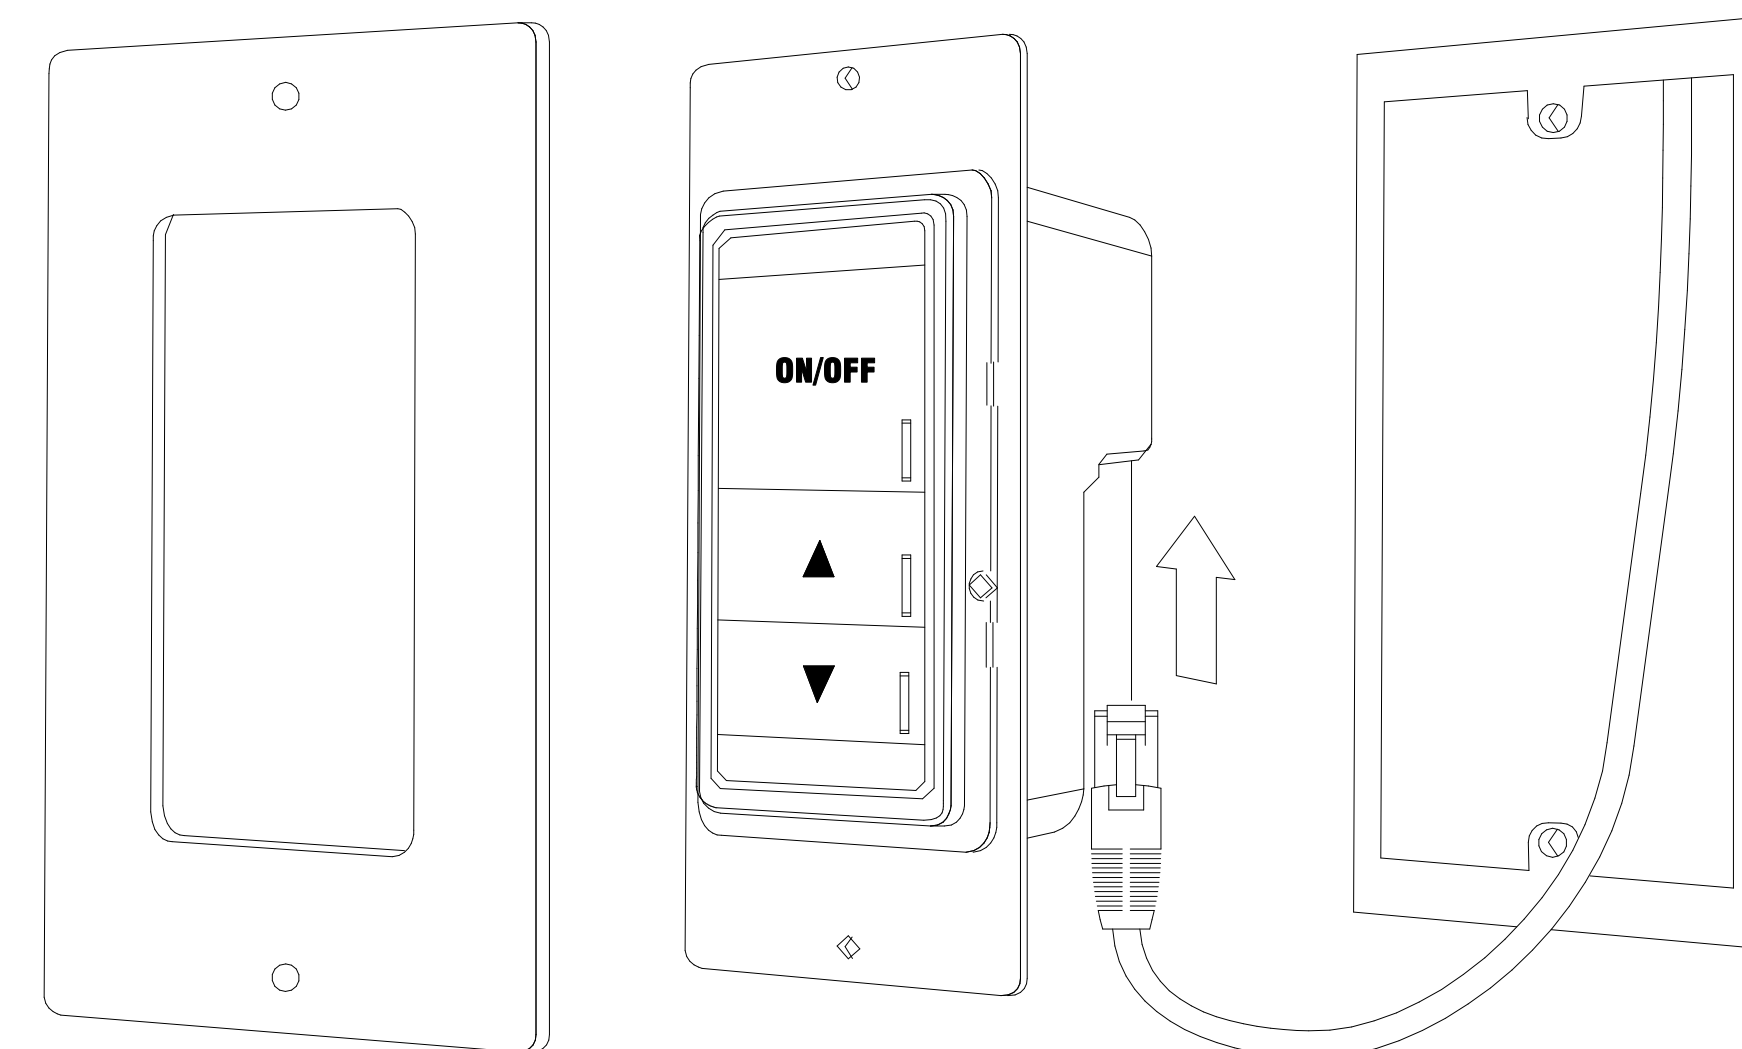


\$L1D **1 ZONE ON/OFF TOGGLE WITH DIMMING**

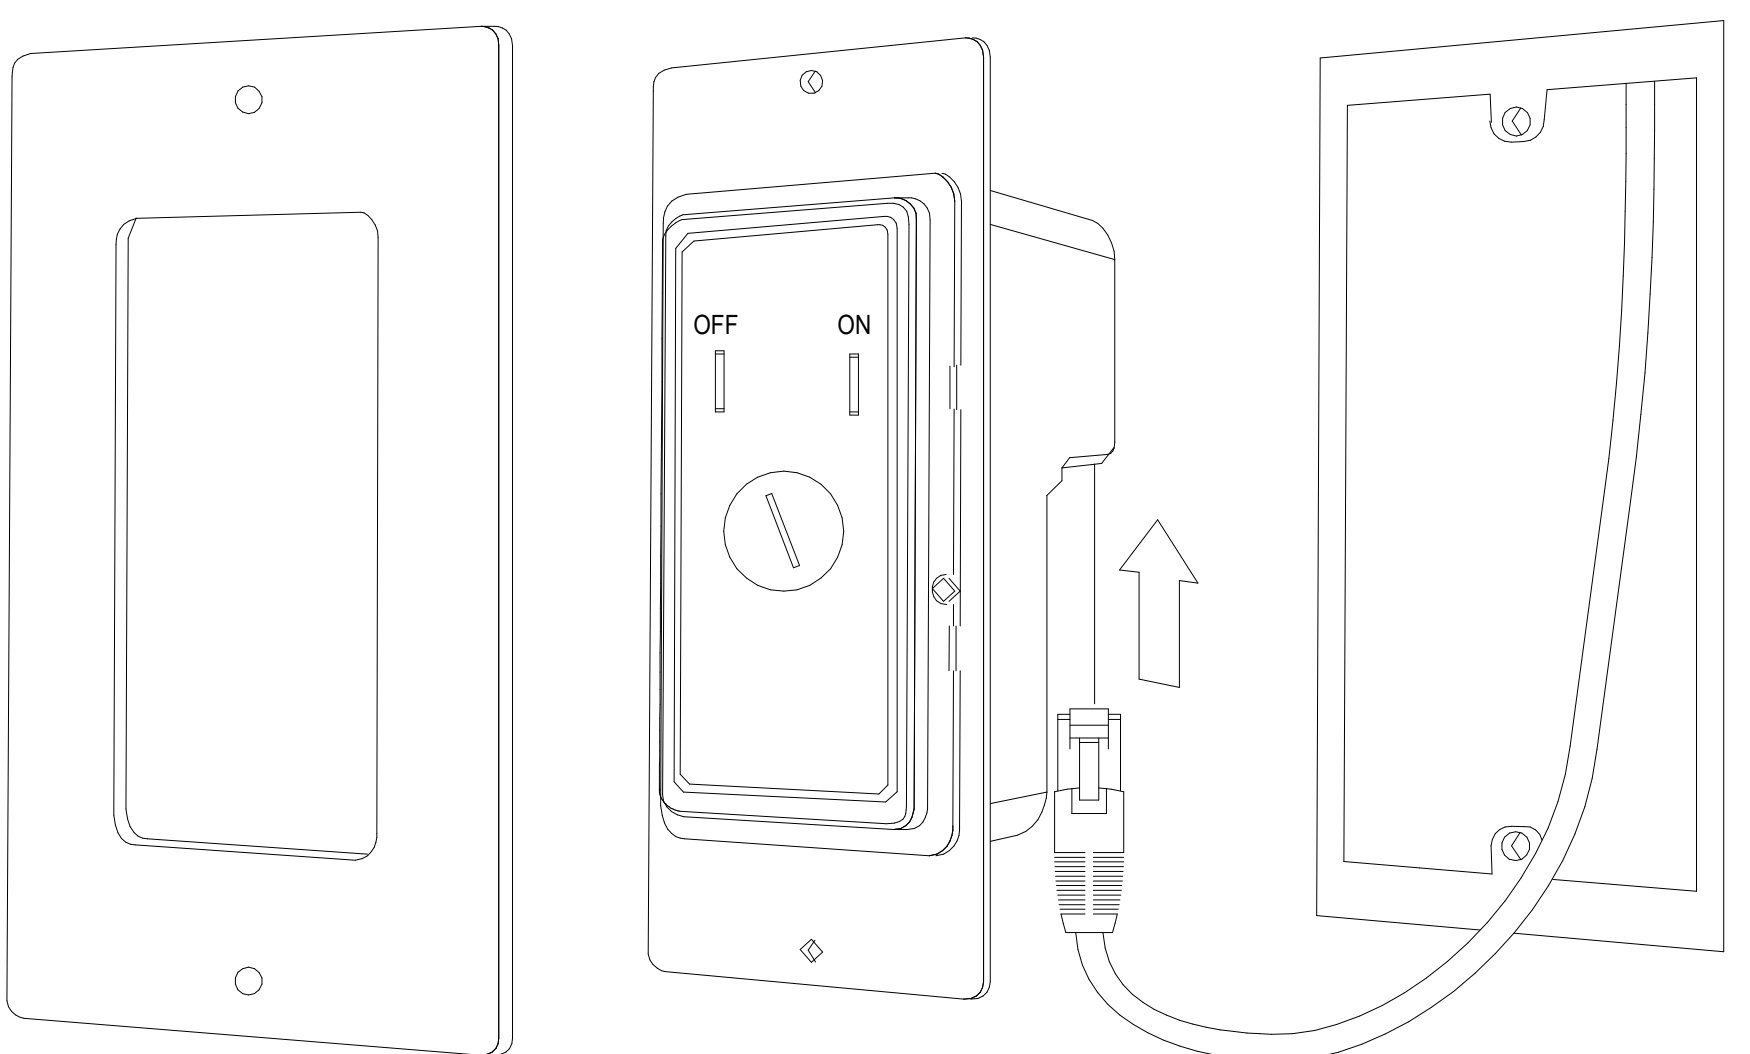

\$LK **KEYED ON/OFF**

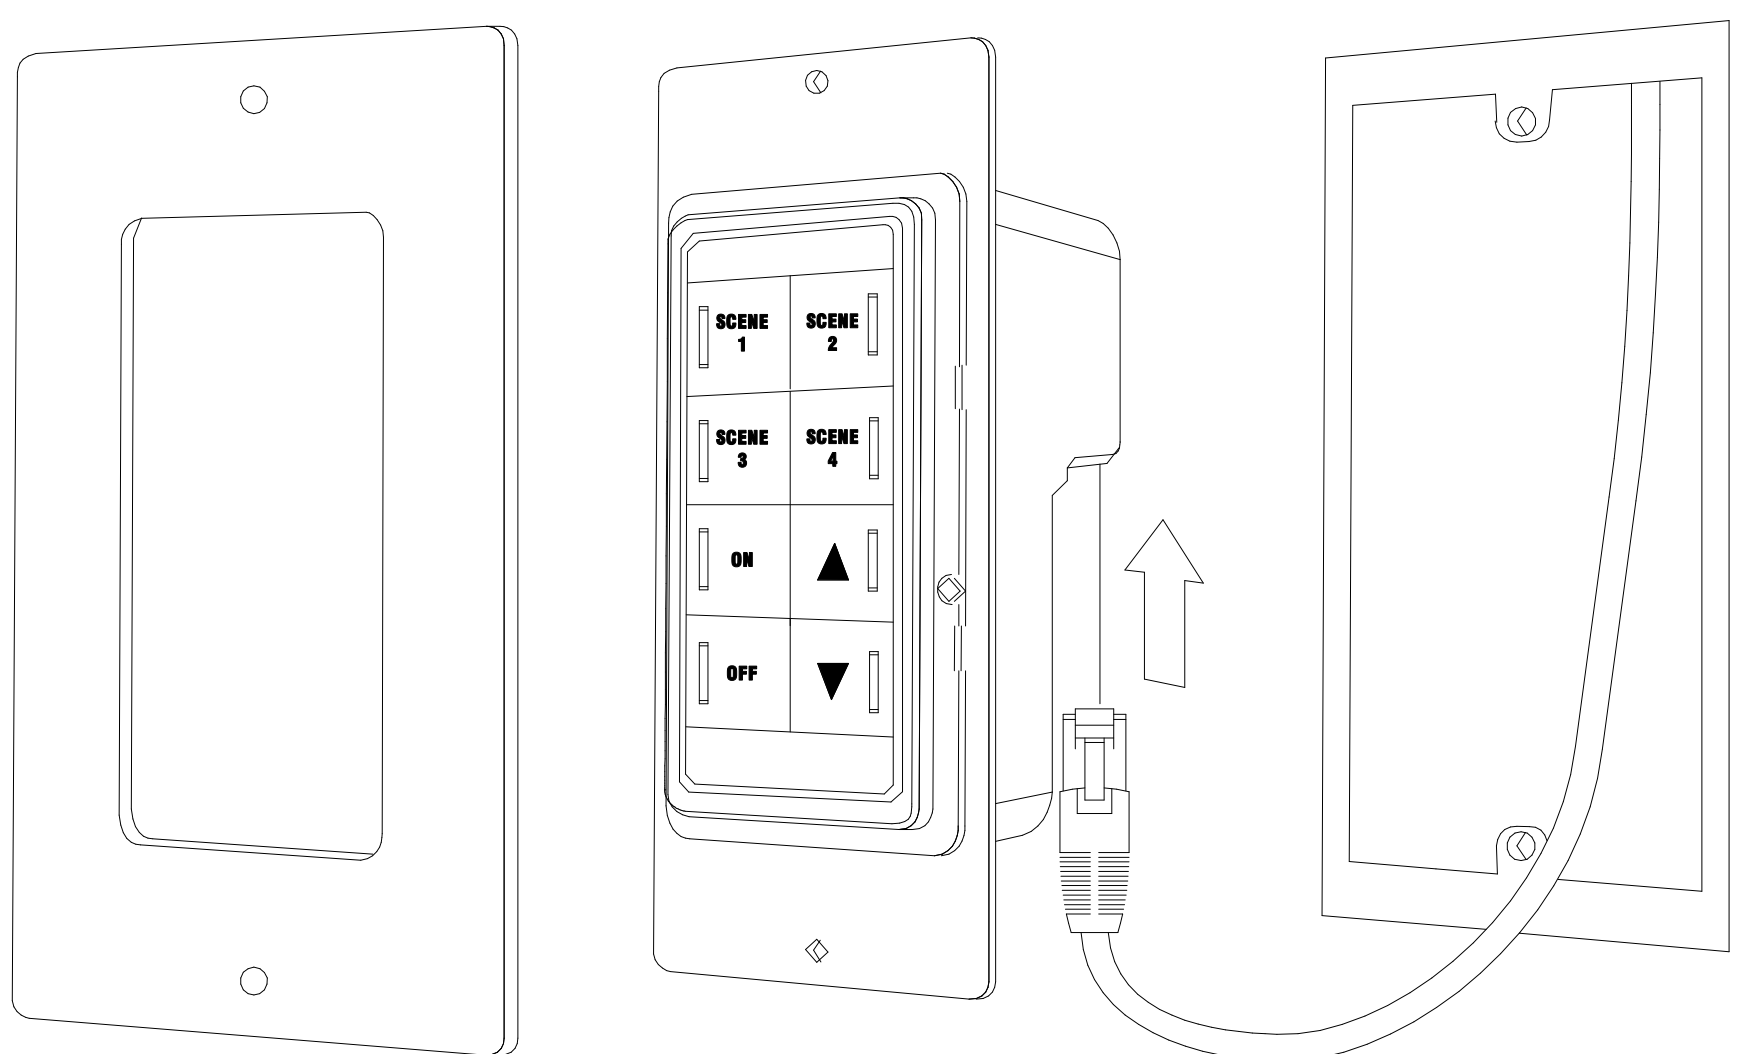

\$L4S **4 SCENE CONTROLLER WITH DIMMING**

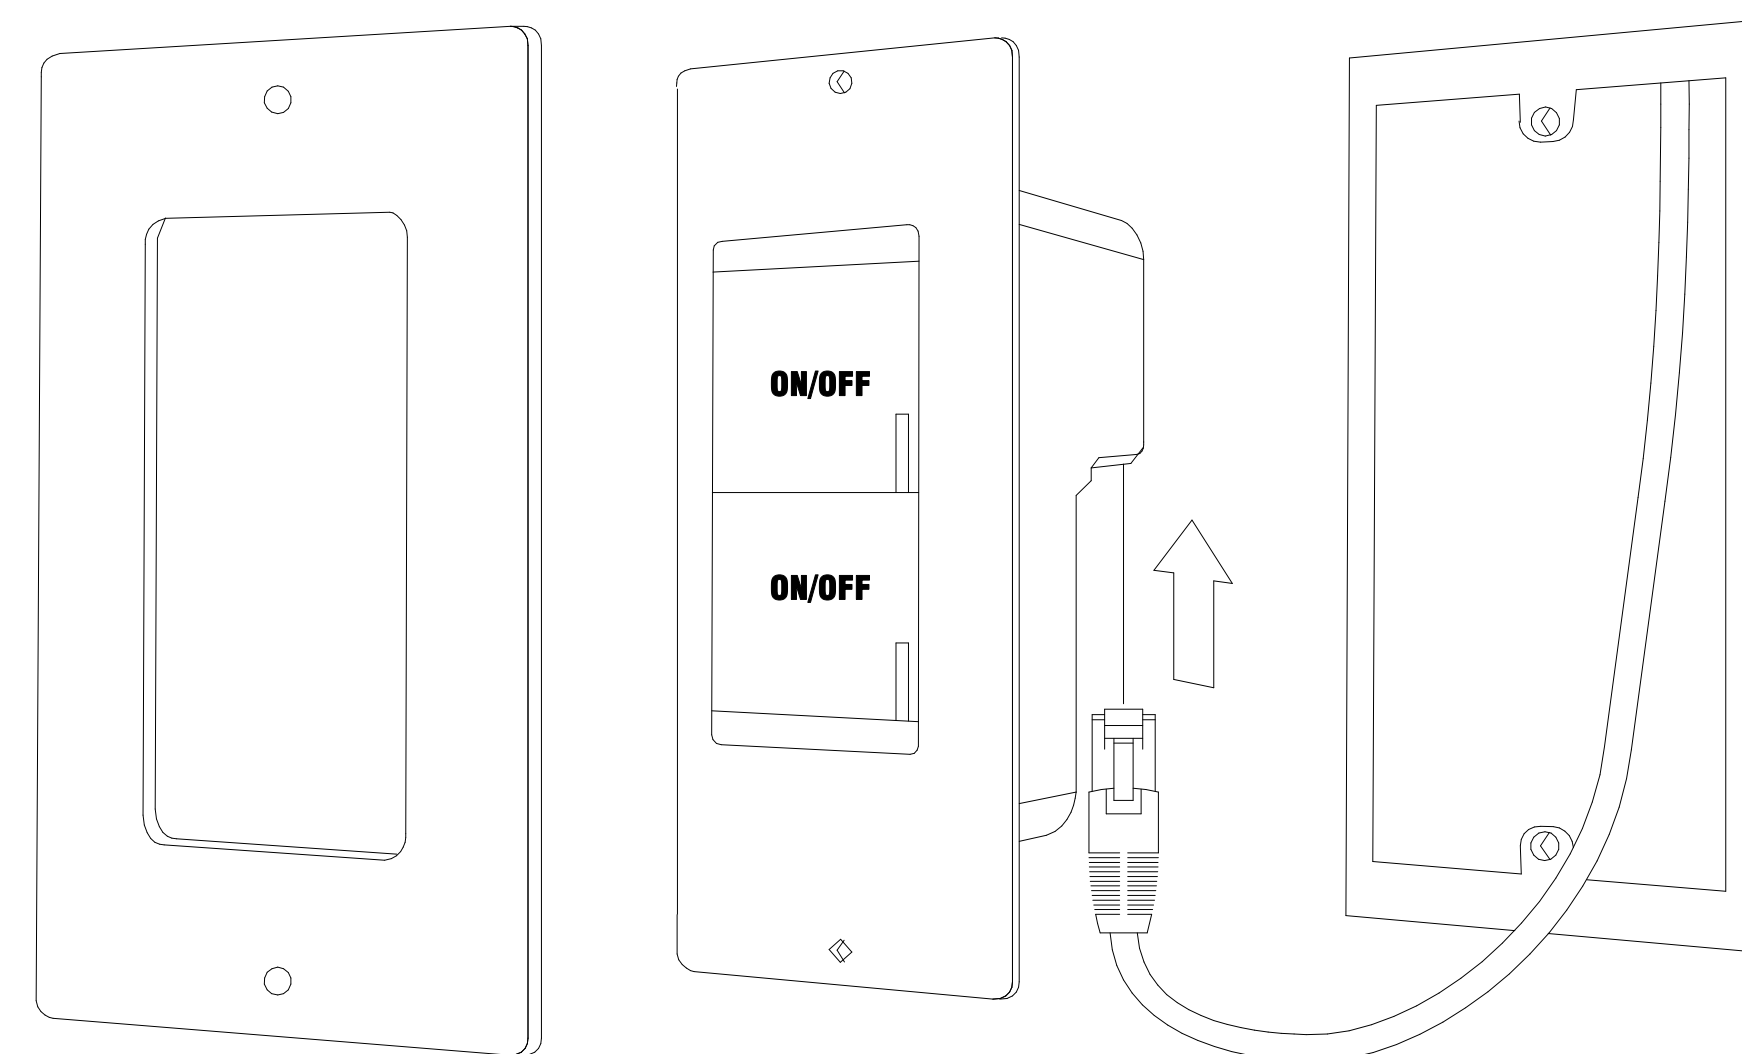

\$L2 **2 ZONE ON/OFF TOGGLE**




knitstudios.com
THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSE OF CONTRACTING LIGHTING AND MAINTAINING THE PROJECT AS THE ARCHITECT OF RECORD FOR THE PROJECT RETAINS OWNERSHIP OF THESE DOCUMENTS. ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DISCLOSED HEREIN IN WHOLE OR IN PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT. REPRODUCTION OF THESE DOCUMENTS IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.



ISSUE DATE: 12.20.2024


REV DATE COMMENT

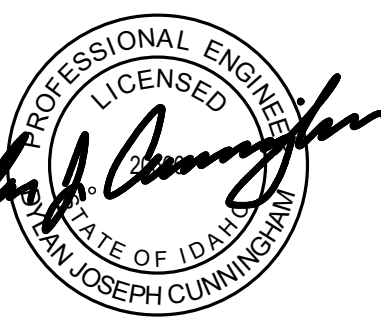

DETAILS - LIGHTING
FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)
860 IDAHO AVE., MOSCOW, ID 83844
UNIVERSITY OF IDAHO

TITLE PROJECT CLIENT
JOB NO: 240004
CAPITAL PROJECT NO: CP220034

EL5-01

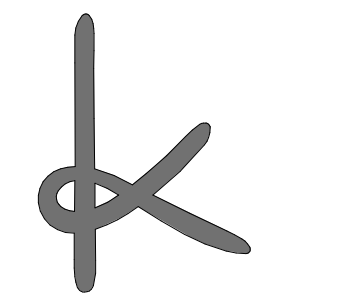

KNIT

knitstudios.com

THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSE OF CONTRACTING LIGHTING AND MAINTAINING THE PROJECT. ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT. REPRODUCTION OF THESE DOCUMENTS IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.




escent LIGHTING DESIGN

801 W First Ave, St 1300
Spokane, WA 99201 USA
509.838.8009
www.escentlighting.com/escent

ISSUE DATE: 12.20.2024

REV DATE COMMENT

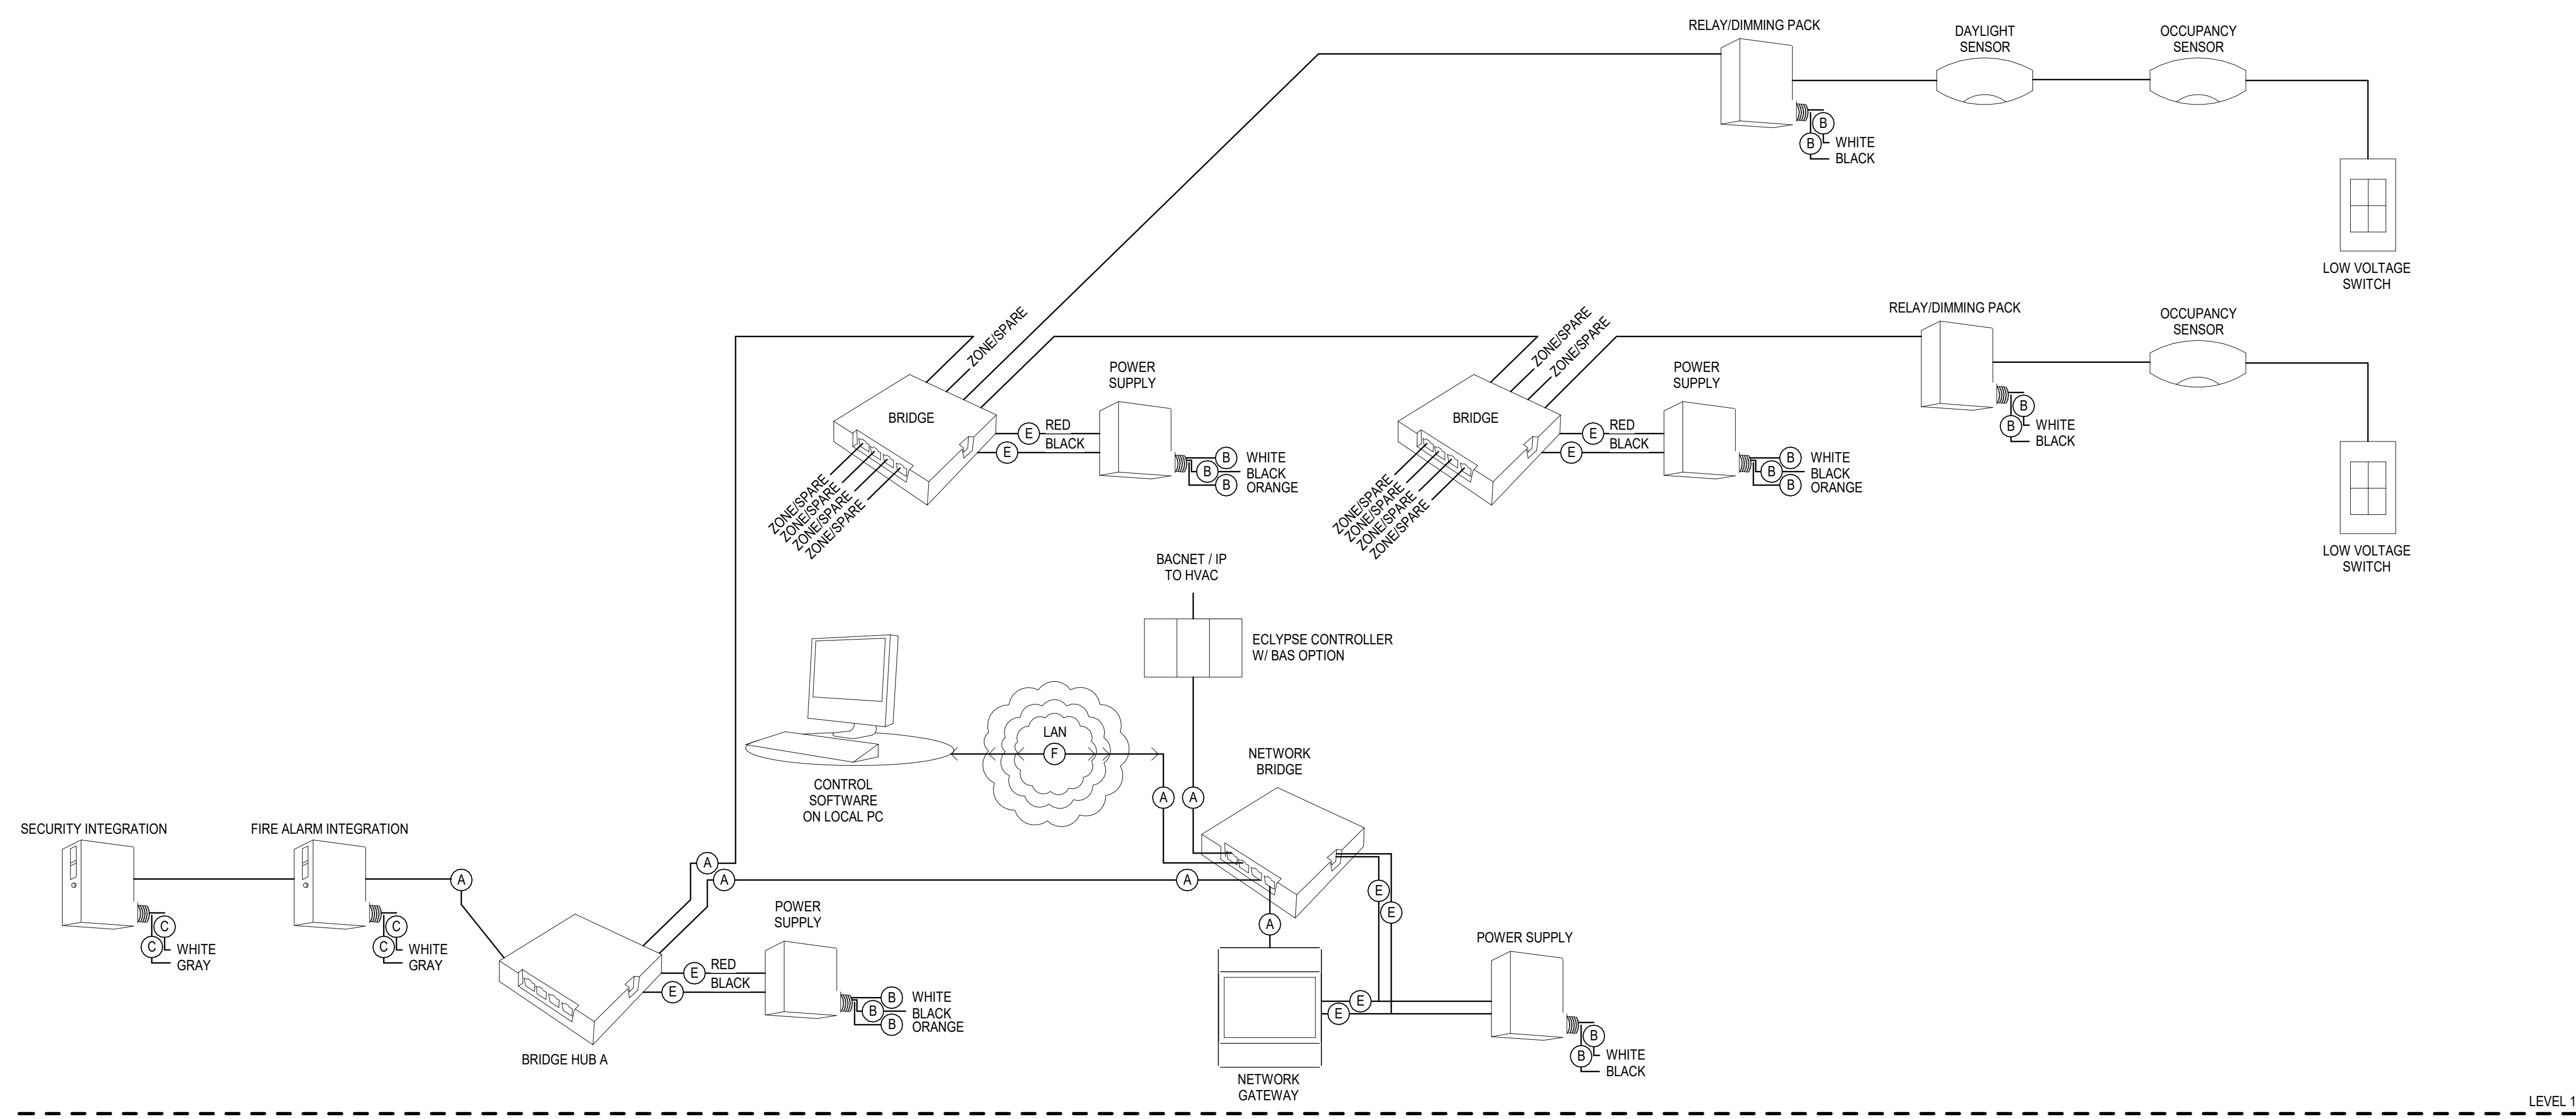

- NOTES:
1. LINE VOLTAGE AND LOW VOLTAGE WIRING SHOWN FOR REFERENCE ONLY. PLEASE REFER TO PRODUCT DATASHEETS FOR DETAILED WIRING INFORMATION.
 2. DO NOT CONNECT LINE VOLTAGE TO 0-10V WIRES ON LIGHT DEVICES.
 3. QUANTITY OF DEVICES SHOWN IS FOR DIAGRAMMATIC PURPOSES ONLY. CONTRACTOR SHALL PROVIDE THE APPROPRIATE AMOUNT OF DEVICES NEEDED TO ACHIEVE THE FUNCTIONALITY DESCRIBED ON THE FLOOR PLANS.
 4. FOR ROOMS SPECIFIED WITH TUNEABLE WHITE LIGHTING FIXTURES, PROVIDE WALL STATION WITH COMPATIBLE SCENE CONTROLS.

WIRE LEGEND	
(A)	CAT 5-E (CLASS 2)
(B)	LINE VOLTAGE
(C)	18/2 CONTACT CLOSURE
(D)	LOW VOLTAGE (1A @ 40 VDC/VAC)
(E)	15-24 VDC POWER
(F)	ETHERNET LAN (CLASS 2)

1 TYPICAL LIGHTING CONTROL RISER
N.T.S.

DETAILS - LIGHTING

FOOD RESEARCH CENTER TI - PHASE 1 (BUILDING #: 005)

860 IDAHO AVE., MOSCOW, ID 83844



UNIVERSITY OF IDAHO

TITLE	PROJECT	CLIENT

JOB NO: 240004
CAPITAL PROJECT NO: CP220034

EL5-02

GENERAL NOTES:
 1. FIELD VERIFY EXISTING CONDITIONS PRIOR TO COMMENCING WORK

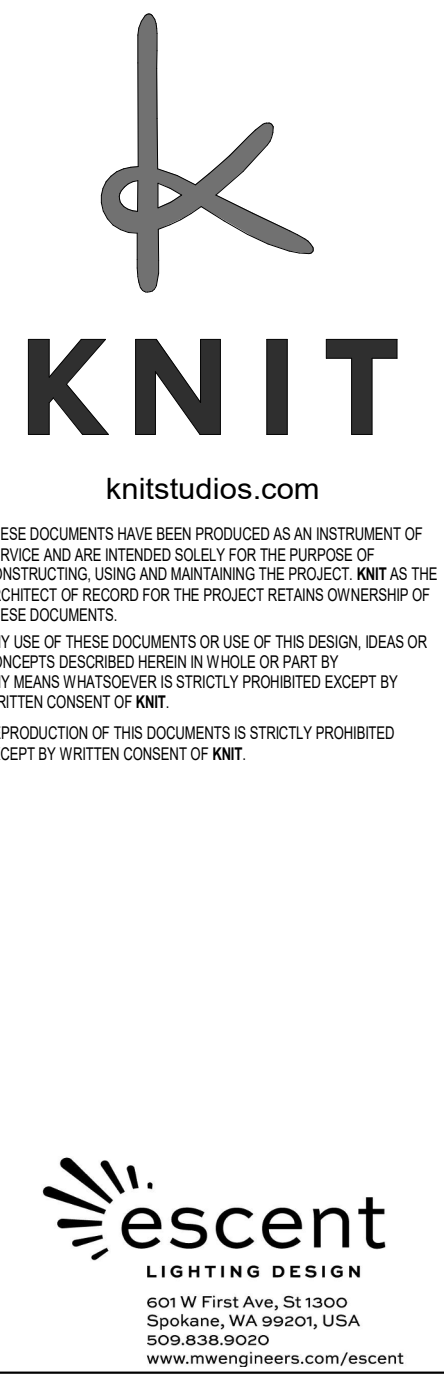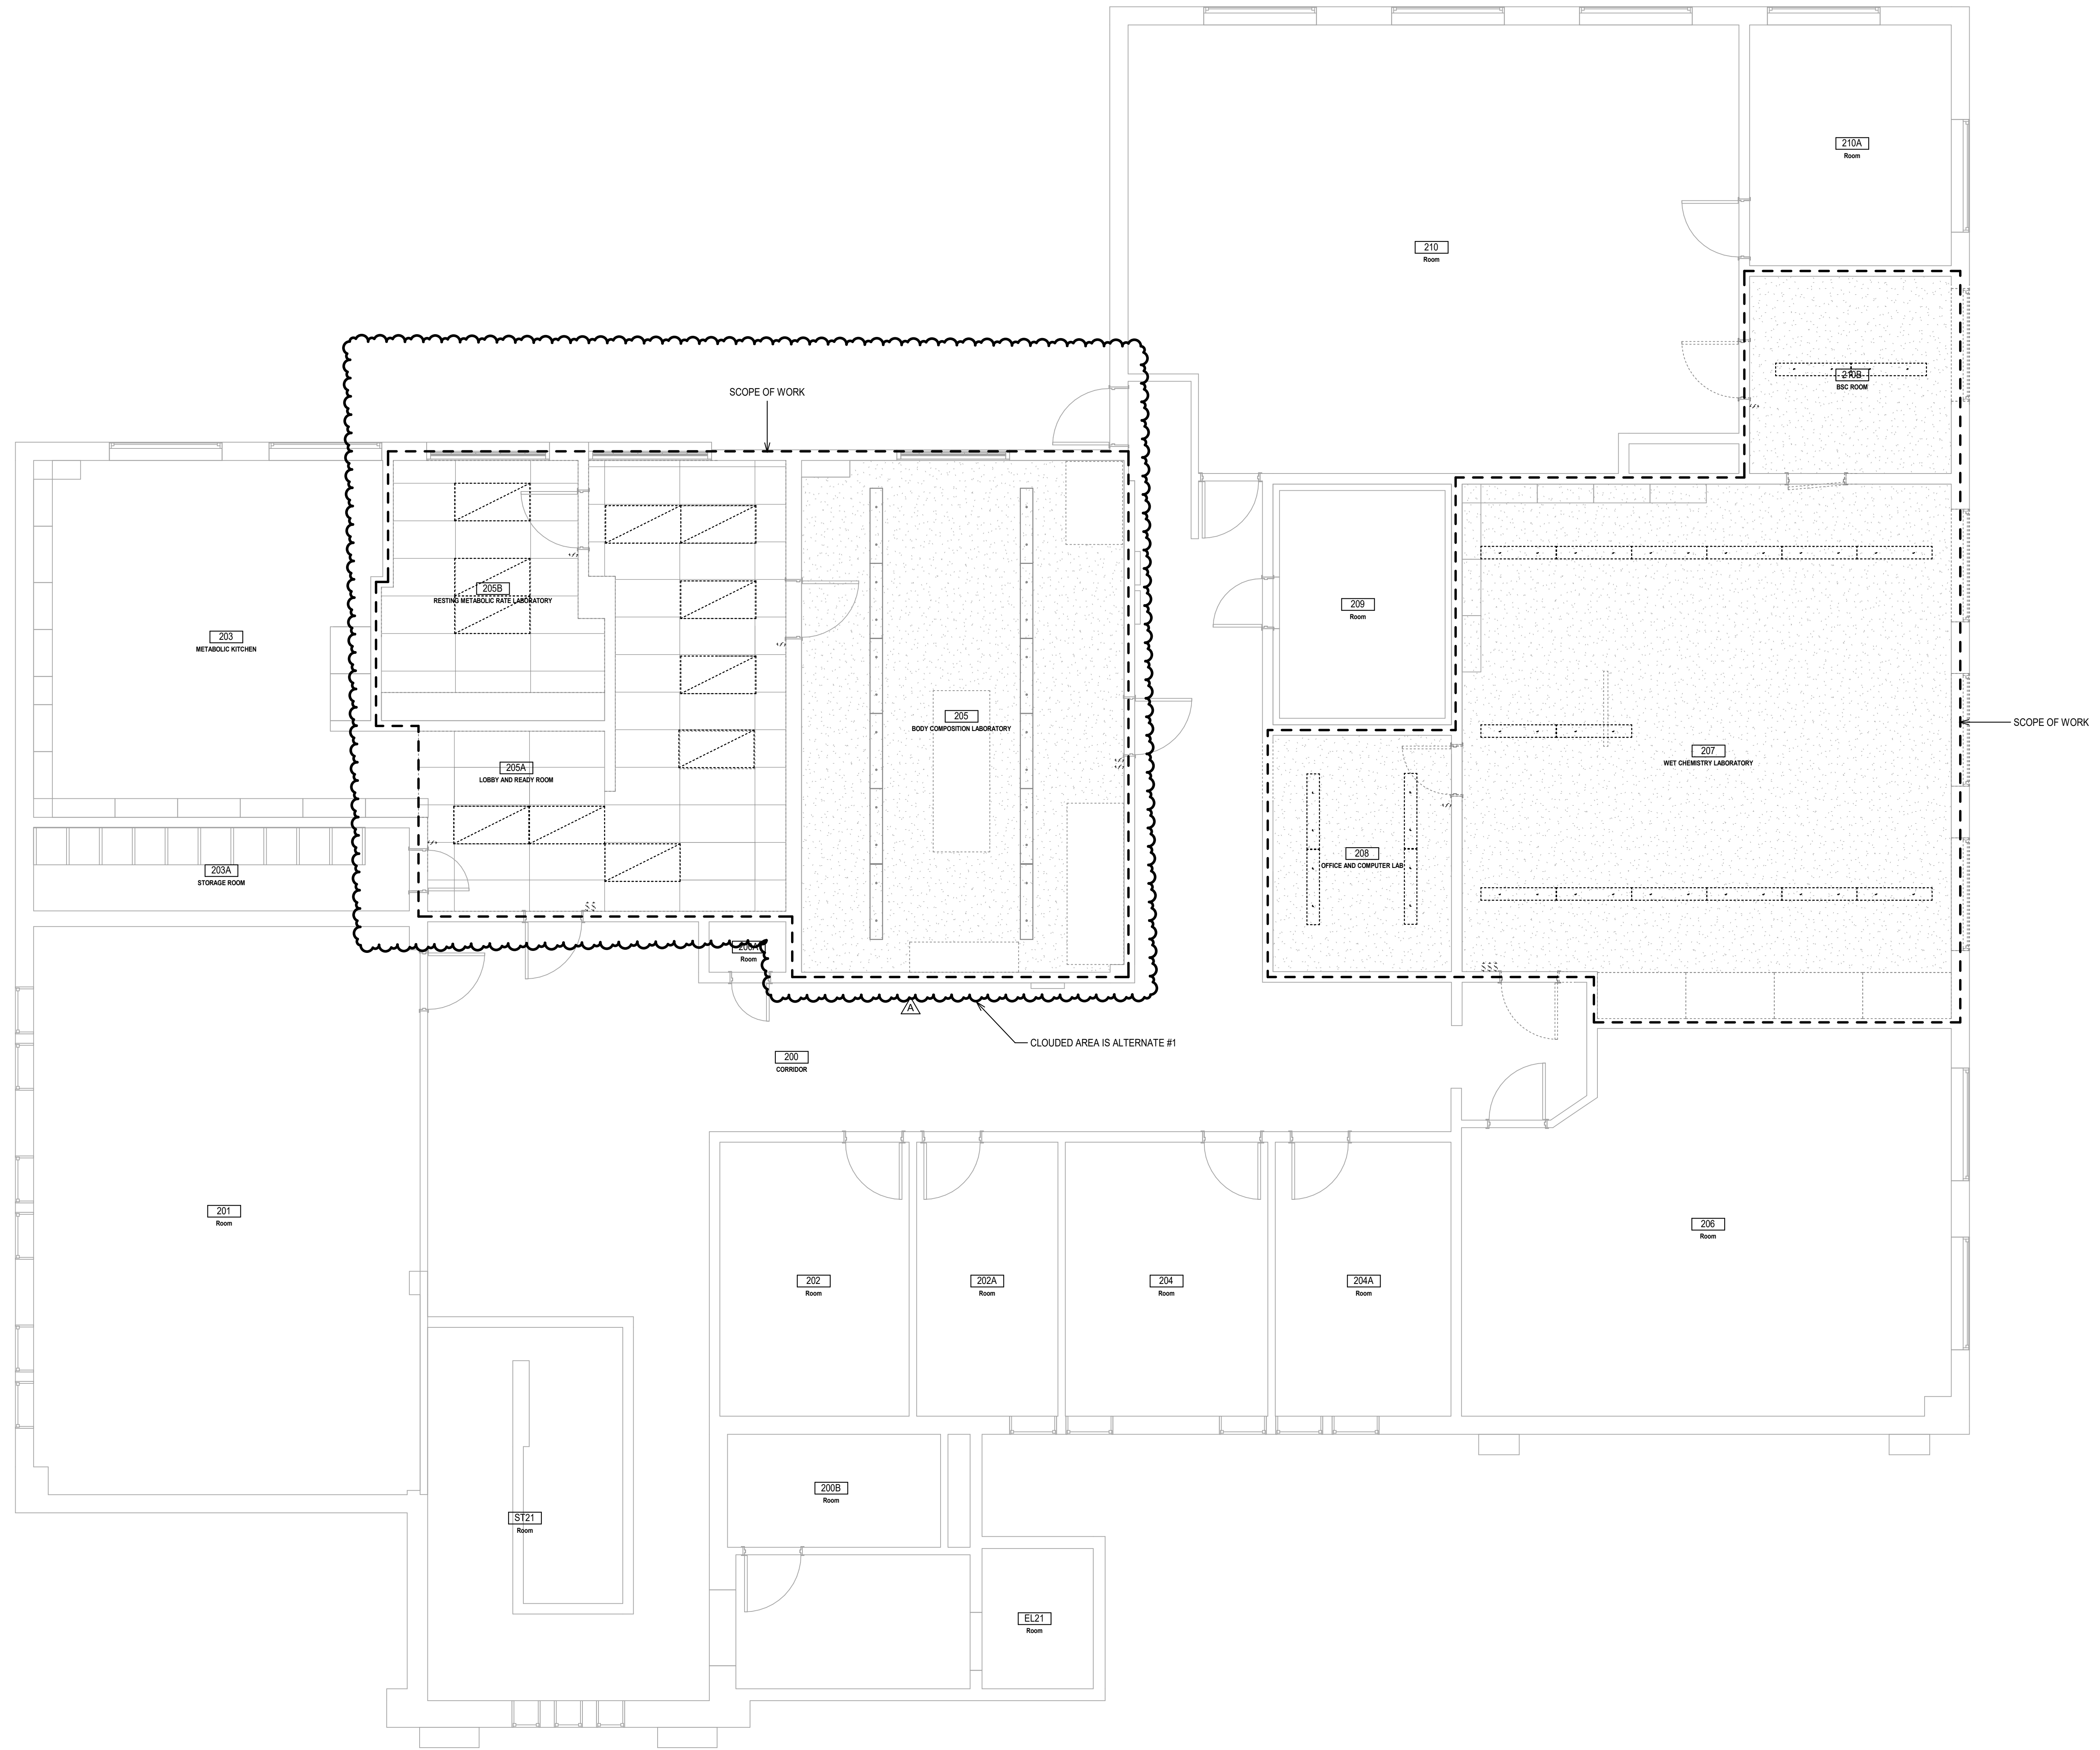

ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT
A	1/31/2025	Owner Revisions



DEMO FLOOR PLAN - LIGHTING
FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE., MOSCOW, ID 83844
UNIVERSITY OF IDAHO


TITLE	PROJECT	CLIENT

JOB NO: **240004**
 CAPITAL PROJECT NO: **CP220034**

ELD2-11

LEVEL 2 - DEMO PLAN - LIGHTING
 1/4" = 1'-0"

- GENERAL NOTES:**
1. FIELD VERIFY EXISTING CONDITIONS PRIOR TO COMMENCING WORK
 2. FA2P LOCATED IN THE FIRST FLOOR CORRIDOR.

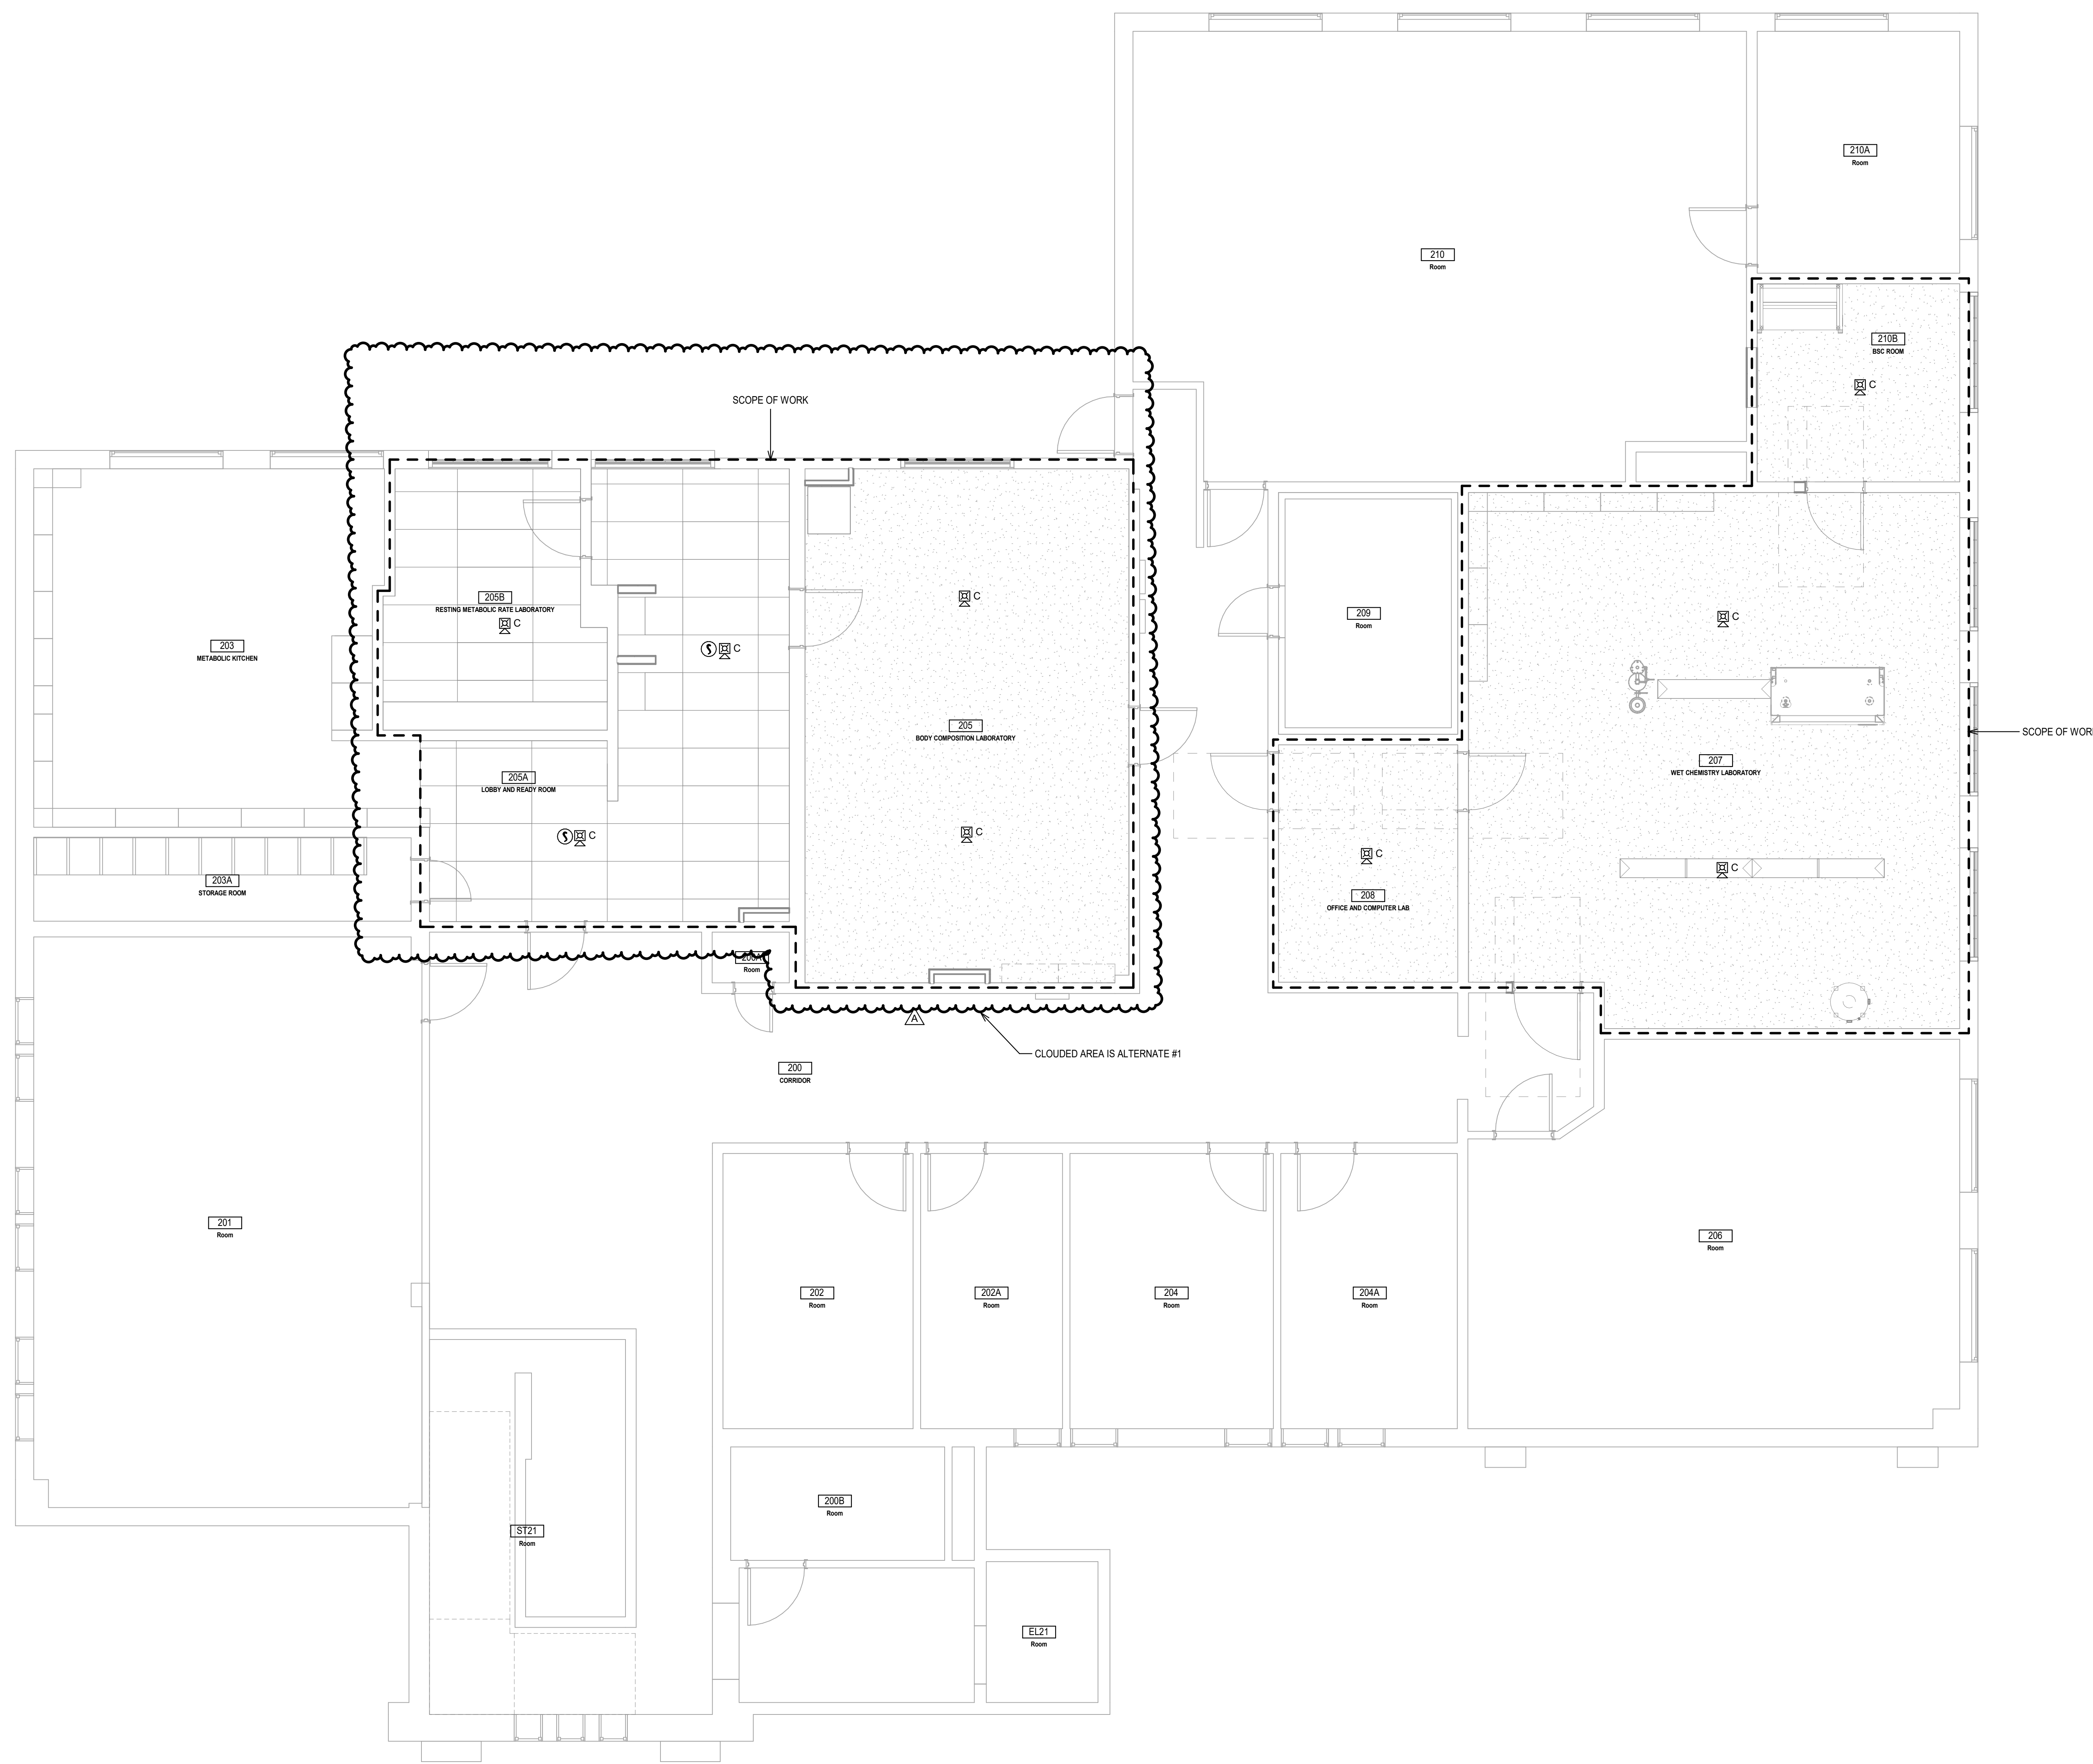


KNIT
knitstudios.com


THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSES OF CONTRACTING, LENDING AND MAINTAINING THE PROJECT. ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DISCLOSED HEREIN IN WHOLE OR IN PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KMIT. REPRODUCTION OF THESE DOCUMENTS IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KMIT.



MW Engineers
601 W First Ave, Ste 1200
Spokane, WA 99201, USA
509.325.8223
mwengineers.com

ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT
A	1/31/2025	Owner Revisions

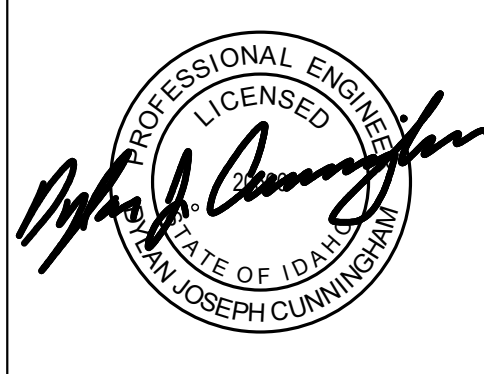

FLOOR PLAN - FIRE ALARM

FOOD RESEARCH CENTER TI - PHASE 1 (BUILDING #: 005)

860 IDAHO AVE., MOSCOW, ID 83844

UNIVERSITY OF IDAHO


TITLE	PROJECT	CLIENT

JOB NO: **240004**
CAPITAL PROJECT NO: **CP220034**

FA2-11

LEVEL 2 - FIRE ALARM
1/4" = 1'-0"

GENERAL NOTES:
 1. FIELD VERIFY EXISTING CONDITIONS PRIOR TO COMMENCING WORK

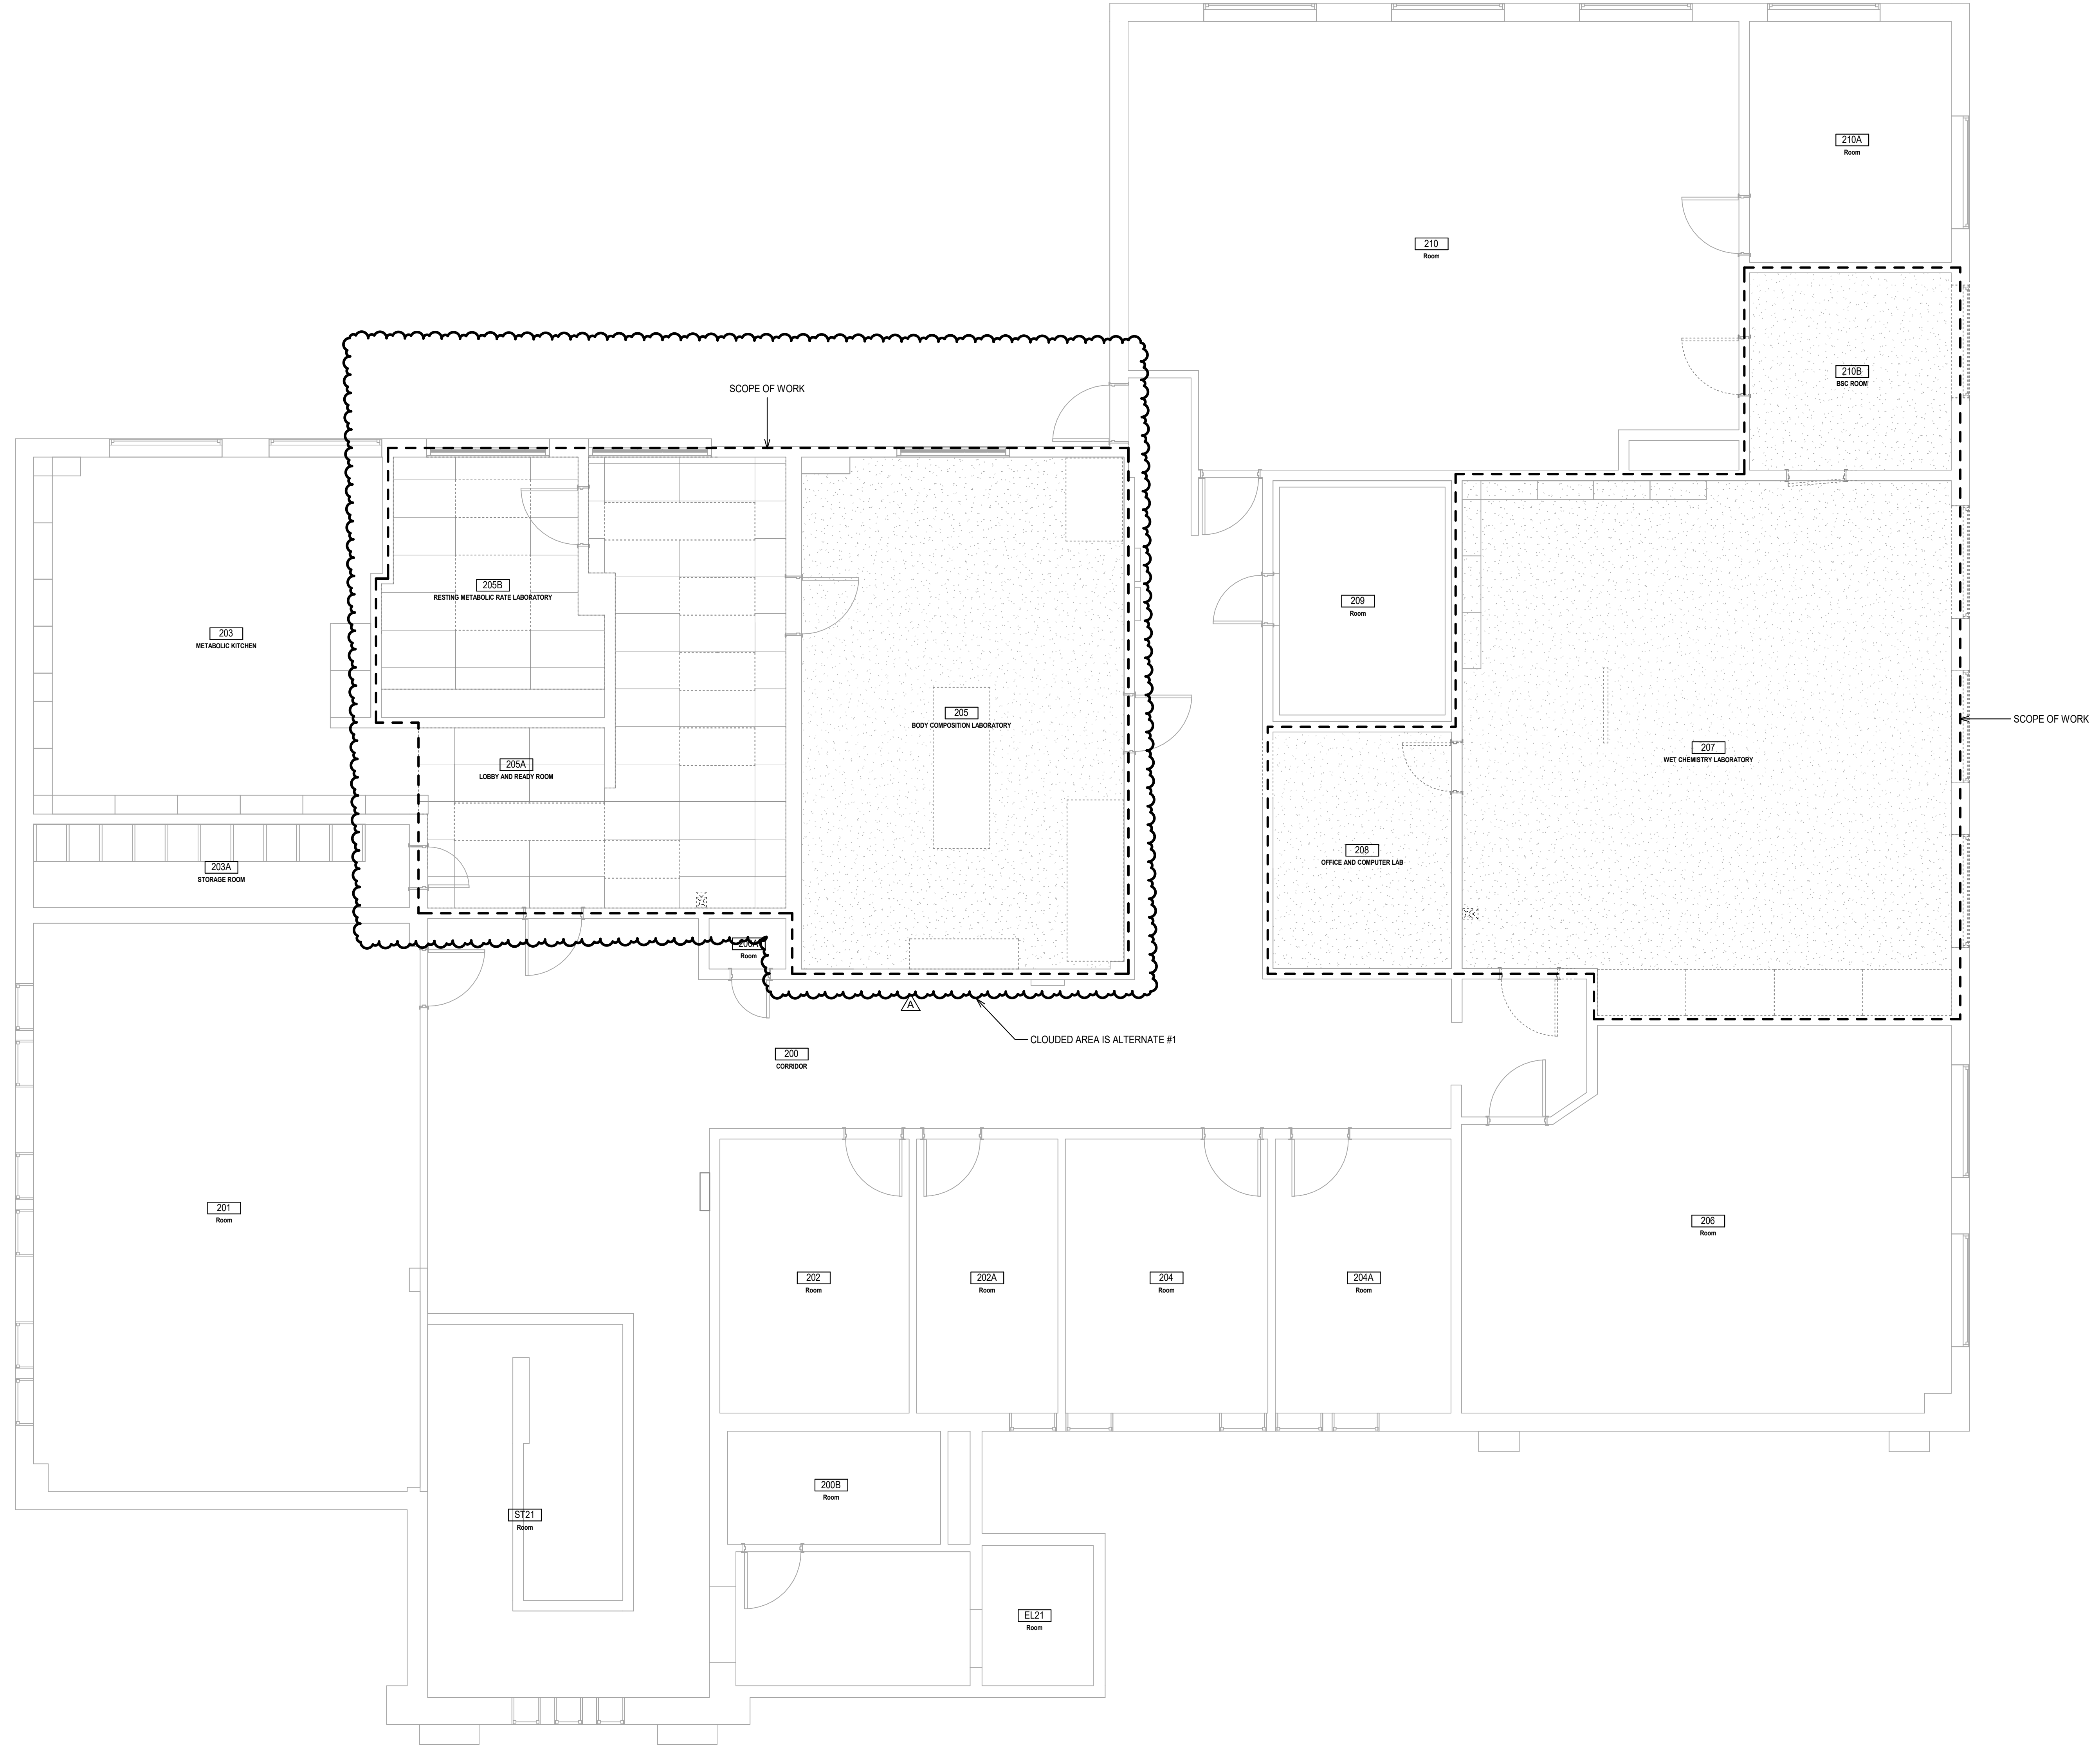

LEVEL 2 - DEMO PLAN - FIRE ALARM
 1/4" = 1'-0"




KNIT
 knitstudios.com
THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSES OF CONTRACTING, LENDING AND MAINTAINING THE PROJECT. ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT. REPRODUCTION OF THESE DOCUMENTS IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.



MW Engineers
 601 W First Ave, Ste 1200
 Spokane, WA 99201, USA
 509.325.8223
 mwengineers.com

ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT
A	1/31/2025	Owner Revisions

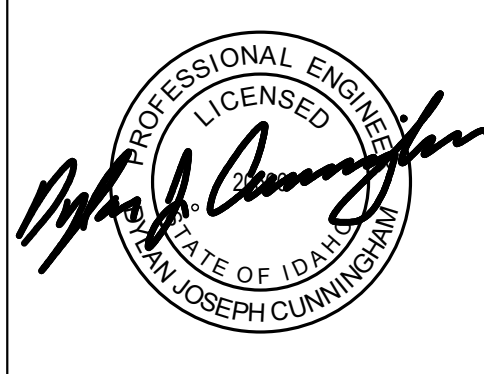

DEMO FLOOR PLAN - FIRE ALARM
 FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE., MOSCOW, ID 83844
 UNIVERSITY OF IDAHO

TITLE	PROJECT	CLIENT

JOB NO: **240004**
 CAPITAL PROJECT NO: **CP220034**

FAD2-11

COMMUNICATIONS SYMBOLS

3-PORT COMMUNICATIONS OUTLET, (1) 3-PORT FACEPLATE WITH (3) 8-POSITION CAT 6A RJ-45 JACKS, WALL FLUSH MOUNTED 18" AFF, UNLESS NOTED OTHERWISE. REFER TO SHEET TS-01 DETAIL 1 FOR OUTLET DETAIL.

3-PORT COMMUNICATIONS OUTLET, (1) 3-PORT FACEPLATE WITH (3) 8-POSITION CAT 6A RJ-45 JACKS, WALL FLUSH MOUNTED 18" AFF, UNLESS NOTED OTHERWISE. REFER TO SHEET TS-01 DETAIL 1 FOR OUTLET DETAIL.

COMMUNICATIONS ABBREVIATIONS

- AFF ABOVE FINISHED FLOOR
- ANSI AMERICAN NATIONAL STANDARDS INSTITUTE
- AWG AMERICAN WIRE GAUGE
- BB BACKBONE
- BIX BIX BLOCK
- C CONDUIT
- CAT 3 CATEGORY 3
- CAT 5 CATEGORY 5
- CAT 5E CATEGORY 5, ENHANCED
- CAT 6 CATEGORY 6
- CONN CONNECTOR
- CFCI CONTRACTOR FURNISHED CONTRACTOR INSTALLED
- CR COMPUTER ROOM
- EIA ELECTRONIC INDUSTRIES ALLIANCE
- EMI ELECTROMAGNETIC INTERFERENCE
- EMT ELECTRICAL METALLIC TUBING
- FF FINISHED FLOOR
- FO FIBER OPTIC
- FOC FIBER OPTIC CABLE
- GE GROUNDING EQUALIZER
- HH HAND HOLE
- ISP INSIDE PLANT
- JBOX JUNCTION BOX
- LAN LOCAL AREA NETWORK
- MDF MAIN DISTRIBUTION FRAME
- MH MAINTENANCE HOLE
- Mhz MEGAHERTZ
- MIC MICROPHONE
- MM MULTIMODE
- NEMA NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
- NFPA NATIONAL FIRE PROTECTION ASSOCIATION
- NIC NOT IN CONTRACT
- OFCI OWNER FURNISHED CONTRACTOR INSTALLED
- OFOI OWNER FURNISHED OWNER INSTALLED
- OSP OUTSIDE PLANT
- PIC PATCH CORD
- PIP PATCH PANEL
- PB PULL BOX
- PC PERSONAL COMPUTER
- PR PAIR
- PVC POLYVINYL CHLORIDE
- RM ROOM
- RMU RACK MOUNT UNIT
- SM SINGLEMODE
- SPKR SPEAKER
- STR STRAND
- SWTH SWITCH TAIL
- TBB TELECOMMUNICATION BONDING BACKBONE
- TC TELECOMMUNICATIONS CLOSET
- TGB TELECOMMUNICATIONS GROUNDING BUSBAR
- TIA TELECOMMUNICATIONS INDUSTRY ASSOCIATION
- TMGB TELECOMMUNICATIONS MAIN GROUNDING BUSBAR
- TR TELECOMMUNICATIONS ROOM, ALSO SEE TC
- TYP TYPICAL
- UG UNDERGROUND CONDUIT
- UL UNDERWRITERS LABORATORIES
- um MICRON OR MICROMETER
- UPS UNINTERRUPTIBLE POWER SUPPLY
- UTP UNSHIELDED TWISTED-PAIR
- WA WORK AREA
- WM WALL MOUNTED
- WS WORKSTATION



knitstudios.com


THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSES OF CONTRACTING LEGAL AND MAINTAINING THE PROJECT. ANY USE OF THESE DOCUMENTS OR USE OF THE ORIGINAL IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.



601 W First Ave, Ste 1200
Spokane, WA 99201, USA
509.838.8223
mwengineers.com

ISSUE DATE: **12.20.2024**


REV	DATE	COMMENT

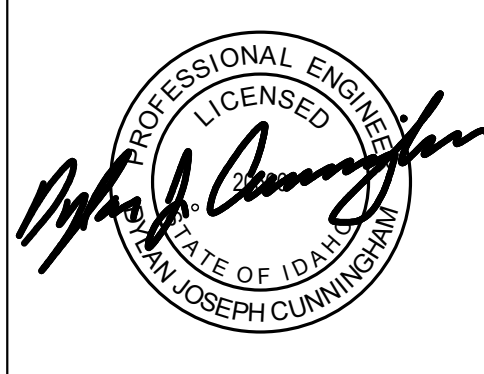

LEGENDS & ABBREVIATIONS - TELECOM
FOOD RESEARCH CENTER TI - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE., MOSCOW, ID 83844
UNIVERSITY OF IDAHO

TITLE	PROJECT	CLIENT
JOB NO: 240004 CAPITAL PROJECT NO: CP220034		

T0-01

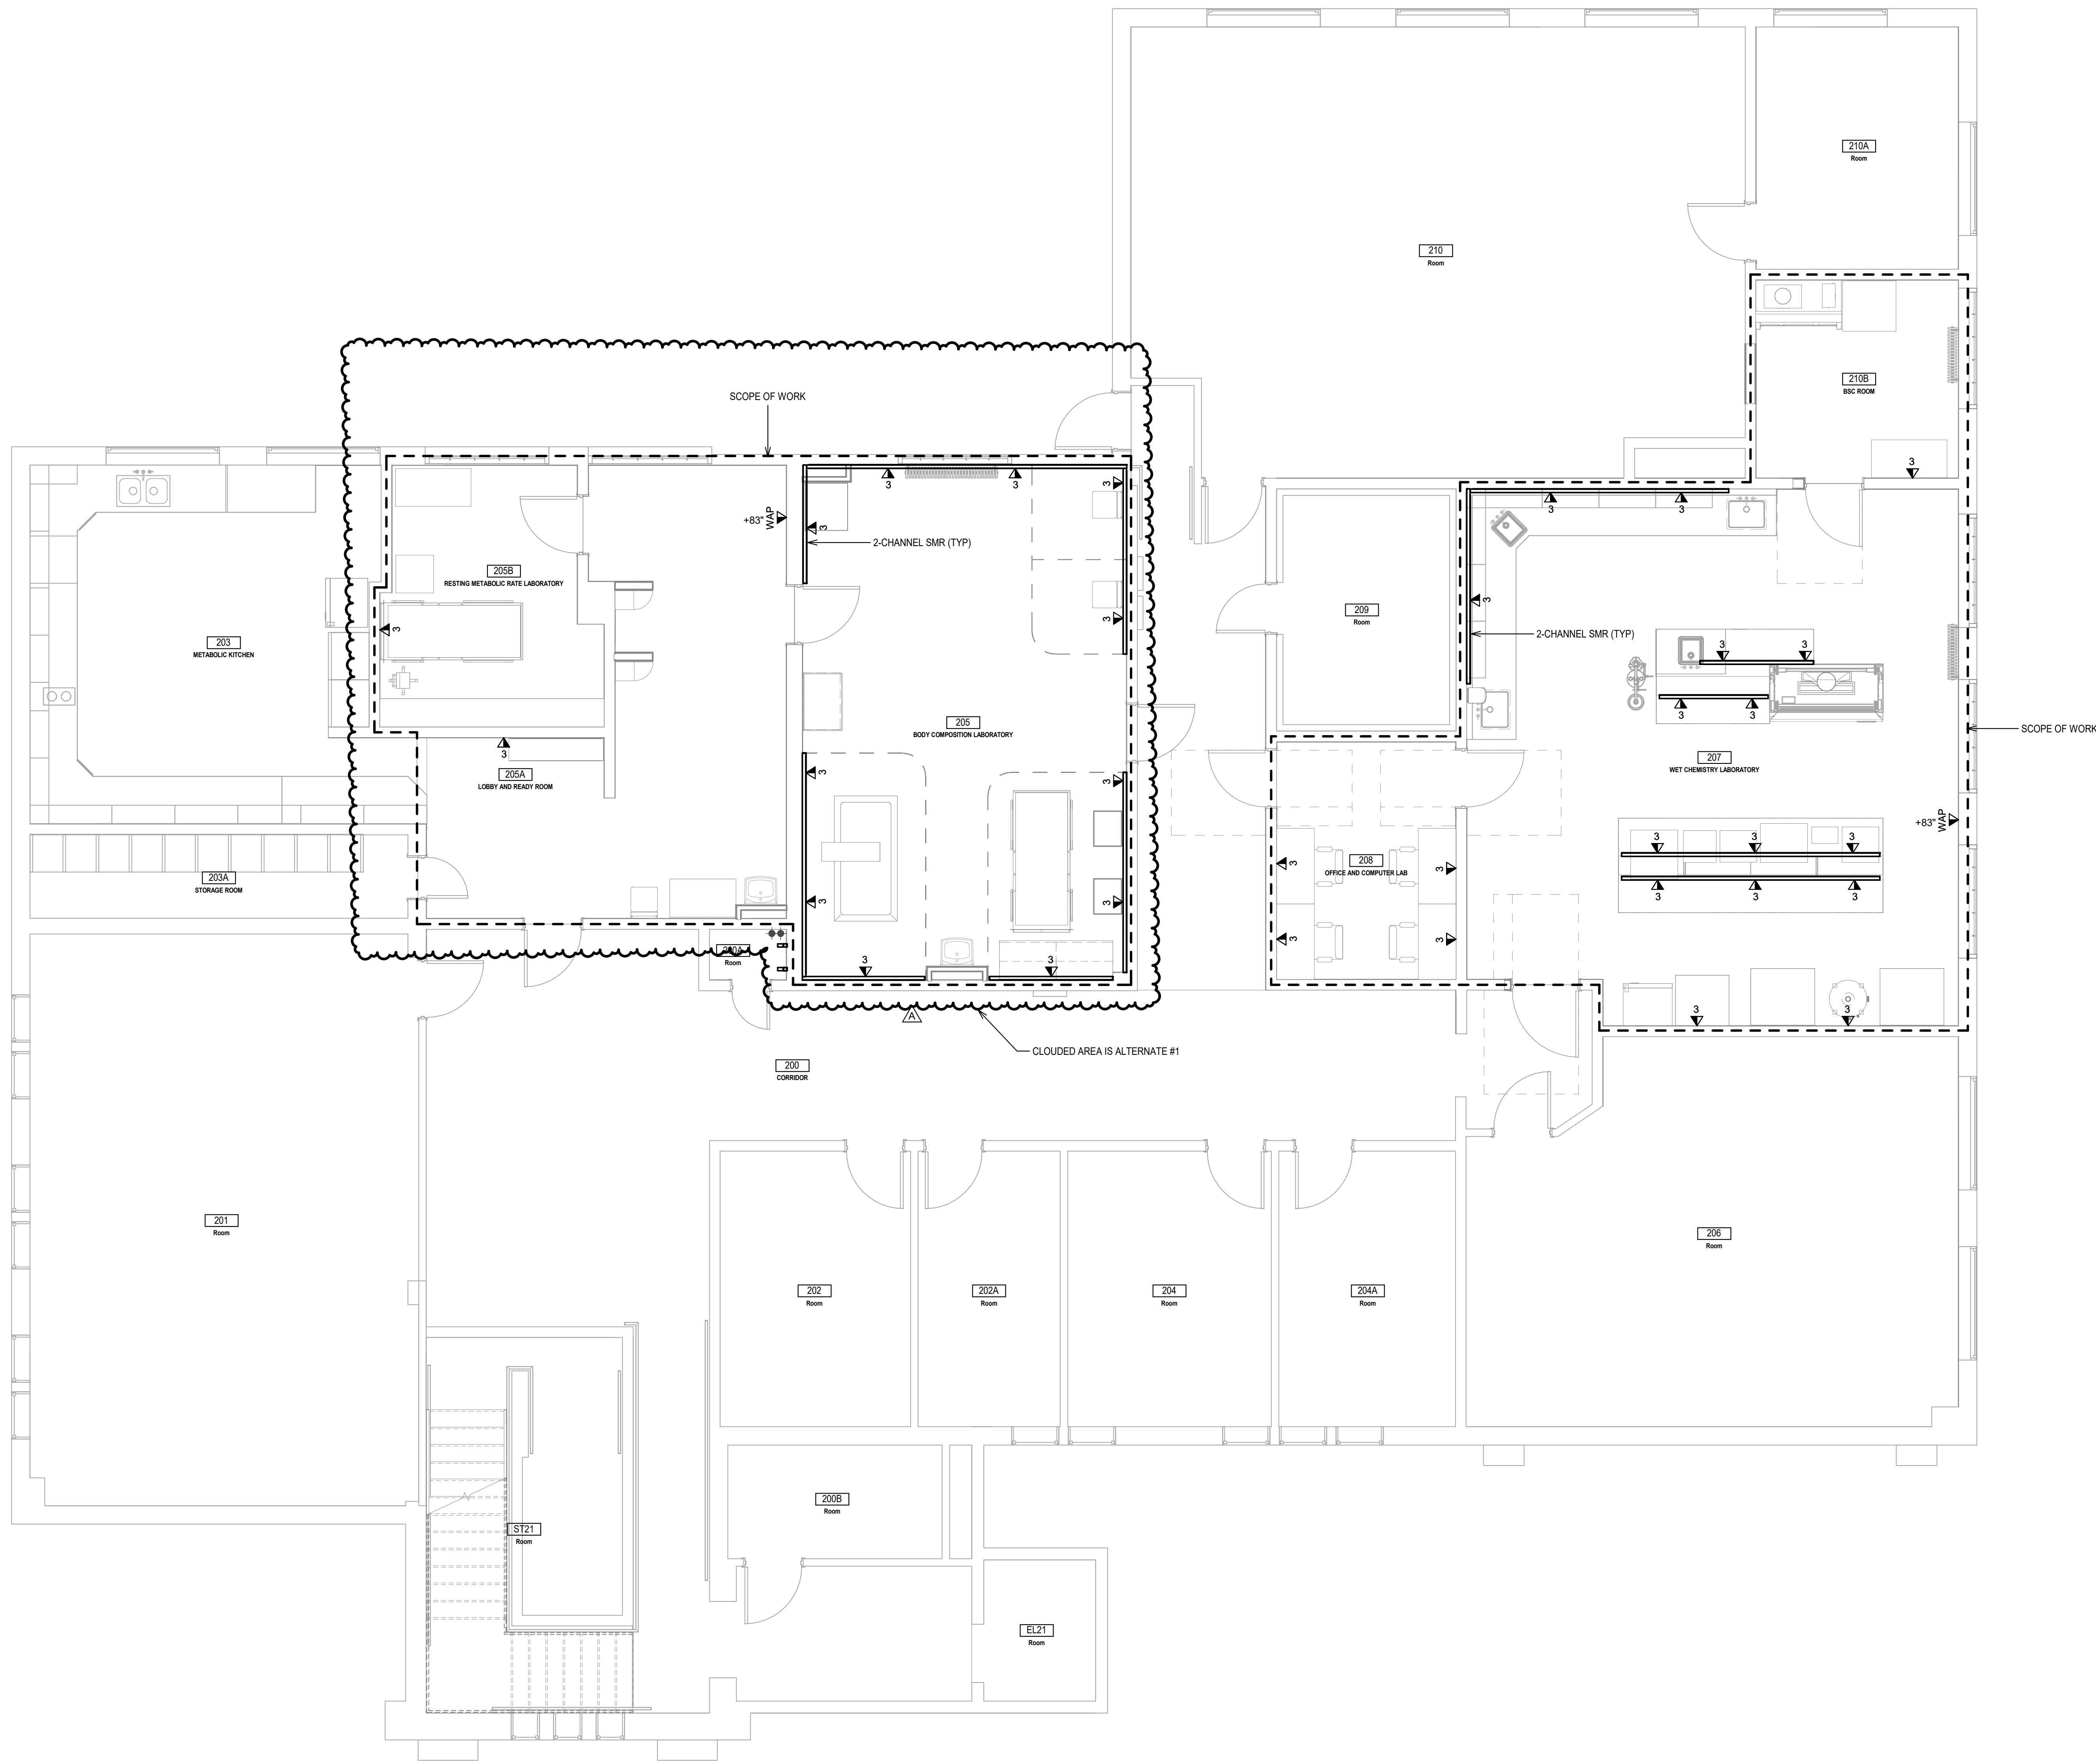

- GENERAL NOTES:**
1. FIELD VERIFY EXISTING CONDITIONS PRIOR TO COMMENCING WORK.
 2. TELECOMMUNICATIONS PATHWAY SHALL ROUTE FROM OUTLET BOX TO ROOM 200A, THEN TRANSITION TO 4" CONDUIT FROM ROOM 200A TO EXISTING TELECOM ROOM 102. STUDS CONDUIT INTO ROOM 200A AND UTILIZE J-HOOKS TO CONSOLIDATE CABLING PRIOR TO ROUTING THROUGH 4" CONDUIT.



KNIT
knitstudios.com


THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSES OF CONTRACTING, LENDING AND MAINTAINING THE PROJECT. ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KMIT. REPRODUCTION OF THESE DOCUMENTS IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KMIT.



MW Engineers
601 W. First Ave., Ste 1200
Spokane, WA 99201, USA
509.326.8223
mwengineers.com

ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT
A	1/31/2025	Owner Revisions

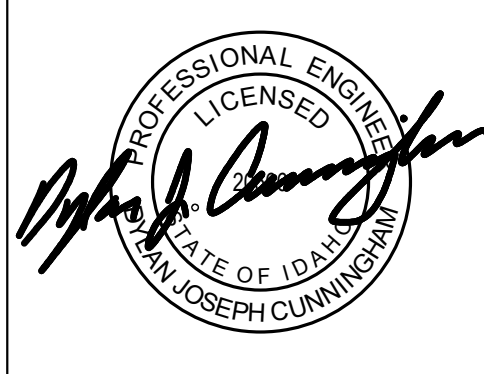

FLOOR PLAN - TELECOM

FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)

860 IDAHO AVE., MOSCOW, ID 83844


UNIVERSITY OF IDAHO

TITLE	PROJECT	CLIENT

JOB NO: **240004**
CAPITAL PROJECT NO: **CP220034**

T2-11

LEVEL 2 - TELECOM
1/4" = 1'-0"

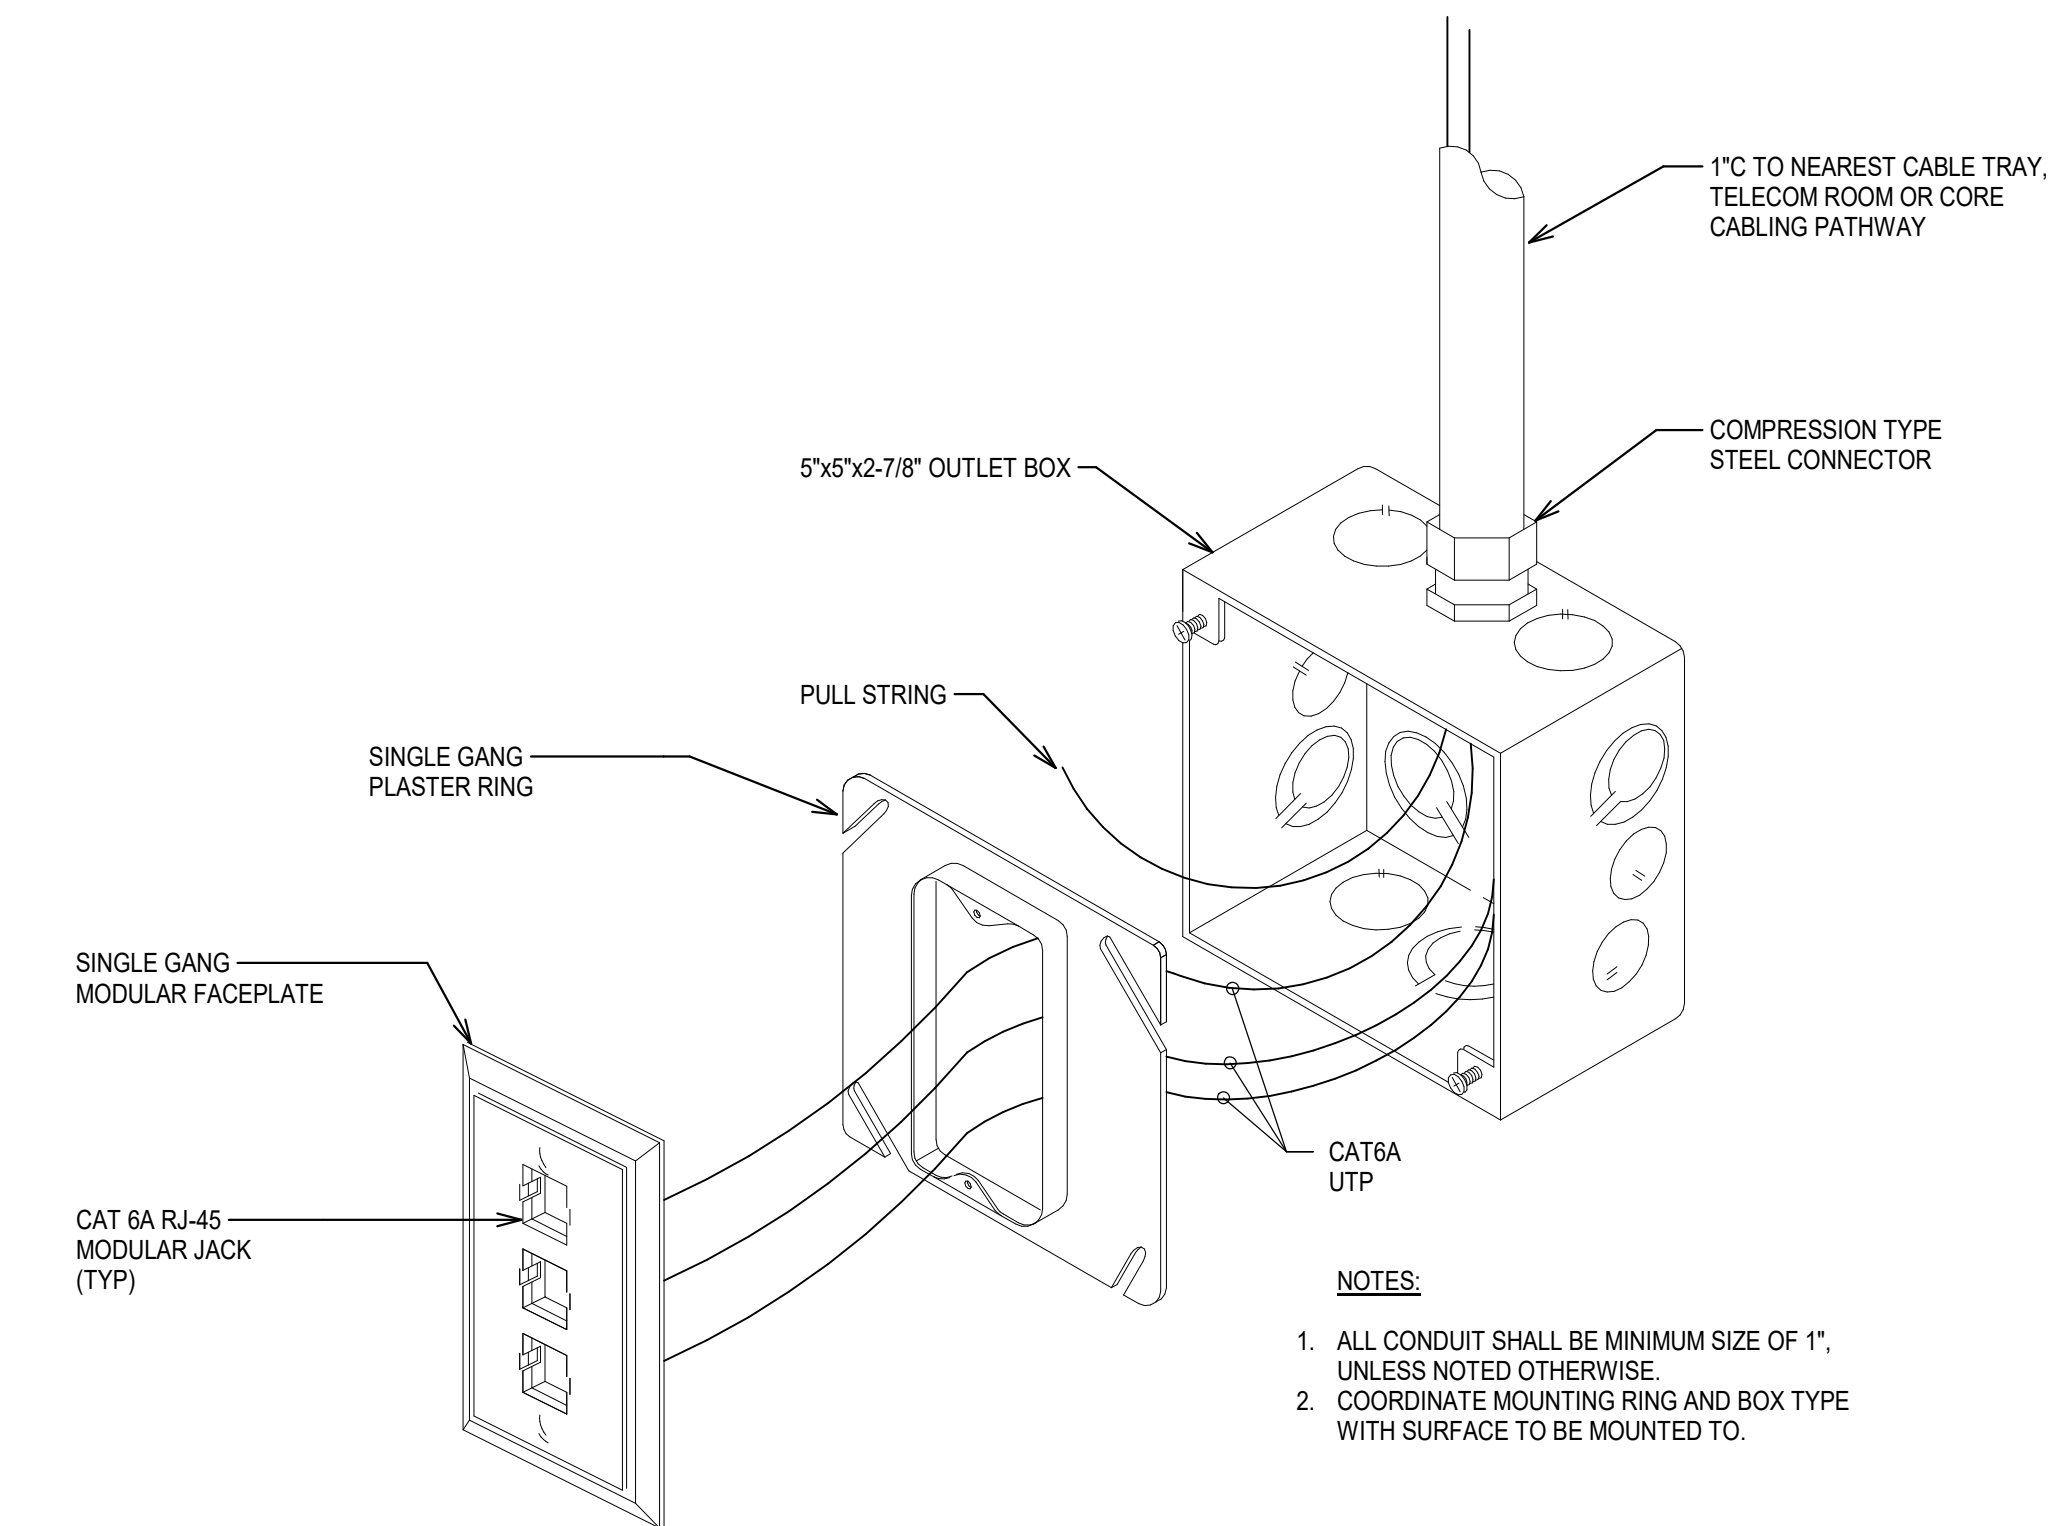

1 TYPICAL 3-PORT OUTLET DETAIL
N.T.S.

- NOTES:**
1. ALL CONDUIT SHALL BE MINIMUM SIZE OF 1", UNLESS NOTED OTHERWISE.
 2. COORDINATE MOUNTING RING AND BOX TYPE WITH SURFACE TO BE MOUNTED TO.



KNIT
knitstudios.com


THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSE OF CONTRACTING UNDER AND MAINTAINING THE PROJECT HEREIN AS THE ARCHITECT OF RECORD FOR THE PROJECT. RETAINS OWNERSHIP OF THESE DOCUMENTS. ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT. REPRODUCTION OF THIS DOCUMENT IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.




MW Engineers
601 W First Ave, Ste 1200
Spokane, WA 99201, USA
509.838.9223
mwengineers.com

ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT

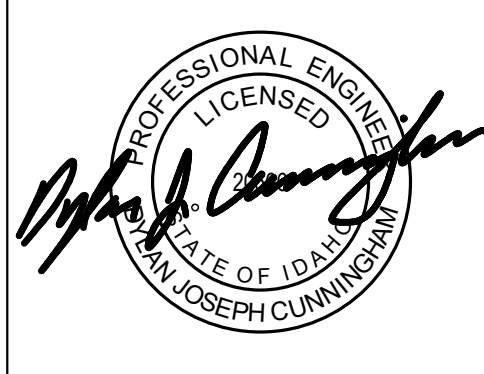

DETAILS - TELECOM	FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005) 860 IDAHO AVE., MOSCOW, ID 83844	UNIVERSITY OF IDAHO
TITLE	PROJECT	CLIENT
JOB NO: 240004 CAPITAL PROJECT NO: CP220034		
T5-01		

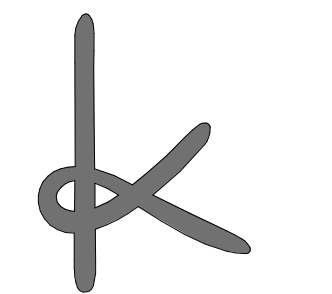

KNIT

knitstudios.com

THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSES OF CONTRACTING, DESIGN AND MAINTENANCE OF THE PROJECT AND AS THE ARCHITECT OF RECORD FOR THE PROJECT RETAINS OWNERSHIP OF THESE DOCUMENTS. ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN, IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT. REPRODUCTION OF THIS DOCUMENT IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KNIT.



ISSUE DATE: **12.20.2024**


REV DATE COMMENT




RISER DIAGRAMS - TELECOM
FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)
860 IDAHO AVE., MOSCOW, ID 83844
UNIVERSITY OF IDAHO

TITLE PROJECT CLIENT
JOB NO: **240004**
CAPITAL PROJECT NO: **CP220034**

T8-01


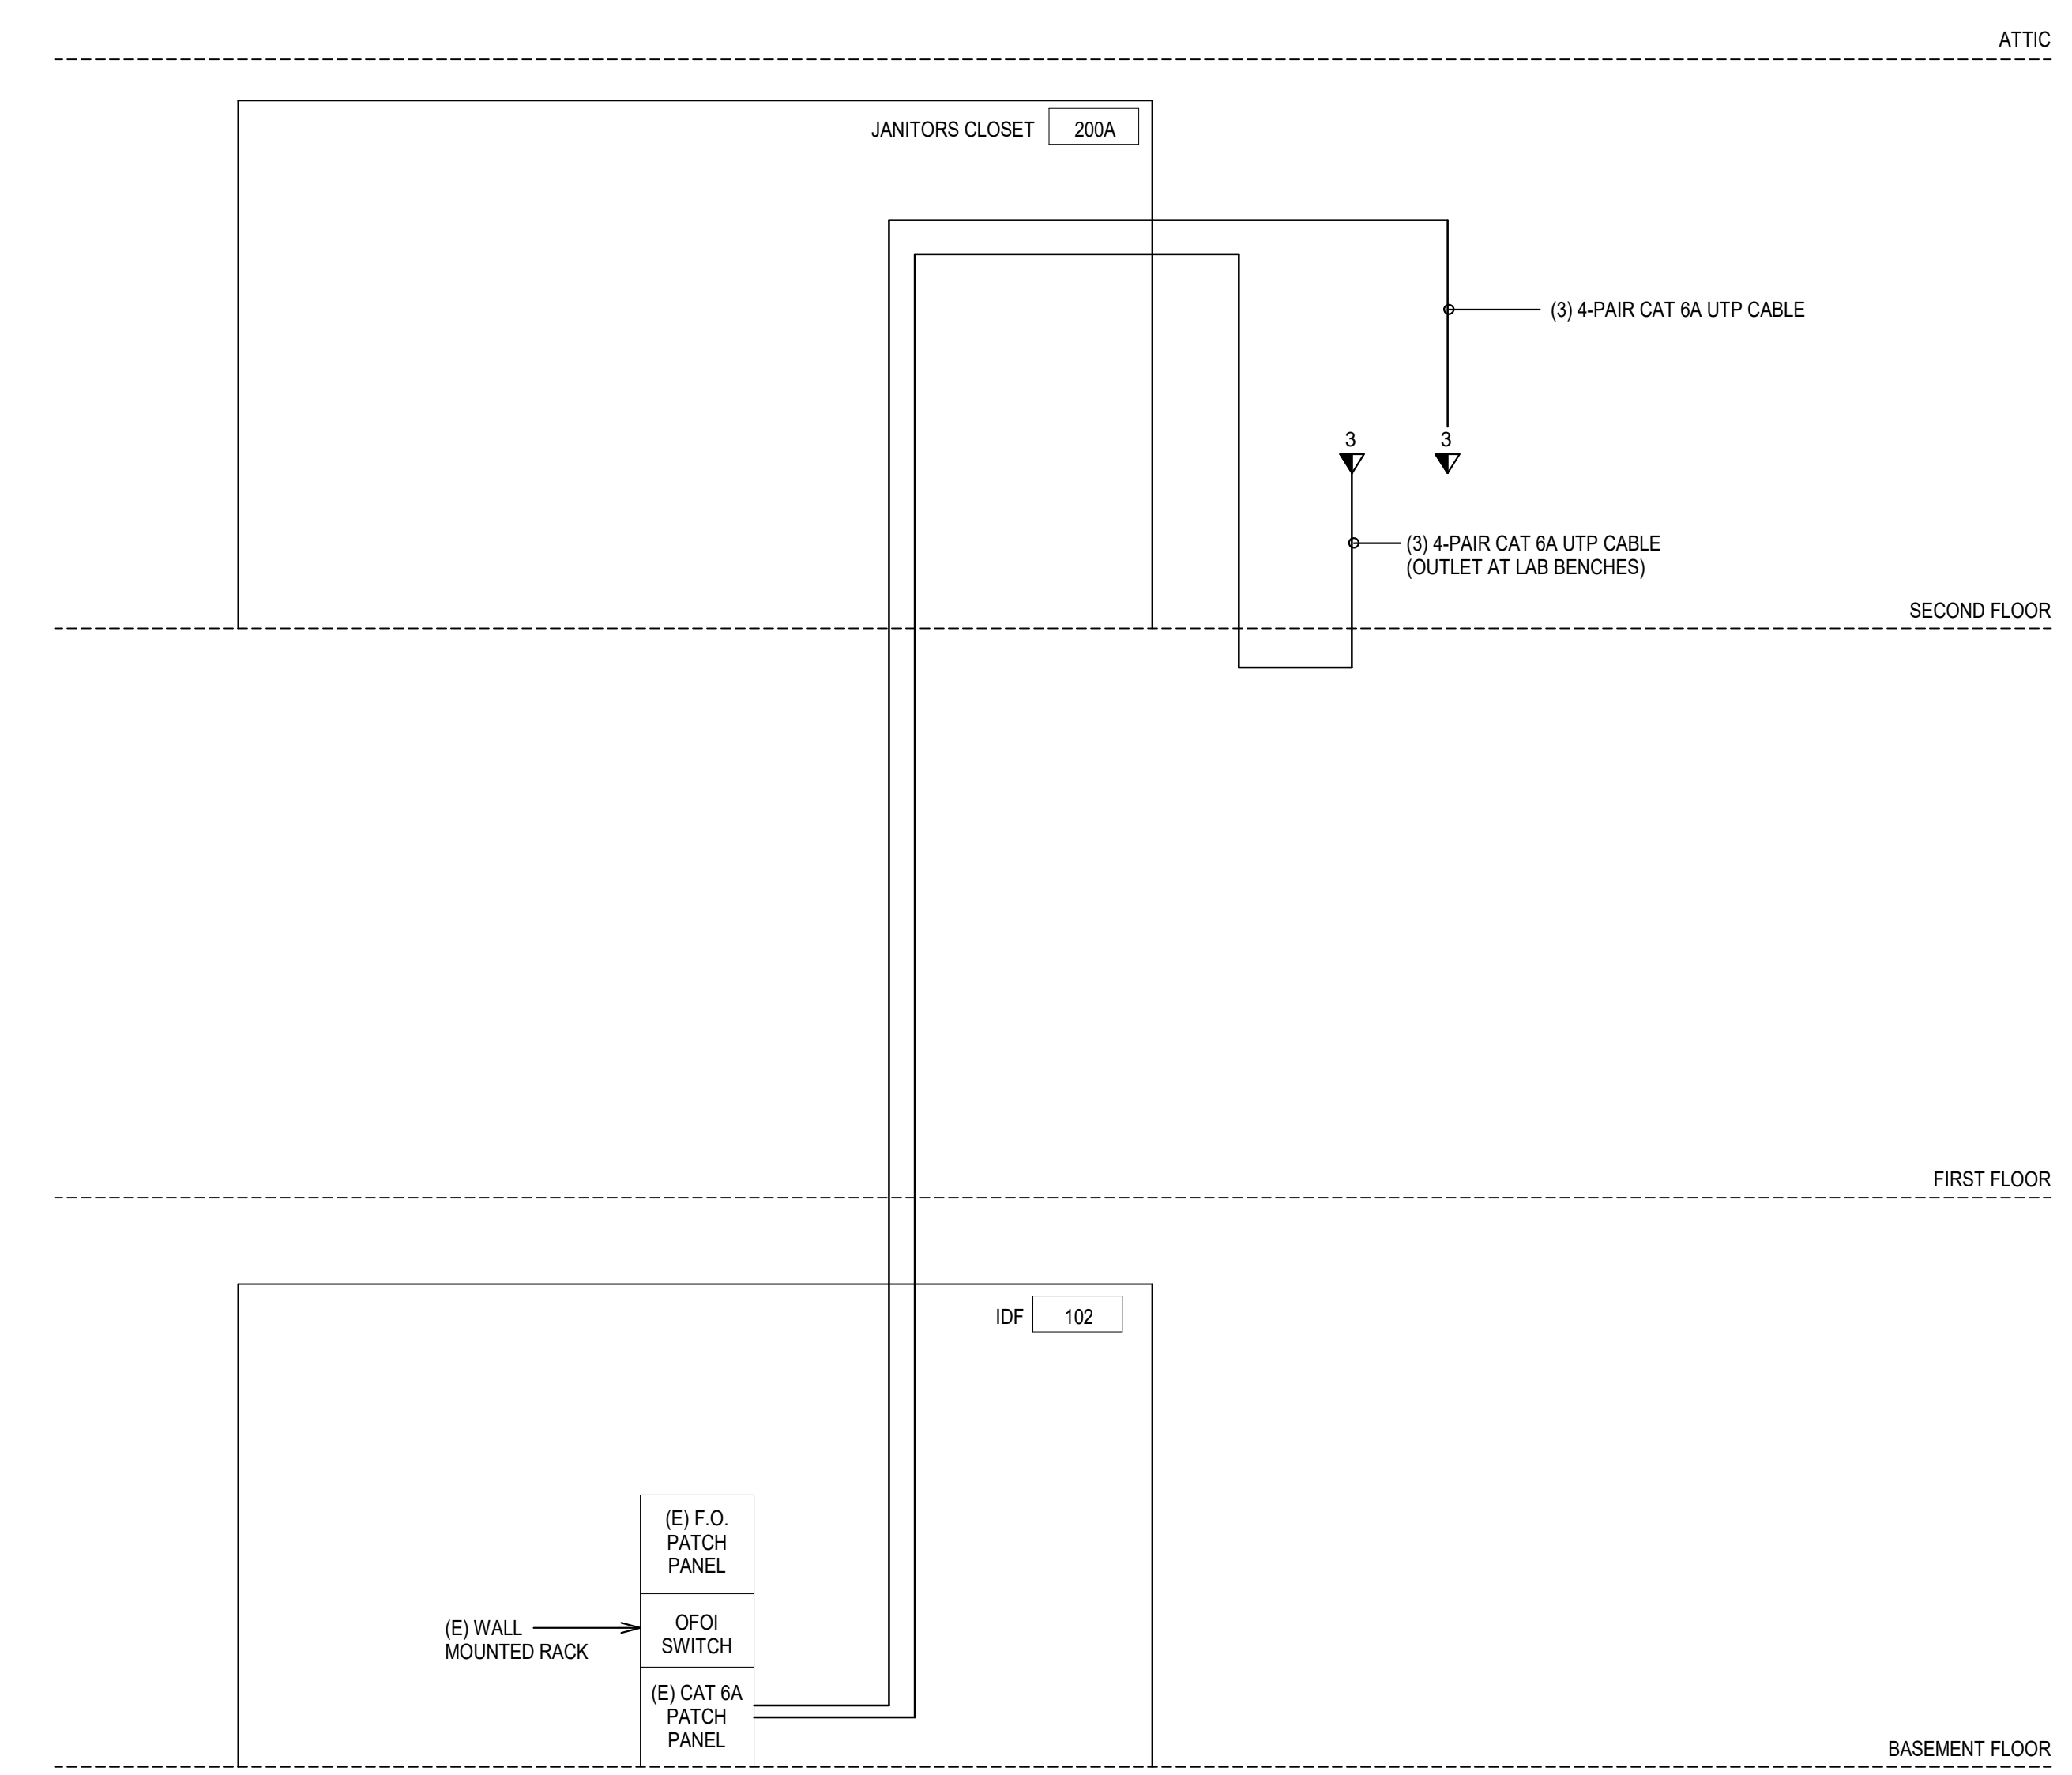


1 COPPER RISER DIAGRAM - TELECOM
N.T.S.

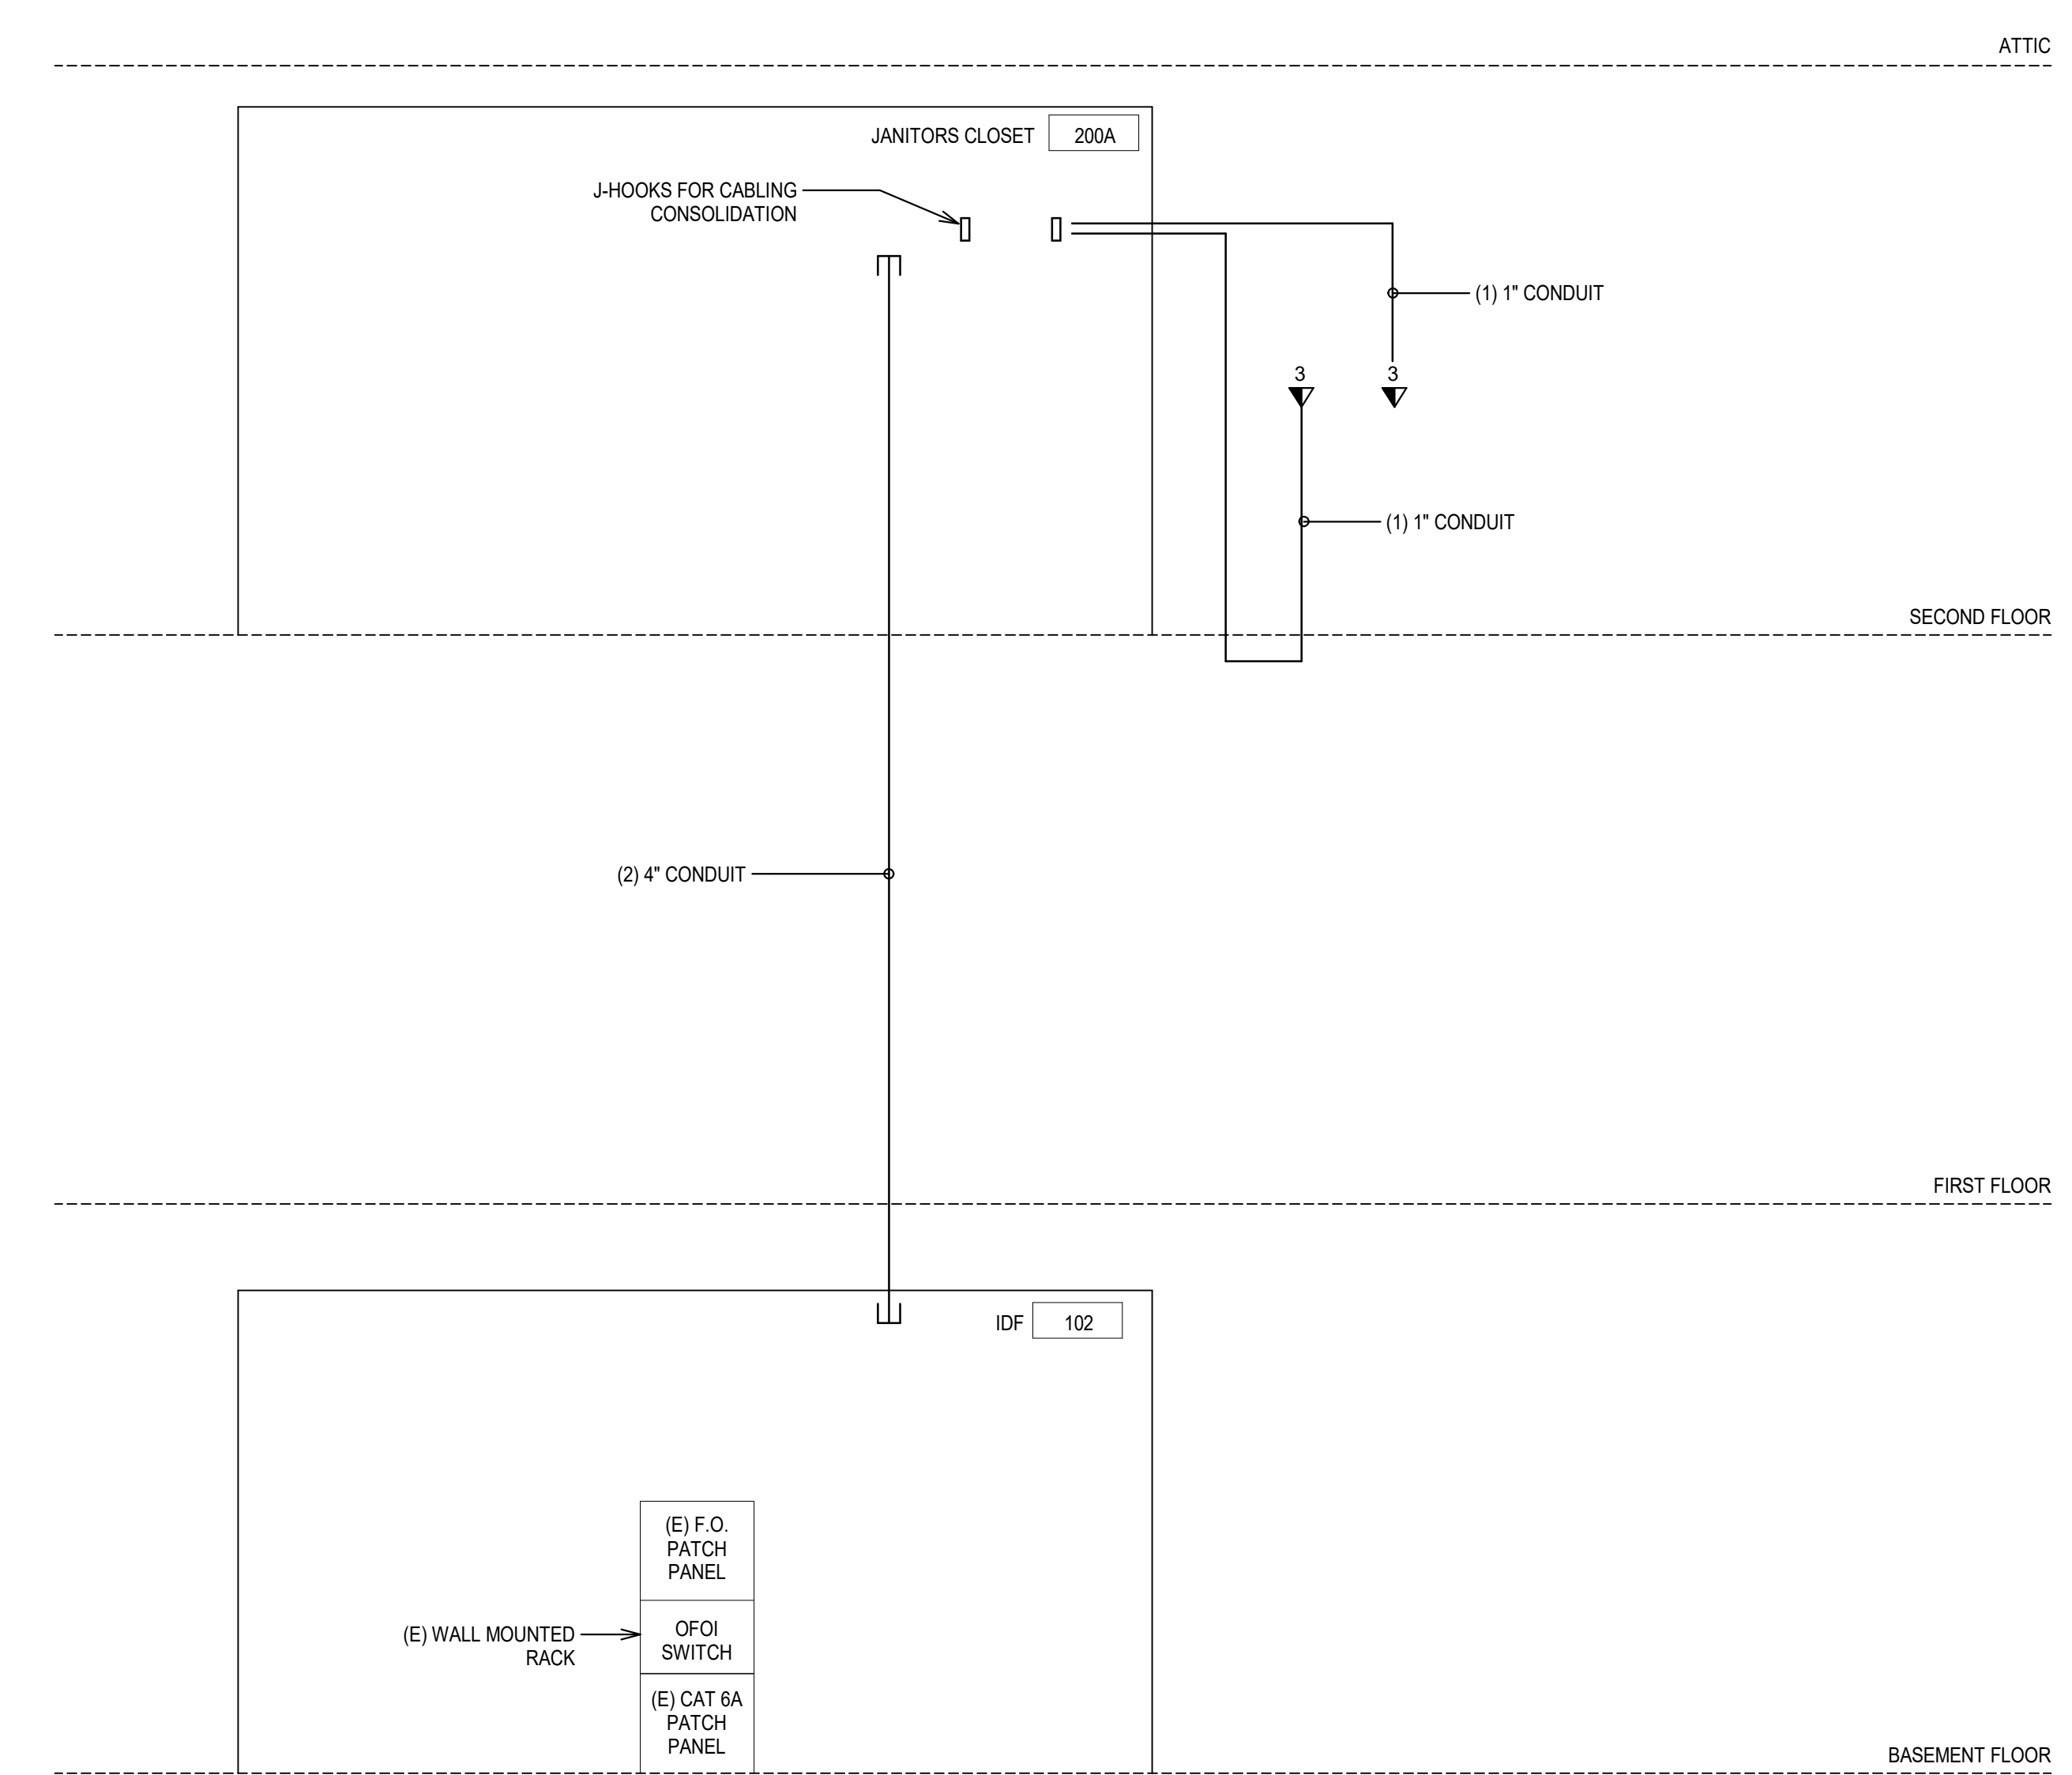


2 PATHWAY RISER DIAGRAM - TELECOM
N.T.S.

GENERAL NOTES:
 1. FIELD VERIFY EXISTING CONDITIONS PRIOR TO COMMENCING WORK

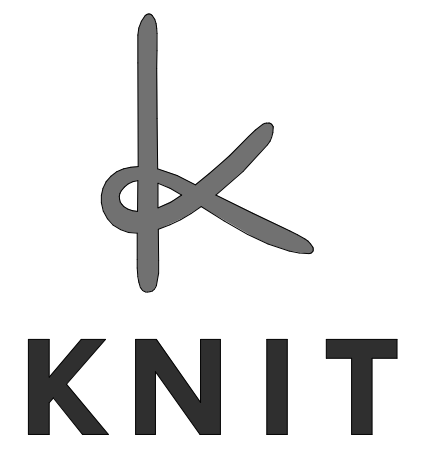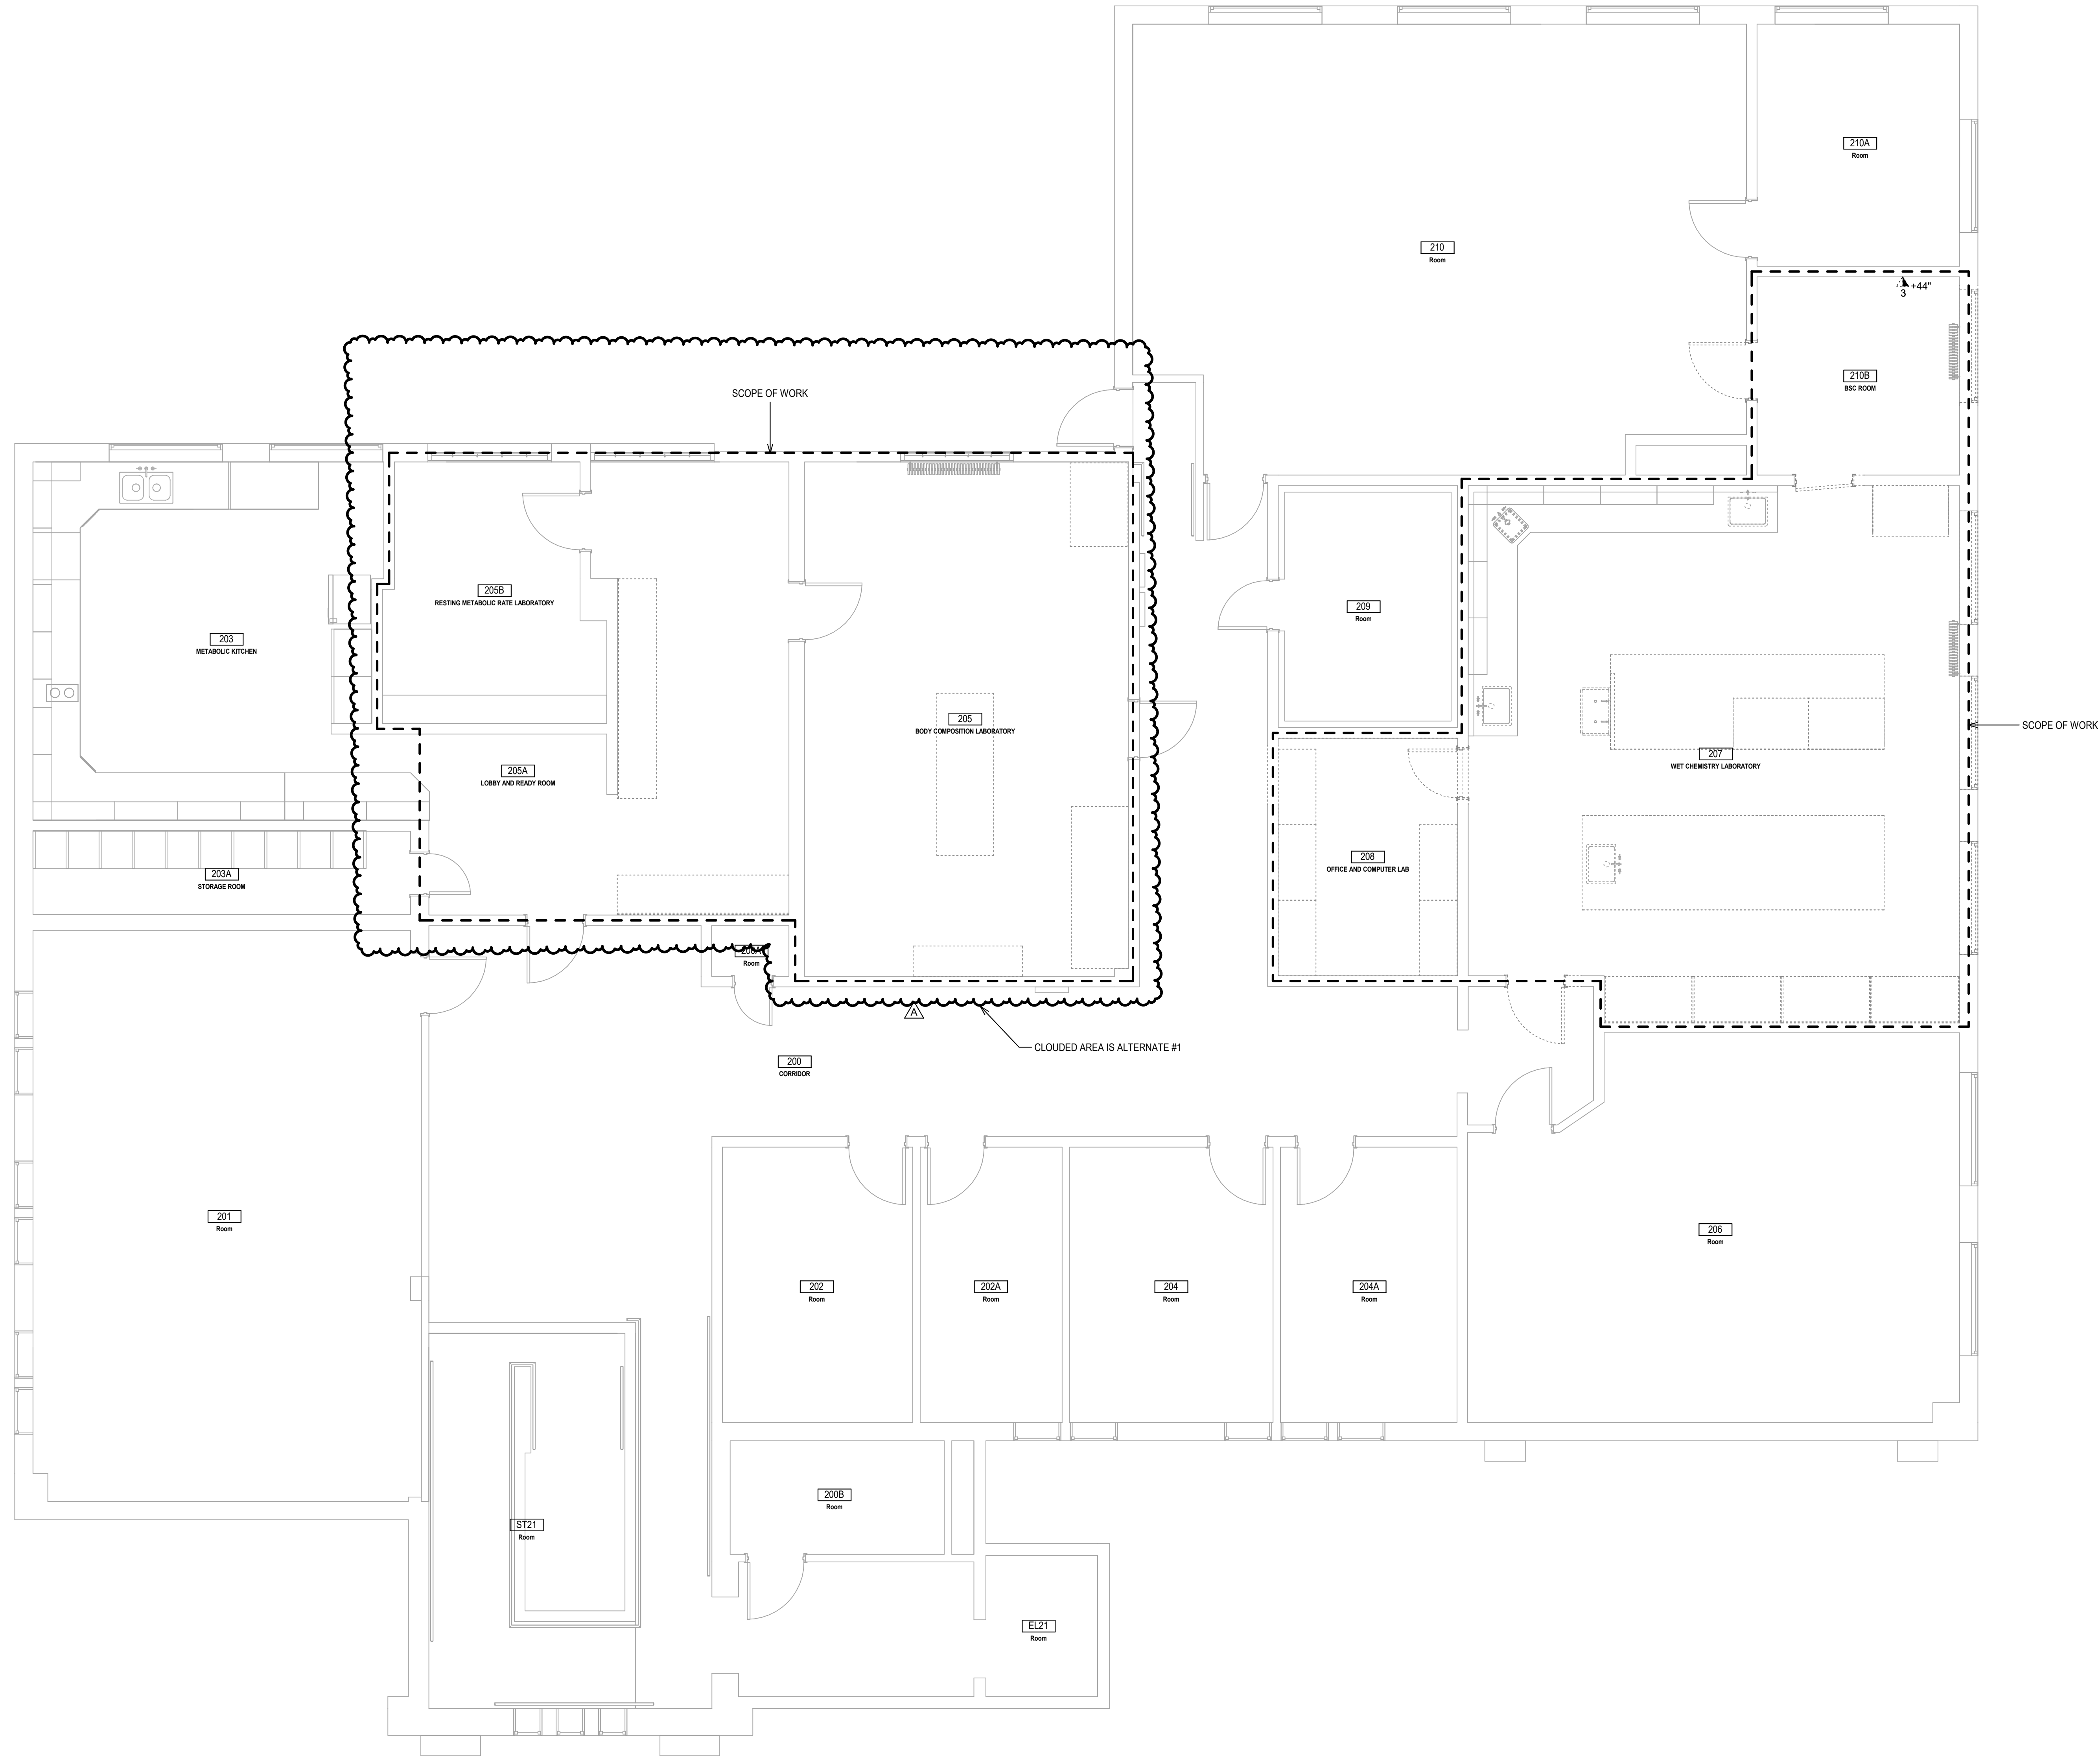

knitstudios.com
 THESE DOCUMENTS HAVE BEEN PRODUCED AS AN INSTRUMENT OF SERVICE AND ARE INTENDED SOLELY FOR THE PURPOSES OF CONTRACTING LINES AND MARKING THE PROJECT. ANY USE OF THESE DOCUMENTS OR USE OF THE DESIGN IDEAS OR CONCEPTS DESCRIBED HEREIN IN WHOLE OR IN PART BY ANY MEANS WHATSOEVER IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KMIT.
 REPRODUCTION OF THESE DOCUMENTS IS STRICTLY PROHIBITED EXCEPT BY WRITTEN CONSENT OF KMIT.

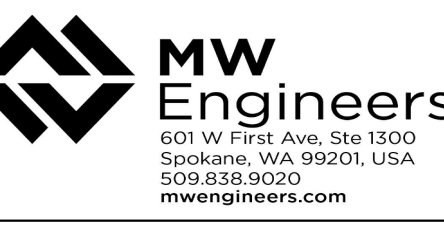

ISSUE DATE: **12.20.2024**

REV	DATE	COMMENT
A	1/31/2025	Owner Revisions



DEMO FLOOR PLAN - TELECOM
 FOOD RESEARCH CENTER T1 - PHASE 1 (BUILDING #: 005)
 860 IDAHO AVE., MOSCOW, ID 83844
 UNIVERSITY OF IDAHO

TITLE	PROJECT	CLIENT

JOB NO: **240004**
 CAPITAL PROJECT NO: **CP220034**

TD2-11

LEVEL 2 - DEMOLITION PLAN - TELECOM
 1/4" = 1'-0"